

**WELLHEAD AREA SURVEY
THIRSTY'S BAR AND GRILL
ACHD SITE NO. 52
North Branch, Allegany County, Maryland**

ALWI Project No. AL7N001

1.0 INTRODUCTION

Advanced Land and Water, Inc. (ALWI) was retained by the Allegany County Health Department (ACHD) to prepare a Wellhead Survey Area for Thirsty's Bar and Grill, located on the east side of Uhl Highway (MD Route 51) in southern Allegany County, Maryland. This site, designated No. 52 by ACHD, is served by one production well completed in the local bedrock aquifer.

The draft Maryland Department of the Environment (MDE) "Transient Water Systems Operations Guidance" manual (herein termed the "Guidance Manual") defines a Non-Transient Non-Community (NTNC) Water System as one that "...serves at least 25 regular consumers over 6 months per year." An informal interview with the bartender suggested that the regular clientele (an average of 50 nightly), the year-round operations, and the lack of nearby tourist attractions drawing transient customers all combine to suggest that this water system is indeed a non-transient non-community system (NTNC).

1.1 PURPOSE

The Safe Drinking Water Act (SDWA) of 1974 required the U.S. Environmental Protection Agency (EPA) to develop enforceable drinking water quality standards to protect the public health. In 1986, amendments made to the SDWA strengthened provisions for the protection of underground sources of drinking water. These amendments included provisions for establishing Wellhead Protection Programs by individual states under "umbrella" EPA oversight. The EPA approved a statewide Wellhead Protection Program developed by MDE in June 1991.

The MDE program originally applied to community water supplies, only. A newly proposed broadening of the federal Clean Water Act will have the result of expanding the MDE Wellhead Protection Program to encompass non-community supplies both transient and non-transient in nature. ACHD, in cooperation with MDE, established this program to bring existing non-community supplies into compliance with the coming regulations.

1.2 SCOPE

ALWI prepared this Wellhead Survey Area following ACHD requirements, which followed MDE guidelines for transient system operation and wellhead protection.

1. **Site Reconnaissance, Photographic Documentation and Interviews** – ALWI observed the on-site wellhead, storage, treatment, and distribution infrastructure to the degree exposed without excavation or exposure to personal hazards. ALWI used an ACHD-owned digital camera to photograph conditions surrounding the wellhead at the time of the field reconnaissance. Said photographs are stored on ACHD's computer system. ALWI interviewed the owner/operator and/or employee(s) to document information on the use patterns, history, and problems associated with the supply.
2. **Baseline Water Quality Assessment** - ALWI purged the water system and collected samples for analysis in the ACHD laboratory that is affiliated with the Maryland Department of Health and Mental Hygiene (DHMH). ALWI performed this fieldwork in accordance with MDE potable water sampling criteria including in-field measurements of turbidity, chlorine, and pH. ACHD selected the analyte list based on countywide experience with potability concerns and the capabilities of the aforementioned laboratory. The analytes included total and fecal coliform bacteria, nitrates, nitrites, iron, sulfur and manganese (Appendix A).
3. **Contamination Hazard Assessment** – ALWI identified existing and potential contaminant hazards within the delineated area based on visual observations and the techniques enumerated above. ALWI ranked these hazards in term of relative risk and provided concrete suggestions for their appropriate address. More generally, herein ALWI provides specific recommendations for source reduction measures, contingency plans, and other methods that may help better protect against occurrences of groundwater contamination.

2.0 HYDROGEOLOGIC FRAMEWORK

ALWI used published information from the United States Geological Survey and the Maryland Geological Survey to identify and describe the characteristics of the local hydrogeologic setting.

2.1 BEDROCK GEOLOGY

Thirsty's is situated within the Valley and Ridge physiographic province and is underlain by fine-grained sedimentary rock of Devonian age. The Hamilton Group, which mainly consists of the Marcellus and Needmore shales (Cleaves, 1968). These rocks have been folded and faulted, resulting in synclines (concave-upward folds) and anticlines (convex-upward folds).

In three dimensions, the local rock formations dip at right angles to the direction of plunge of the fold system. In general, dip directions may help govern groundwater (and contaminant) movement directions in the bedrock but plunge directions have less relation. At this location, the bedding planes dip to the east, which suggests that the gentle southwesterly plunge may exert greater-than-usual control on deep groundwater flow directions. Reported well yields within the Hamilton Group are sparse but average 6 gpm (Slaughter and Darling, 1962).

2.2 SAPROLITE AND SOIL MANTLE

Natural chemical weathering of the shallow portion of the bedrock, due to percolating water, has chemically altered many of the original rock-forming minerals to clays and other secondary minerals. This has resulted in the development of shallow saprolite (weathered bedrock) and the overlying soil mantle. The thickness of the soil and saprolite varies considerably over short distances depending on the thickness of Quaternary alluvial deposits and other factors. In highly fractured zones, enhanced groundwater storage and movement has accelerated the breakdown of the rock-forming minerals and has caused formation of a thicker saprolitic deposit.

2.3 AQUIFER RECHARGE

Precipitation infiltrating through the soil and Quaternary alluvium on site and/or in up-gradient areas is the primary source of aquifer recharge to the on-site supply well. Generally, overlying soil horizons act to absorb and then slowly release infiltrating precipitation. However, in areas where fracture zones have formed, percolating groundwater can reach the water table quickly. A portion of the precipitation percolates downward through the soil mantle and then migrates through narrow, interconnected joints, fractures, faults, and cleavage planes in the bedrock.

2.4 GEOLOGY-CONTROLLED GROUNDWATER FLOW

Generally, bedding plane partings and cross-bedding fracture zones (where present) function as both downward and lateral water conduits. Consequently, such zones receive and transmit water at a rate higher than would otherwise be achievable and, accordingly, are preferential conduits for groundwater flow and contaminant transport.

3.0 WATER QUALITY ASSESSMENT

Slaughter and Darling (1962) reported the water quality from the Hamilton Group as locally variable (iron concentrations range from 0.79 to as much as 8.2 micrograms per liter (mg/l); hardness ranges from 213 to 227 mg/l; and pH ranges from 7.1 to 7.7). ALWI interpreted that the slight reddish colors of the local rock exposures as likely attributable to the trace presence of iron.

At this location, ALWI collected baseline water samples on December 2, 1998, in accordance with the MDE sampling procedures specified in COMAR 26.08.05. ACHD's laboratory analyzed the samples for those constituents of countywide concern. These included total coliform bacteria as specified in COMAR 26.04.01.11A-C (alkalinity, color, conductance, hardness, iron, manganese, nitrate-nitrite nitrogen (COMAR 26.04.01.14(4)(a)), nitrite nitrogen (COMAR 26.04.01.14(4)(b)), pH, and total dissolved solids. The results are included as Appendix A, and suggest potability relative to the samples collected.

4.0 DELINEATION

ALWI delineated an area of potential concern surrounding this site's well using generalized criteria developed by MDE for non-community supplies, as modified by ALWI (with ACHD consent) based on the specific topographic setting of the site. ALWI began by using a fixed radius of 1,000 feet around the well. From this radial area, ALWI then excluded downgradient areas more than 100 feet from the wellhead as well as areas unlikely to contribute recharge to the well based on intervening streams and/or drainage divides. ALWI also excluded steeply-sloping cross-gradient areas.

The resultant delineation is shown on the "Water Plant Information" survey form (Appendix B) and encompasses approximately 67% of the circle (originally 72 acres in size) or 48 acres. Within an assumed 600 gallons per day per acre (gpd/ac) of annualized groundwater recharge (Slaughter and Darling, 1962, Table 37), slightly less than 29,000 gallons per day exists within the aquifer beneath this surveyed area. In actuality, the modest demand of this well is much smaller than the total available in the surveyed area, lending a high degree of conservatism to this analysis.

Negligible nitrate-nitrogen concentrations were detected in the sample ALWI collected. This obviated the need for a nitrate balance assessment.

5.0 CONTAMINANT THREATS ASSESSMENT

ALWI performed a site reconnaissance on December 2, 1998. During the reconnaissance, local land use conditions were observed with emphasis on the potential use, storage and disposal practices of hazardous materials and petroleum products. Such conditions may have included visual evidence for present or former spills, stained or discolored ground surfaces, stressed vegetation, unusual odors, or visible underground storage tank (UST) facilities. Adjacent and nearby properties were also visually scanned for such evidence from the property and nearby public right-of-ways. Off-site properties were not entered. ALWI relied on the accuracy of interviews for this information.

No discharge to groundwater has been confirmed by any of the facilities or practices ALWI observed. Design, construction and present condition are important factors in determining a well's susceptibility to contamination. No well tag was visible. Accordingly, ALWI could not assess the initial design nor present condition of the casing or grout seal. ALWI observed that the portion of the casing exposed at ground surface appeared intact and was equipped with a conventional pitless-style cap of the type that can sometimes allow insects to enter the well. An upgrade to a more modern cap would provide greater protection against microbial contamination.

The owner reports historical problems with the on-site wastewater disposal system. The present practice is to store wastewater in an above-ground cistern. The cistern is periodically pumped out on an as-needed basis. However, if the cistern would overflow, contamination of the well might

occur depending on the spilled volume and direction of its overland flow. There is also risk of contamination in the event of a spill or accident during the manual pumpout procedure.

6.0 CONCLUSION AND RECOMMENDATIONS

ALWI found that the supply is potable relative to the analyses performed. No discharge to groundwater has been confirmed by any of the facilities or practices ALWI observed. ALWI recommends that the owner replace the cistern with a new convent and septic system. An interview with an employee suggested that future hook up to public sewer is planned. This would provide even greater protection from well contamination than the present weekly pumpouts.

7.0 SELECTED REFERENCES

Cleaves, Emery T., Jonathan Edwards Jr. and John D. Glaser, 1968. Geologic Map of Maryland: Maryland Geologic Survey, 1:250,000.

MDE Public Drinking Water Program, 1998, Transient Water System Operations Guidance; Guidance For Counties With Delegated Responsibilities (Draft), 45p.

Slaughter, Turbit H. and John M. Darling, 1963, The Water Resources of Allegany and Washington Counties: Maryland Department of Geology, Mines, and Water Resources, Bulletin 24, p. 408.

NONCOMMUNITY WATER SUPPLY SANITARY SURVEY

1. System Name: <u>Good Investments T/A Thirsty's</u>		2. WAS: <u>52</u>	
System Information: Address: <u>14418 Uhl Highway, S.E.</u> <u>Cumberland, Maryland</u> Phone No.: <u>(301) 777-1617</u>		4. ADC Map/Grid: <u>N/A</u>	5. Tax Map/Plat: <u>N/A</u>
		6. Population: Transient <u>unknown</u> Regular <u>50 +/-</u> Total <u>unknown</u>	
7. Property Information: Owner's Name <u>Messrs. Abel and Bingham</u> Address: <u>14418 Uhl Highway, S.E.</u> <u>Cumberland, Maryland</u> Phone No. <u>(301) 777-1617 (301) 724-9025</u>		8. No. Service Connections:	
		9. Type of Facility: Food Service <u> x </u> Church <u> </u> Campground <u> </u> Daycare <u> </u> Other (specify) <u> </u>	
10. Contact Person: Name: <u>Messrs. Abel and Bingham</u> Phone No. <u>(301) 724-9025</u>	11. Operator: Name: <u> </u> Cert. No. <u> </u>		
12. Sample History (Has the system had any violations?): Bacteria: <u>None apparent or reported</u> Nitrate: <u>None apparent or reported</u>			

SURVEY RESULTS

13. Comments on System, Recommendations:

ALWI found that the supply is potable relative to the analyses performed. No discharge to groundwater has been confirmed by any of the facilities or practices ALWI observed. ALWI recommends that the owner replace the cistern with a new convent and septic system. An interview with an employee suggested that future hook up to public sewer is planned. This would provide even greater protection from well contamination than the present weekly pumpouts.

14. Inspected by: <u>Mark W. Eisner</u>	15. Date inspected: <u>12/03/98</u>	16. System Vulnerability Protected <u> x </u> Vulnerable <u> </u>
--	--	---

WATER PLANT INFORMATION

17. Type of Treatment:
(Check all that apply)

- Disinfection
- Gas Chlorine: _____
- Sodium Hypochlorite _____
- Ultraviolet Radiation
- Iron Removal _____
- Nitrate Removal _____
- PH Neutralizer _____
- Other _____
- Unknown _____

18. System Schematic (Process Flow):



NOTE: This diagram is a simplified schematic of operational process flow observed or described on the date of the reconnaissance. Many water systems possess malfunctioning, disconnected and/or occasionally/regularly-bypassed equipment. Actual treatment processes may differ, therefore, from those shown herein.

19. System Storage:

- Ground Storage _____
- Elevated Storage _____
- Hydropneumatic Tank
- Other _____

20. Storage Capacity:

Typical Domestic

21. Untreated water sampling tap?

Yes _____ No

WELL INFORMATION


22. Well Information:

- Tag Number: not visible
- Year Drilled: _____
- Casing Depth: _____
- Well Depth: _____
- Well Yield: _____
- Casing Height: _____
- Grout Depth: _____
- Pitless Adapter? _____
- Wiring OK? unknown
- Pump OK? unknown

23. Well Type:

- Drilled
- Driven _____
- Dug _____

24. Well Location Diagram (1 in. = 1250 ft.) with Approximate Distances from Potential Contaminant Sources (i.e. septic, sewer lines, structures, petroleum storage, surface water bodies, etc.):

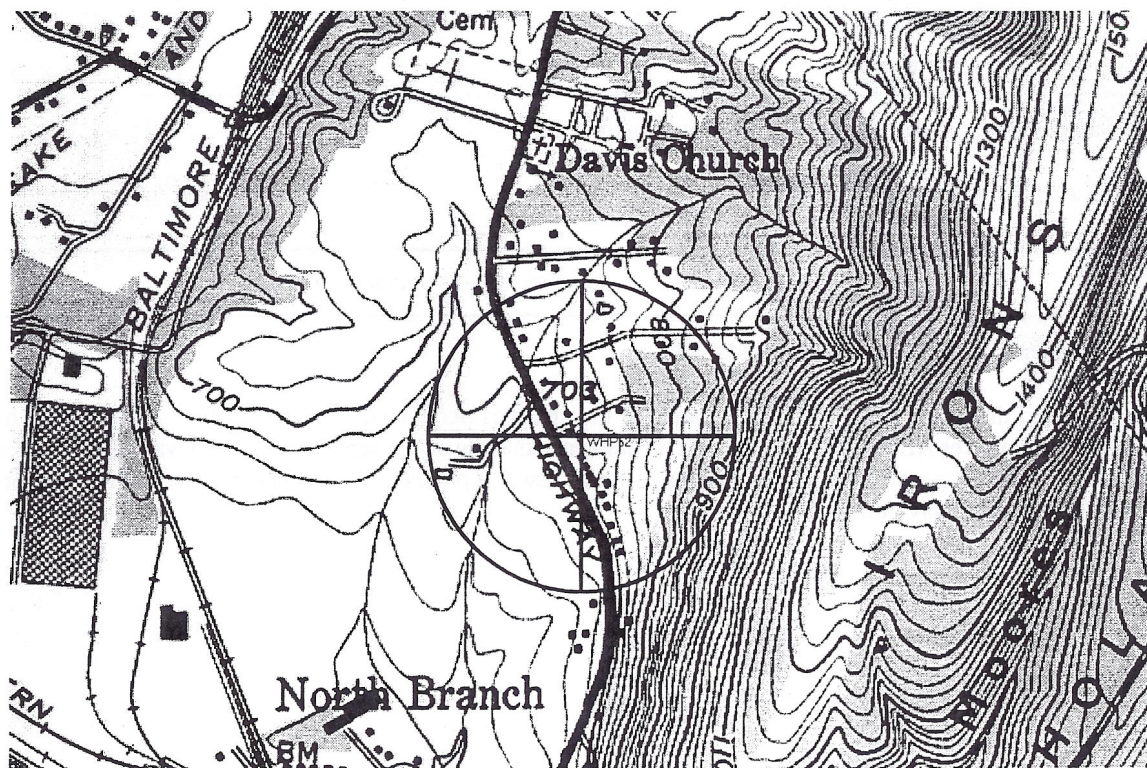

25. Aquifer:

- Name: Hamilton
- GAP #: _____
- Confined _____
- Unconfined
- Semi-confined _____

26. Quantity Used:

- Daily Avg (gpd) 600
- Pumping Rate (gpm) unknown
- Hours run per day unknown

27. Well Cap:

- Type? _____
- Seal Tight? O.K.
- Vented? O.K.
- Screened? No
- Conduit OK? O.K.

28. Casing Diameter:

- 2" _____
- 4" _____
- 6"
- Other _____

29. Casing Type:

- PVC _____
- Metal
- Concrete _____