


# Reduced Lead/Copper Monitoring

(After two consecutive 6 month monitoring periods in which the lead and copper AL is not exceeded)

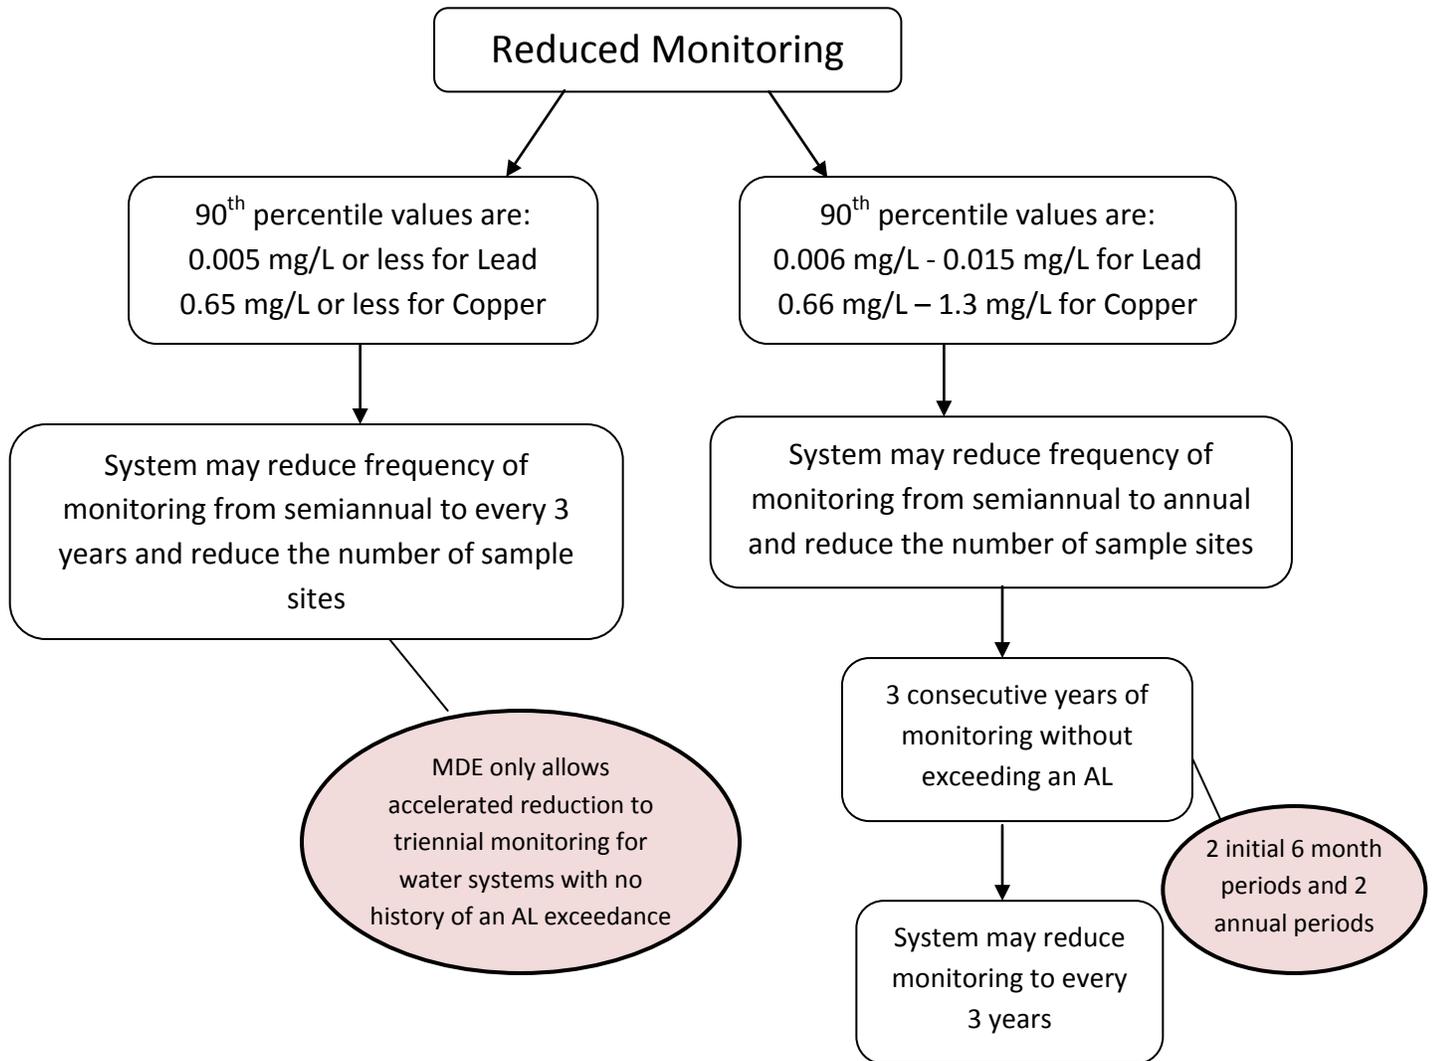

**Note:** If the lead Action Level (AL) is exceeded at any point then the System must deliver a public education program. If the system continues to exceed the Lead AL after optimizing CCT, then it must replace lead service lines if applicable.

- Reduced Lead/Copper Monitoring must occur June-September