



TESTING FOR LEAD IN DRINKING WATER for MARYLAND PUBLIC AND NONPUBLIC SCHOOLS

Prepared for:

Larry Hogan, Governor
State of Maryland

and the Maryland General Assembly

December 2018



Maryland
Department of
the Environment

Ben Grumbles
Secretary



Karen B. Salmon
State Superintendent

Table of Contents

EXECUTIVE SUMMARY	1
BACKGROUND	2
REGULATION IMPLEMENTATION	4
MARYLAND’S LEAD TESTING PROGRAM	6
Initial Testing Results for Public, Charter, and Nonpublic Schools	6
Testing Deferrals	7
Waivers	8
Successes	8
Challenges	8
Conclusion	9
APPENDICES	10
Appendix A: Glossary	
Appendix B: Flow Chart	
Appendix C: Table 1. Schools Completing Lead Testing – Public Schools	
Table 2. Schools Completing Lead Testing – Charter Schools	
Table 3. Schools Completing Lead Testing – Nonpublic Schools	
Appendix D: Table 4. Lead Samples Collected – Public Schools	
Table 5. Lead Samples Collected – Charter Schools	
Table 6. Lead Samples Collected – Nonpublic Schools	
Appendix E: Table 7. Elevated Lead Levels – Public Schools	
Table 8. Elevated Lead Levels – Nonpublic Schools	
Appendix F: Table 9. Twelve-Month Deferrals – Public Schools	
Table 10. Twelve-Month Deferrals – Charter Schools	
Table 11. Twelve-Month Deferrals – Nonpublic Schools	
Table 12. Three-Year Deferrals – Public, Charter, Nonpublic Schools	
Appendix G: Table 13. Waivers – Prior Testing – Public, Charter, Nonpublic Schools	
Table 14. Waivers – Bottled Water – Public, Charter, Nonpublic Schools	
Table 15. Waivers – Lead-Free Building – Public, Charter, Nonpublic Schools	
Appendix H: References	

EXECUTIVE SUMMARY

Maryland House Bill 270 (HB 270), passed during the 2017 legislative session, provided a framework to reduce Maryland school children's exposure to lead in drinking water. HB 270 directed the Maryland Department of the Environment (MDE), in consultation with the Maryland State Department of Education (MSDE), the Department of General Services (DGS), and the Maryland Occupational Safety and Health (MOSH), to adopt regulations to require periodic testing for the presence of lead in each drinking water outlet located in an occupied public or nonpublic school building. The bill required MDE to establish a stakeholder group and to gather information about the testing processes, protocols, and efforts undertaken by schools to test for and remediate lead. The bill also required MDE, in consultation with MSDE, to provide a mechanism to grant waivers from testing to schools under certain circumstances. Furthermore, by Dec. 1, 2018, and on or before December 1 each year thereafter, MDE and MSDE must jointly report to the Governor on the findings of the lead testing conducted by schools.

This report details the first year of Maryland's program for lead testing in the drinking water for public and nonpublic schools and the progress made toward identifying and reducing exposure to lead through drinking water in schools; it summarizes activities for the period of June 1, 2017, when the law became effective, through July 1, 2018, when the first phase of lead testing ended. This report presents the findings of the lead testing in schools serving children in prekindergarten through grade 5 and/or school buildings built before 1988, and schools serving children in grades 6 through 12 and built 1988 or later that have elected to test early.

Approximately 2.9% of the 25,350 lead samples collected and analyzed had elevated levels of lead. When outlets used for drinking, food preparation, or cooking are found to have elevated levels of lead in the water, immediate removal from service is required. Through continued testing and remediation, Maryland's goal is to reduce the rate of elevated lead in water to zero, thereby reducing exposure to lead in the drinking water for approximately 1 million children who rely on water provided by Maryland's 3,000 public and nonpublic schools.

BACKGROUND

This report summarizes the lead testing results of drinking water samples collected during the 2017-2018 school year at Maryland's public and nonpublic schools; it has been prepared for the Governor's Office in accordance with Section 6-1502(E) of the Environmental Article of the Annotated Code of Maryland.

[House Bill 270](#) was signed into law on May 4, 2017, and became effective on June 1, 2017. The bill directed:

- MDE, in consultation with MSDE, DGS, and MOSH, to adopt regulations requiring periodic testing for lead in each drinking water outlet located in an occupied public or nonpublic school building;
- MDE establish a stakeholder group to provide advice and make recommendations regarding the development of the regulations;
- MDE to gather information about the testing processes, protocols, and efforts undertaken by County school systems and nonpublic schools to establish a safe and lead-free environment, including the status of testing plans and any resultant remedial measures;
- MDE, in consultation with MSDE, to provide a mechanism to grant waivers from testing to schools under certain circumstances;
- The initial round of sampling to be completed by July 1, 2018; and
- MDE and MSDE to jointly report to the Governor by Dec. 1, 2018, and on or before December 1 each year thereafter, on the findings of the lead testing conducted by schools.

In June 2017, MDE convened a Stakeholders Advisory Group consisting of two members of the House of Delegates including the Bill sponsor, representatives of MDE, MSDE, other State agencies, County school systems, private schools, the Maryland Association of Boards of Education (MABE), the Public School Superintendents' Association of Maryland (PSSAM), advocates, and various other organizations. The group met three times between July 2017 and October 2017 to provide input to facilitate the drafting of regulations to implement the law.

In September 2017, MDE sent surveys to public school superintendents, charter schools, and private schools that are members of the Maryland chapter of the Council for American Private Education (CAPE) in an effort to gather information about the level of testing and remediation for lead in drinking water that has occurred in schools.

MDE presented draft regulations to the Stakeholders Advisory Group for review and comments on Oct. 26, 2017. The proposed action on the regulations, *Lead in Drinking Water – Public and Nonpublic Schools*, was published in the [Maryland Register](#) on Feb. 2, 2018, for a 30-day comment period. A public hearing was held at MDE on Feb. 28, 2018, and the regulations became effective on April 9, 2018.

Between March 23, 2018, and May 11, 2018, MDE provided six regional training sessions to assist schools with implementing the testing requirements and understanding the regulations. Over 200 persons attended the training, including school personnel (administrators, facilities/environmental departments, teachers, school organizations), laboratory personnel, and consultants.

[MDE's website](#), consisting of Frequently Asked Questions, summaries of the findings of the testing, and links to the law, regulations, written comments on the proposed regulations, guidance materials, including sampling instructions and the training presentation, educational materials, forms, templates, applications for waivers and deferrals, state-certified laboratories, and other helpful information, was launched on May 22, 2018.

As of Oct. 15, 2018, MDE had received over 25,300 lead sample results for 415 schools (322 public schools, three charter schools, and 90 nonpublic schools) that had completed testing by July 1, 2018, 767 applications for deferrals from initial testing, and 130 applications for waivers.

MDE has contracted with an outside vendor, 120WaterAudit, to provide software to track the lead in drinking water sampling data, school inventory information, deferrals, waivers, public notification, and remediation. This software will streamline the reporting process for schools by allowing schools to report data to one location that can be shared among the various state and local agencies that are required to receive and review such data. MDE is also working with the Maryland Department of Health (MDH) to provide a map-based presentation of the lead sample results throughout the state.

This report and its findings will be made available to Maryland citizens through MDE's website.

REGULATION IMPLEMENTATION

The [regulations](#), effective on April 9, 2018, require all occupied public and nonpublic schools, serving children in prekindergarten to grade 12, that receive drinking water by a public water utility to test for the presence of lead in all drinking water outlets. Testing is to be conducted every three years and must be performed during the regular school year while school is in session. As specified in the law, testing is phased in based on age of the students and the age of the school building; schools serving the youngest students (younger children are more vulnerable to the health effects of lead) and school buildings built before the federal lead ban are the highest priority. The regulations also provide options for schools to defer the initial sampling for either 12 months or three years, and schools may also waive out of testing altogether if specific criteria is met, as set forth in the law.

The regulations require that all drinking water outlets in a school building are tested for lead in accordance with specific [sample procedures](#). If testing reveals that an outlet has an elevated level of lead greater than 20 parts per billion (ppb), schools must immediately remove all access to that outlet until the outlet can be remediated, replaced, or removed

Outlets are prioritized according to use – all outlets in schools that provide water for drinking, cooking, or food preparation must be tested for lead. Outlets that are not used for consumption are not required to be tested for lead, however, they must be clearly labeled with signs indicating that the water is not to be used for consumption. Schools must notify students, parents, and staff of any elevated levels of lead. As directed by HB 270, the regulations follow the guidance in the U.S. Environmental Protection Agency’s *3Ts for Reducing Lead in Drinking Water in Schools*, for standards, including sampling procedures, action level, and outlet prioritization.

The regulation provides for deferral of initial testing under specific conditions. MDE, in consultation with MSDE, may grant a deferral not to exceed 12 months from the initial due date if a school has a plan in place for testing all drinking water outlets, as well as a plan detailing actionable steps to be taken if elevated levels of lead are found in a sample from any drinking water outlet. Also, in consultation with MSDE, MDE may grant a school a deferral not to exceed three years from the initial due date if the school has completed testing for all drinking water outlets in the school in accordance with the regulations, and no test results exceed the action level (AL) of 20 ppb.

A waiver from future testing may be granted by MDE in consultation with MSDE under certain specific situations:

- *Type 1, Prior Testing*: All drinking water outlets tested for lead no earlier than five years before the effective date of the regulations, and every test result for every sample collected was 5 ppb or lower;

- *Type 2, Bottled Water:* Students in the building do not have access to piped water from any drinking water outlet, and bottled water that meets all National Primary Drinking Water standards is the only source of water for drinking and food preparation; or
- *Type 3, Lead-Free Building:* The service line, all plumbing connecting the school to the water main, and all interior plumbing in the school building is certified to be lead-free.

Unless the school has been granted a waiver as described above, it must repeat testing every three years. Schools granted deferrals must repeat testing three years from the initial date as stipulated in the regulation (i.e., not three years from the deferred due date). Newly constructed schools put into service after the effective date of this regulation must complete initial testing within 12 months of occupancy.


MARYLAND'S LEAD TESTING PROGRAM: 2017 – 2018 SCHOOL YEAR

Initial Testing Results

The first phase of testing ended July 1, 2018. Schools for which the required initial testing was to be completed by July 1, 2018, include all schools in buildings constructed before 1988, and all schools serving students age prekindergarten through grade 5, regardless of the age of the buildings. Schools with overlapping age groupings are required to test by the earliest specified date. It should be noted that there are some schools that completed their testing by July 1, 2018, even though their initial testing due date may have been July 1, 2019, or July 1, 2020; the test results of those schools are included in the current reporting cycle.

A total of 415 schools completed testing by July 1, 2018, in accordance with the requirements of COMAR 26.16.07.07. Of these, 322 (77%) were public schools, three (1%) were charter schools, and 90 (22%) were nonpublic schools (see Figure 1 below). Names and locations of schools completing testing are presented in Tables 1 through 3 located in Appendix C.


Figure 1: Schools Completing Lead Testing by July 1, 2018

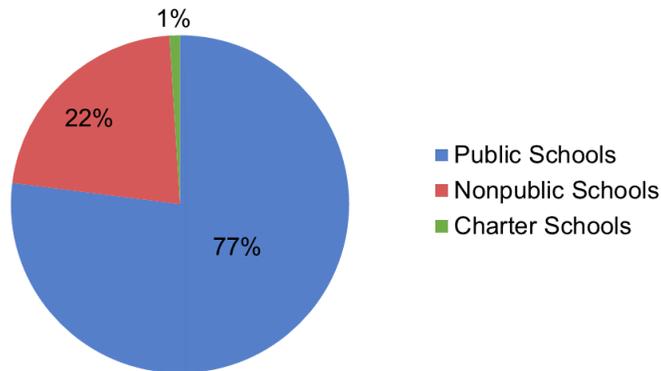

An elevated level of lead (above the AL of 20 ppb) was found at 186 of the 415 schools completing lead testing by July 1, 2018. There were 157 public schools with elevated results and 29 nonpublic schools with elevated results. No charter schools had elevated results (see Figure 2 below). Of the 25,348 outlets tested, elevated levels of lead were found at a total of 724 outlets (2.9%). Consumption outlets (i.e., outlets used for drinking, cooking, or food preparation) accounted for 382 (53%) of the elevated results and 277 (38%) were non-consumption outlets (i.e., outlets used only for purposes other than consumption and are not required to be tested). The remaining 65 (9%) elevated samples were taken at outlets that have not been identified as consumption or non-consumption. Elevated levels of lead were most frequently found in

classroom sinks (41%), followed by bathroom sinks (16%); drinking water fountains and kitchen sinks only comprised 12% and 9% of elevated outlets, respectively. A complete list of all outlets found to have elevated levels of lead, including the type, use, location and lead level of the outlet, is presented in tabular form in Tables 7 and 8 located in Appendix E.

Figure 2: Schools Reporting Elevated or Nonelevated Levels of Lead in Drinking Water

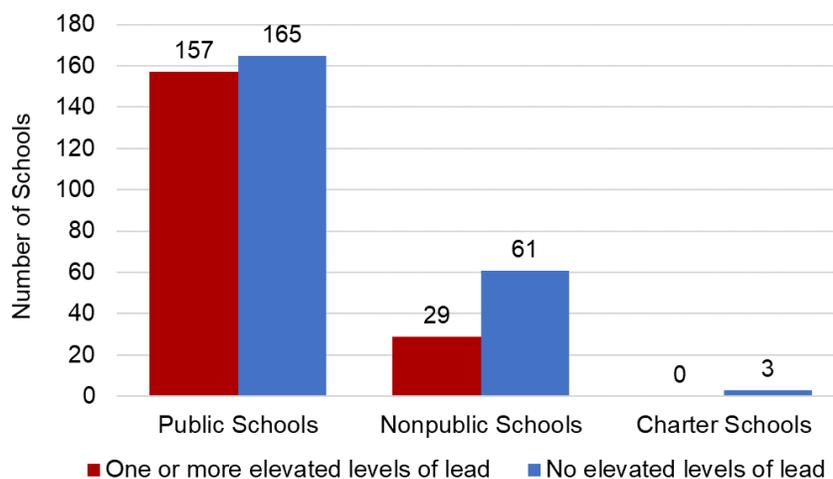

Deferrals

The accelerated schedule for implementation of HB 270 resulted in final regulations going into effect three months prior to the deadline for completion of the first round of sampling. Given this timeframe for sample collection and that schools could not be certain of which sample collection procedure to follow until the regulations were final, many schools elected to defer initial sampling, a provision included in both the law (as a waiver) and regulations. MDE, in consultation with MSDE, received and approved 662 applications for 12-month deferrals from schools that were scheduled for lead testing by July 1, 2018. Five hundred six of these were for public schools, 150 were from non-public schools, and six were from charter schools. Full details are presented in Appendix F.

Many schools had already completed some testing for lead in drinking water prior to enactment of HB 270. The provision for three-year deferrals is intended to allow schools who had already tested in a manner consistent with HB 270's requirements additional time before they needed to collect additional samples. One hundred five schools – 99 public, four nonpublic, and two charter – that were scheduled for lead testing by July 1, 2018, applied for three-year deferrals. To date, MDE has not granted three-year deferrals to any school. Full details are presented in Appendix F.

Waivers

A total of 130 schools that were scheduled for lead testing by July 1, 2018, have applied for waivers: 12 schools applied for “prior testing” (type 1) waivers; 112 schools applied for “bottled water” (type 2) waivers, and six schools applied for “lead-free building” (type 3) waivers. To date, MDE has not granted any waivers. Seven applications for “prior testing” waivers, 106 applications for “bottled water” waivers, and one application for “lead-free building” waiver have been denied, and the remaining applications are under review. Details are presented in Appendix G.

Successes

Convening a Stakeholder Advisory Group proved to be very valuable. The advice and recommendations from school personnel, laboratory personnel, nonpublic school umbrella associations, and members of the General Assembly ensured that the regulations developed were comprehensive, effective and workable. Information gathered in the September 2017 survey of public schools and nonpublic schools enabled MDE and MSDE to identify strengths and weaknesses of prior testing that had been conducted by schools, which allowed us to better target our limited resources.

Six training sessions – three at MDE headquarters in Baltimore and one each in Easton, La Plata, and Hagerstown – were useful in minimizing issues such as sampling errors and incomplete paperwork. The training covered all aspects of implementation of the law, including sampling and laboratory protocol, paperwork, notification requirements, remediation, and applying for deferrals and waivers. Attendees described the sessions as very helpful.

During the first reporting cycle, over 25,000 drinking water outlets have been tested for lead. Seven hundred twenty-four outlets were identified to have elevated levels of lead; those identified as consumption taps were immediately removed from service until they can be remediated, replaced, or permanently removed from service. Outlets identified as non-consumption taps were either remediated, replaced, or permanently removed from service, or were signed as not a drinking water outlet. Notification of students, parents, and school staff was required for any outlet with an elevated level of lead, regardless of whether the outlet was identified as consumption or non-consumption.

Challenges

A number of factors presented challenges for implementing the regulations for HB 270. While contact with, and outreach to, the public schools proved relatively easy since school districts and school district information are centralized at the county level in Maryland, contact with the nonpublic schools has been more challenging. Neither MDE nor MSDE had access to a comprehensive list of nonpublic schools, however, through assistance from CAPE and the work of MSDE, a list is now available. Unfortunately, the list does not include email addresses. CAPE,

the Archdioceses of Baltimore and Washington, and other organizations have all been very helpful in facilitating contact with some nonpublic schools.

The timeframe required to implement the regulations was challenging. The bill was signed into law on May 4, 2017, and took effect June 1, 2017. MDE convened a Stakeholders Advisory Group, meeting three times over the summer and fall of 2017. By the time the regulations were submitted in December 2017, and became effective on April 9, 2018, there were only a few weeks left in the school year and the first round of testing needed to be completed prior to the end of the school year.

Many schools and school systems have indicated that there was no funding dedicated for lead testing in the fiscal year budget and any remediation that may be necessary. Many schools facing an initial due date of July 1, 2018, reported that, while ultimately they would be able to secure sufficient funding, it would be impossible to do so with the remaining budget of the 2017-2018 school year. In addition, for newly constructed schools seeking a waiver based on a “lead-free” building, the expense incurred to receive the proper certification for a waiver from a licensed master plumber or professional engineer/architect may exceed that of testing; it may be that it is easier for truly “lead-free” schools to conduct a round of testing and then apply for a “prior testing” (type 1) waiver.

Finally, the reporting of lead sample data proved to be a challenge for many schools. In order to standardize the lead sample results and ancillary data for eventual import into a data tracking system, MDE developed a template in Excel format. In some cases, laboratories were able to populate the spreadsheet; in other cases, however, school personnel had to type this into the spreadsheet themselves, resulting in an increased workload. Additionally, the potential for error in transcription manual entry of the data is concerning. We expect this issue to be less of a problem as the program matures and more information can be uploaded electronically rather than typed in.

Conclusion

Although the program for lead testing in school drinking water is currently in its infancy, the initial results are promising: a total of 322 public schools, three charter schools, and 90 nonpublic schools successfully completed testing for lead in their drinking water during the first reporting year of this new initiative, which ended on July 1, 2018. As Maryland’s testing program continues and matures, and as the schools continue to remediate outlets showing elevated levels of lead, it will have a significant impact on reducing exposure to lead in the drinking water for approximately 1 million of Maryland’s children who rely on water provided by the nearly 3,000 public and nonpublic schools in the state.

APPENDIX A

Glossary

Action Level - A level of lead which, if exceeded, requires the school to complete steps including remedial action, notification, and follow-up sampling.

Bottled water - Water that is intended for human consumption and that is sealed in bottles or other containers and meets the National Primary Drinking Water regulations for all regulated contaminants.

Certified Laboratory - A laboratory certified by the Maryland Department of the Environment to analyze drinking water samples for lead.

Deferral - An extension in the time a school is allowed to complete initial testing.

Department - The Maryland Department of the Environment (MDE).

Drinking water outlet - A potable water fixture that is used for drinking or food preparation.

Drinking water outlets include:

- a. Drinking fountains (DF), including both bubbler and water cooler styles;
- b. Ice-making machines (IM);
- c. Hot drink machines (HD);
- d. Kitchen sinks (KS);
- e. Classroom combination sinks with drinking fountains (CF);
- f. Sinks in home economics classrooms (HE);
- g. Teachers' lounge sinks (TL);
- h. Nurse's office sinks (NO);
- i. Sinks in special education classrooms (SE);
- j. Any other sink known to be used for human consumption (OT).

NOTE: *Drinking water outlet does not include an outlet clearly signed as not a drinking water outlet.*

Elevated level of lead - A lead concentration in drinking water that exceeds the concentration of 20 parts per billion (ppb) in a 250 milliliter (mL) first-draw sample, as recommended by the EPA in technical guidance documents for schools, including "3Ts for Reducing Lead in Drinking Water in Schools (2006)."

First-draw sample (FD) - A 250 mL sample of tap water that has been standing in plumbing 8 to 18 hours and is collected without flushing the tap.

Flushed sample (FL) - A 250 mL sample of tap water that has been drawn from an outlet immediately after the outlet has been run for at least 30 seconds. Flushed samples are collected after all first-draw samples within the building have been collected.

Lead-free - Plumbing that meets the definition of “lead-free” as defined by the Annotated Code of Maryland, Business Occupations and Provisions Article, §§12-101, 12-605.1, and 12-605.2.

MDH - The Maryland Department of Health.

MSDE - The Maryland State Department of Education.

Nonpublic school - An elementary or secondary school, other than a public school, offering education for prekindergarten through grade 12 wherein any child may legally fulfill compulsory school attendance requirements.

Public School - A school, including a charter school that is maintained at public expense for the education of the children of a community or district and constitutes a part of a system of free public education for prekindergarten through grade 12.

School - An individual school or a school system.


School day - Any day on which school is in session.

School building - Any structure, facility, addition, or wing of a school that may be occupied by children or students pre-kindergarten to grade 12. This does not include buildings used solely for administrative purposes.

Technical Guidance - The most recent technical guidance documents issued by EPA for reducing lead in drinking water in schools, such as the “3Ts for Reducing Lead in Drinking Water in Schools” (2006) and any subsequent technical guidance documents issued by EPA for reducing lead in drinking water in schools.

Waiver - An indefinite exemption from testing.

Appendix B: Flow Chart

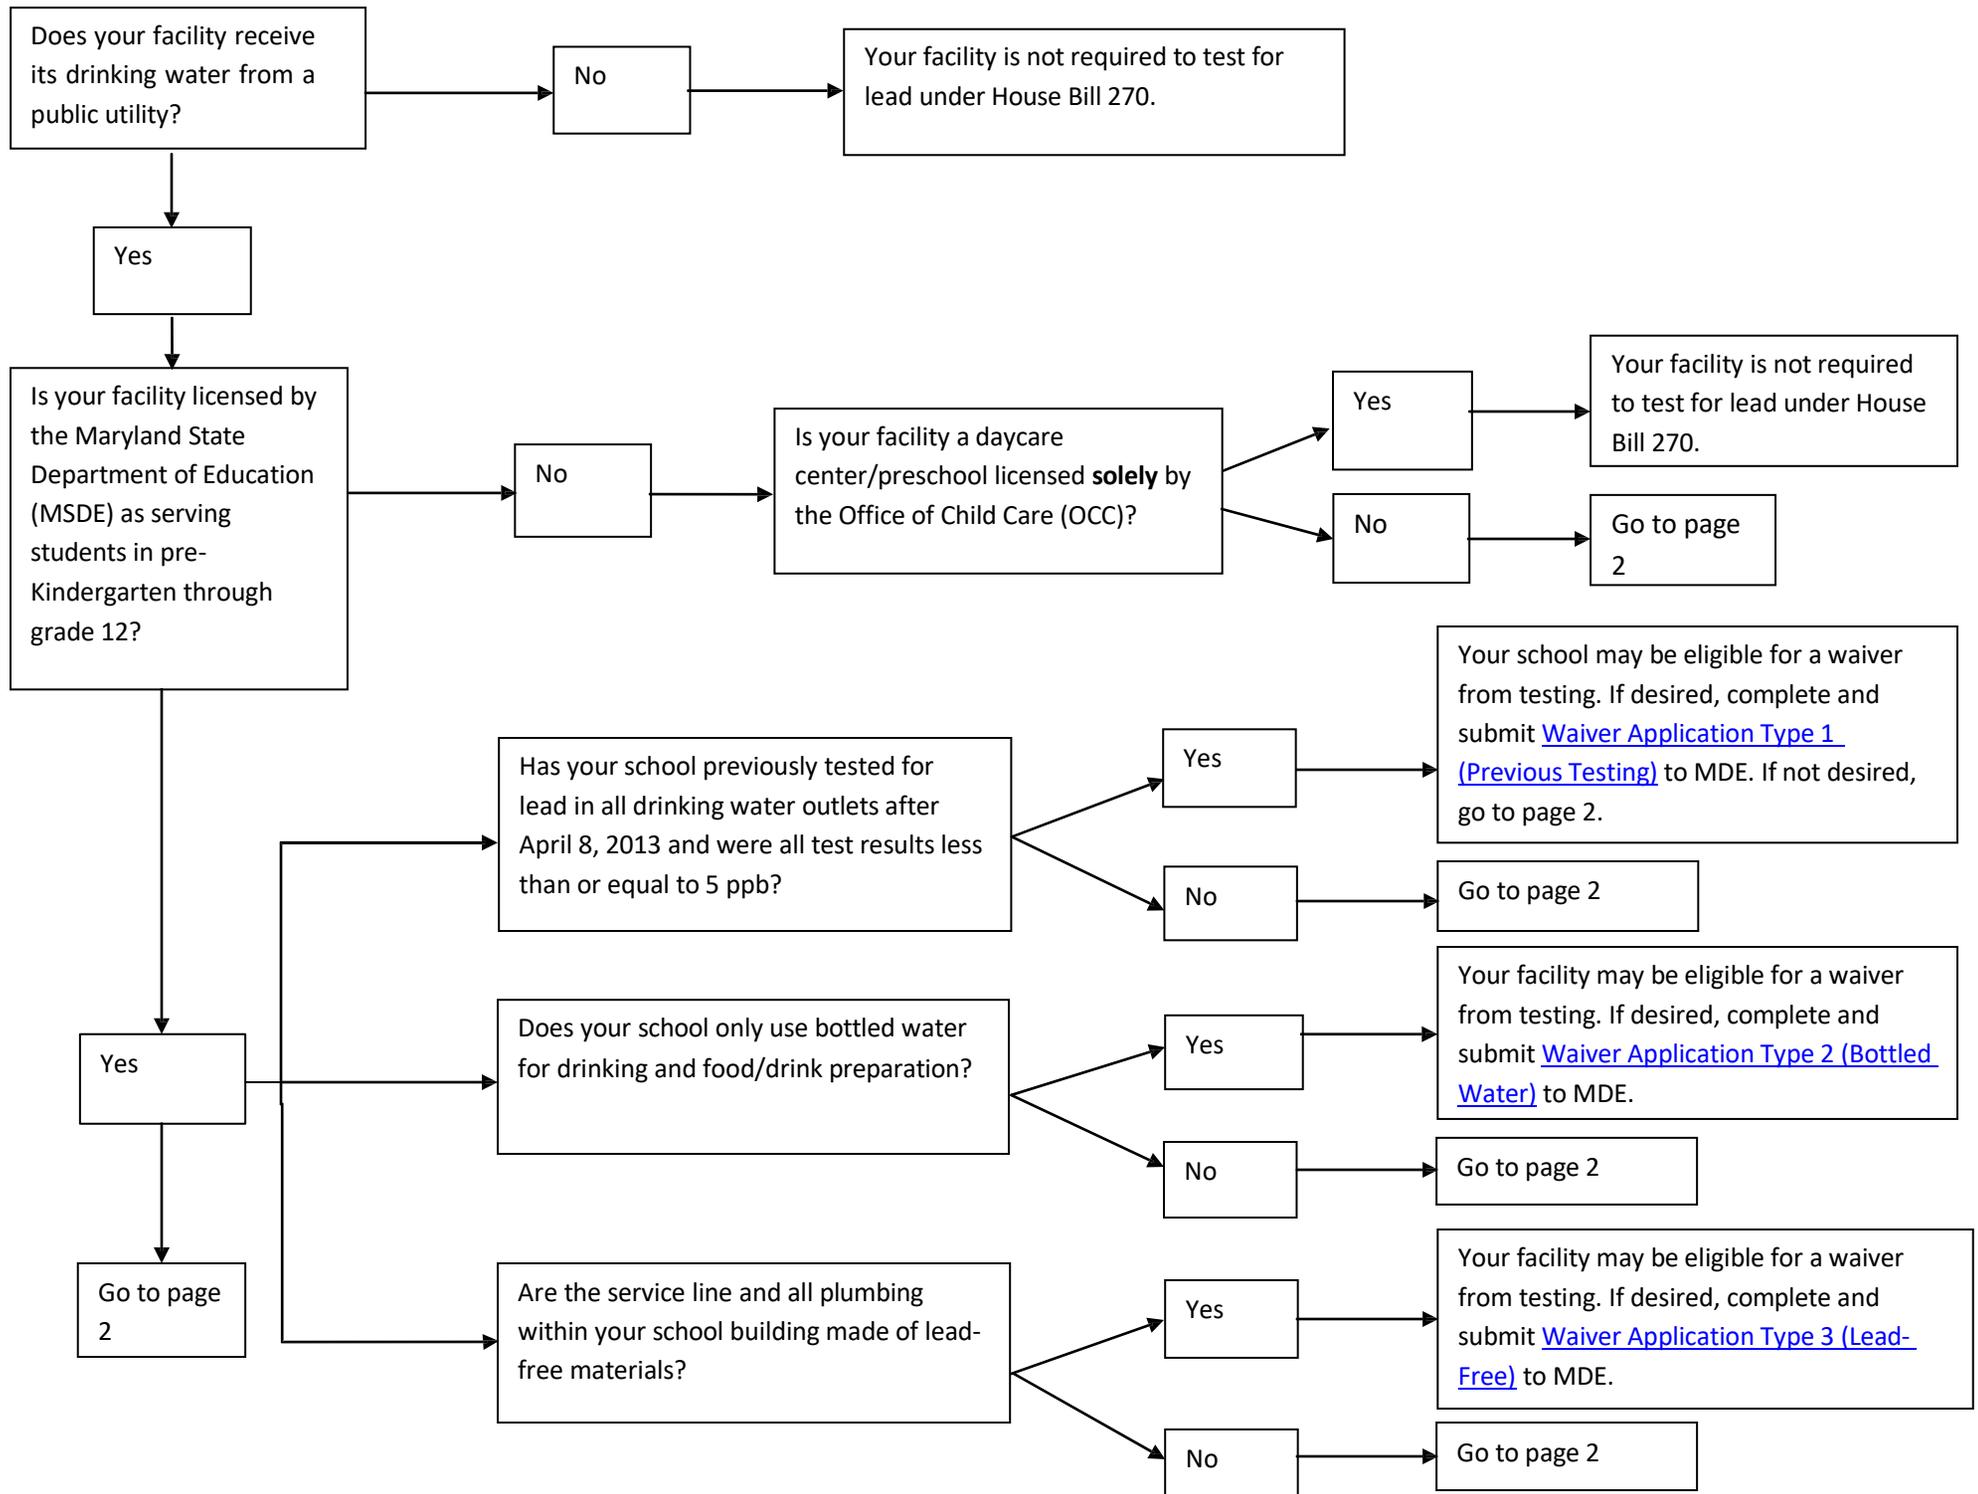

Test all outlets used for drinking water and food/drink preparation, including ice machines and hot drink machines and submit samples to laboratory for analysis within 14 days of sample collection. Any outlet that is not tested must have [signage](#).

Are all test results less than or equal to 20.4 ppb?

Yes

No

Go to page 3

Report all test results to MDE, MSDE, and your local health department within 30 days of samples being analyzed by the laboratory, using the following forms:

- [Sample Collection Form](#)
- [Laboratory Results Reporting Form](#)
- Official laboratory report signed by the Laboratory Director

Certify to MDE, MSDE, and the appropriate local health department that all drinking water outlets were tested in accordance with the regulation and provide other required information using the [Lead Sample Summary Certification Form](#) within 30 days after the samples were analyzed or 30 days after the end of the school calendar year in which the samples were collected.


Are all test results less than or equal to 5.4 ppb?


Yes

No

Your facility may be eligible for a waiver from future testing. If desired, **complete and submit** [Waiver Application Type 1](#) to MDE and MSDE. If not desired, repeat testing in 3 years.

Repeat testing in 3 years.

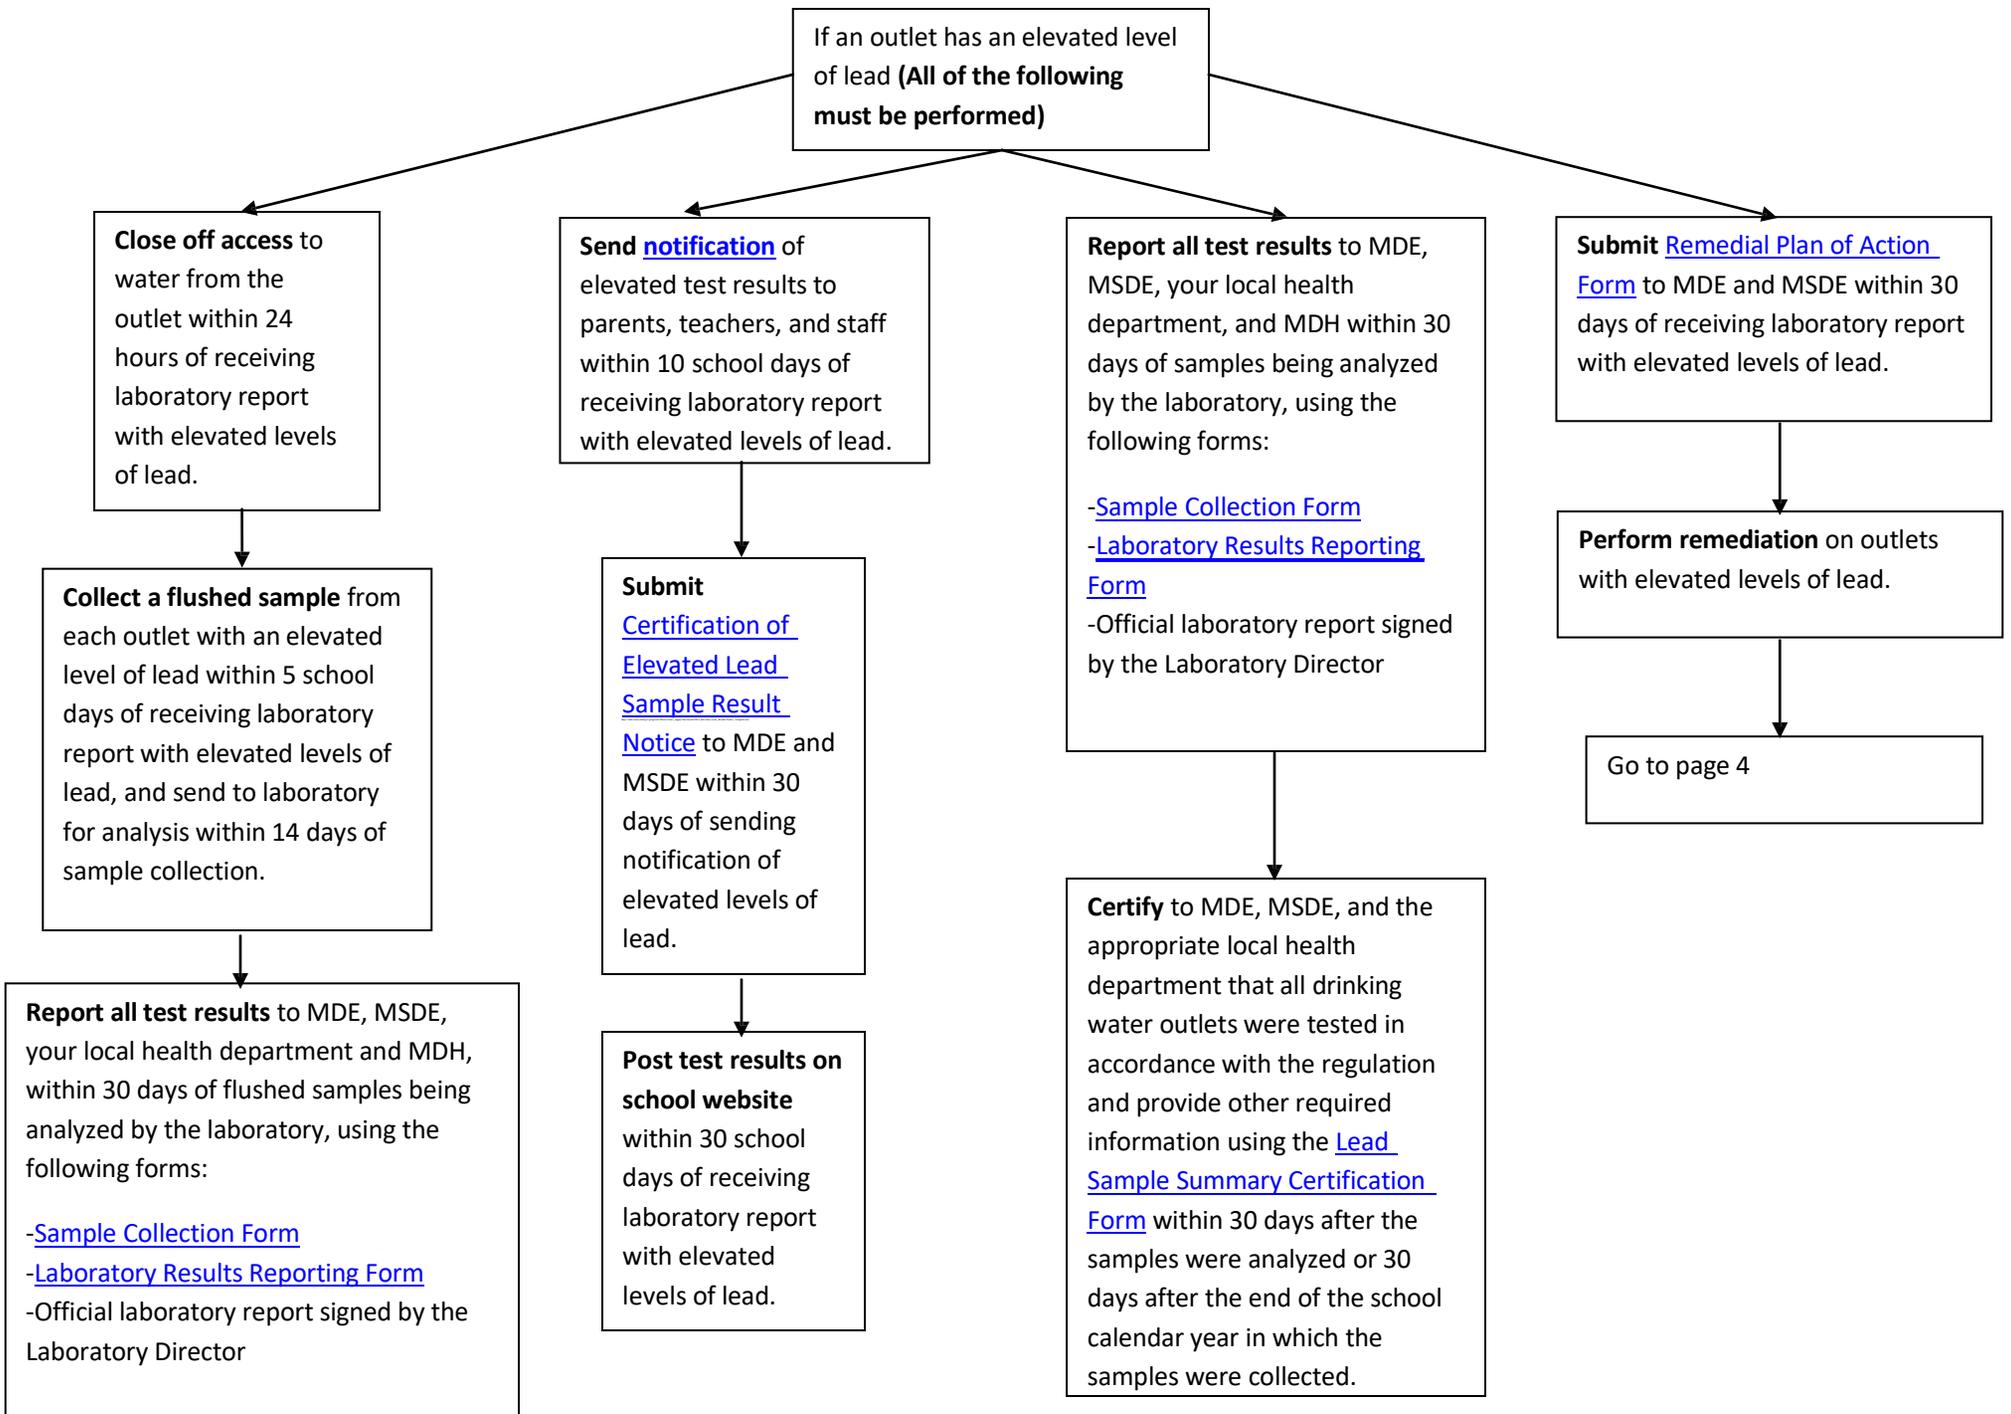

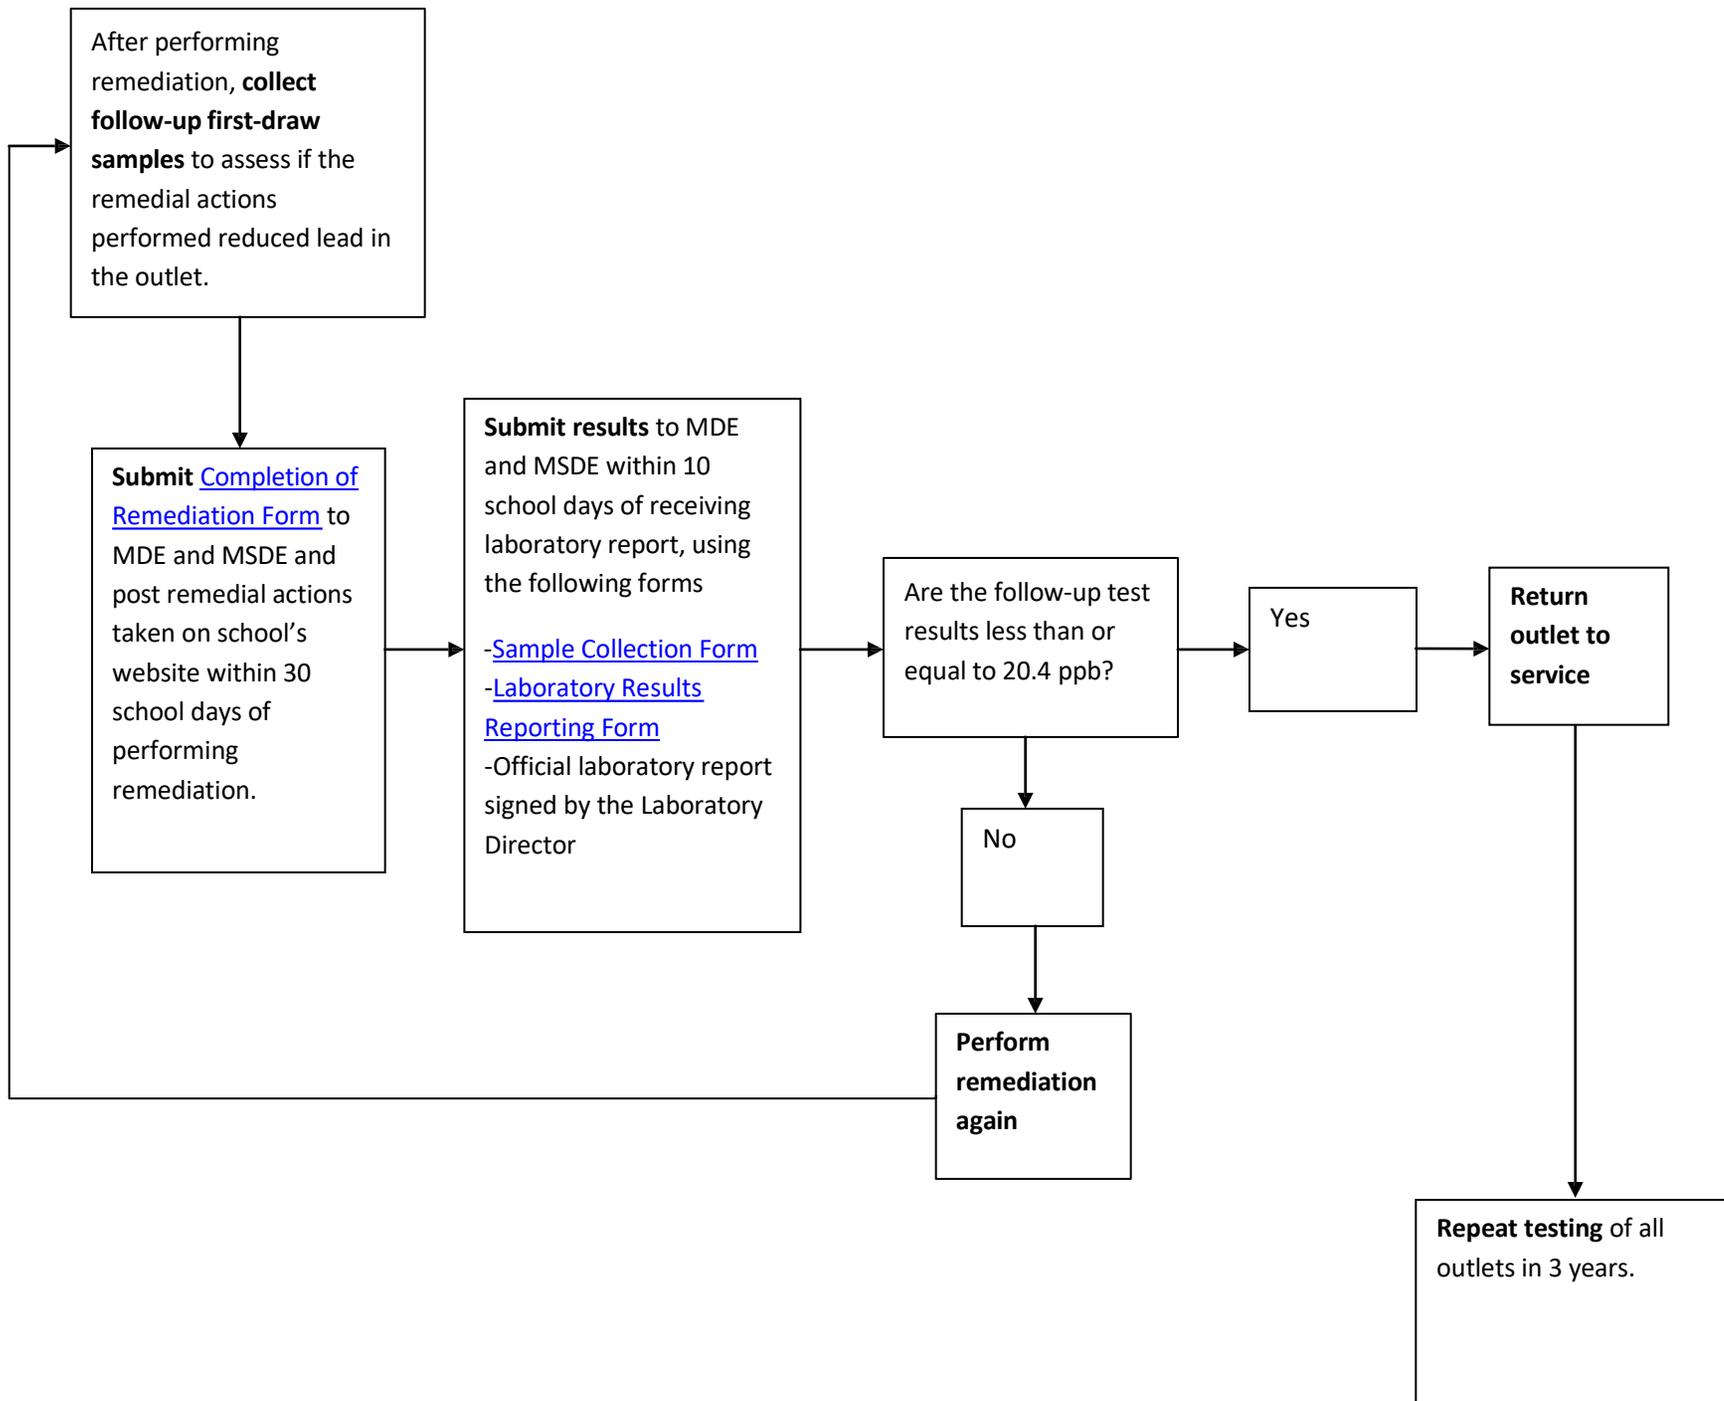

APPENDIX C

Tables 1-3. Schools Completing Lead Testing, Reporting Period
Ending July 1, 2018

Table 1. Schools Completing Lead Testing - Public Schools				
SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
ALLEGANY COUNTY				
NO DATA				
ANNE ARUNDEL COUNTY				
Belle Grove Elementary School	4502 Belle Grove Road	Baltimore	21225	Yes
Brooklyn Park Elementary School	200 14th Avenue	Baltimore	21225	Yes
Ferndale Early Education Center	105 Packard Avenue	Glen Burnie	21061	No
Freetown Elementary School	7904 Freetown Road	Glen Burnie	21060	No
George Cromwell Elementary School	221 Olen Drive	Glen Burnie	21061	Yes
Glendale Elementary School	105 Carroll Road	Glen Burnie	21060	Yes
Hilltop Elementary School	415 Melrose Avenue	Glen Burnie	21061	Yes
Linthicum Elementary School	101 School Lane	Linthicum	21090	Yes
Marley Elementary School	715 Cooper Road	Glen Burnie	21060	No
North Glen Elementary School	615 West Furnace Branch Road	Glen Burnie	21061	Yes
Overlook Elementary School	401 Hampton Road	Linthicum	21090	Yes
Park Elementary School	201 E. 11th Avenue	Baltimore	21225	Yes
Point Pleasant Elementary School	1035 Dumbarton Road	Glen Burnie	21060	Yes
Point Pleasant Resource Center	1450 Furnace Avenue	Glen Burnie	21060	Yes
Richard Henry Lee Elementary School	7600 Quarterfield Road	Glen Burnie	21061	Yes
Solley Elementary School	7608 Solley Road	Glen Burnie	21060	Yes
BALTIMORE COUNTY				
NO DATA				
BALTIMORE CITY				
Hampstead Hill Academy*	500 S. Linwood Avenue	Baltimore	21224	*
Highlandtown Elementary Middle School*	231 S. Eaton Street	Baltimore	21224	*
Lakeland Elementary Middle School*	2921 Stranden Road	Baltimore	21230	*
Leith Walk Elementary Middle School*	1235 Sherwood Avenue	Baltimore	21239	*

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Violetville Elementary Middle School*	1207 S. Pine Heights Avenue	Baltimore	21229	*
Waverly Elementary Middle School*	3400 Eilerslie Avenue	Baltimore	21228	*
Yorkwood Elementary Middle School*	5931 Yorkwood Road	Baltimore	21239	*
CALVERT COUNTY				
Barstow Elementary School	295 JW Williams Road	Prince Frederick	20678	No
Beach Elementary School	7900 Old Bayside Road	Chesapeake Beach	20732	Yes
Calvert High School	600 Dares Beach Road	Prince Frederick	20678	No
Career and Technology Academy	330 Dorsey Road	Prince Frederick	20678	No
CHESPAX	3200 King's Landing Road	Huntingtown	20639	No
Dowell Elementary School	12680 HG Trueman	Lusby	20657	No
St. Leonard Elementary School	5370 St Leonard Road	St Leonard	20685	No
Windy Hill Elementary School	9550 Boyds Turn Road	Owings	20736	No
CECIL COUNTY				
NO DATA				
CHARLES COUNTY				
NO DATA				
CAROLINE COUNTY				
NO DATA				
CARROLL COUNTY				
NO DATA				
DORCHESTER COUNTY				
NO DATA				
FREDERICK COUNTY				
NO DATA				
GARRETT COUNTY				
Accident Elementary School	534 Accident Bittinger Road	Accident	21520	Yes
Broad Ford Elementary School	607 Harvey Winters Road	Oakland	21550	Yes
Crellin Elementary School	115 Kendall Drive	Oakland	21550	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Dennett Road Educational Complex	770 Dennett Road	Oakland	21550	No
Friendsville Elementary School	841 First Avenue	Oakland	21550	Yes
Grantsville Elementary School	120 Grant Street, P.O. Box 9	Grantsville	21536	Yes
Hickory Environmental Education Center	604 Pride Parkway	Accident	21520	Yes
Northern Garrett High School	86 Pride Parkway	Accident	21520	Yes
Northern Middle School	371 Pride Parkway	Accident	21520	No
Southern Garrett High School	345 Oakland Drive	Oakland	21550	Yes
Southern Middle School	605 Harvey Winters Road	Oakland	21550	Yes
Yough Glades Elementary School	70 Wolf Acres Drive	Oakland	21550	No
HARFORD COUNTY				
Abingdon Elementary School	399 Singer Road	Abingdon	21009	Yes
Bel Air Elementary School	30 East Lee Street	Bel Air	21014	No
Darlington Elementary School	2119 Shuresville Road	Darlington	21034	No
Edgewood Elementary School	2100 Cedar Drive	Edgewood	21040	No
Forest Lakes Elementary School	100 Osborne Parkway	Forest Hill	21050	No
Fountain Green Elementary School	517 Fountain Green Road	Bel Air	21015	No
George Lisby Elementary School	810 Edmund Street	Aberdeen	21001	No
Joppatowne Elementary School	407 Trimble Road	Joppa	21085	No
Old Post Road Elementary School	2706 Old Philadelphia Road	Abingdon	21009	Yes
Ring Factory Elementary School	1400 Emmorton Road	Bel Air	21014	Yes
Riverside Elementary School	211 Stillmeadow Drive	Joppa	21085	Yes
William Paca Elementary School	2706 Old Philadelphia Road	Abingdon	21009	Yes
HOWARD COUNTY				
NO DATA				
KENT COUNTY				
NO DATA				
MONTGOMERY COUNTY				
Arcola Elementary School	1820 Franwall Avenue	Silver Spring	20902	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Argyle Middle School	2400 Bel Pre Road	Silver Spring	20906	No
Ashburton Elementary School	6314 Lone Oak Drive	Bethesda	20817	No
Baker, John T. Middle School	25400 Oak Drive	Damascus	20872	Yes
Banneker, Benjamin Middle School	14800 Perrywood Drive	Burtonsville	20866	No
Bannockburn Elementary School	6520 Dalroy Lane	Bethesda	20817	Yes
Barnsley Elementary School @ Northlake Center	15101 Bauer Drive	Rockville	20852	Yes
Beall Elementary School	451 Beall Avenue	Rockville	20850	Yes
Bel Pre Elementary School	13801 Rippling Brook Drive	Silver Spring	20906	No
Bells Mill Elementary School	8225 Bells Mill Road	Potomac	20854	No
Belmont Elementary School	19528 Olney Mill Road	Olney	20832	Yes
Bethesda Chevy Chase High School	4301 East-West Highway	Bethesda	20814	Yes
Bethesda Elementary School	7600 Arlington Road	Bethesda	20814	No
Beverly Farms Elementary School	8501 Postoak Road	Potomac	20854	No
Blair, Montgomery High School	51 University Boulevard East	Silver Spring	20901	No
Blake, James Hubert High School	300 Norwood Road	Silver Spring	20905	Yes
Bradley Hills Elementary School	8701 Hartsdale Avenue	Bethesda	20817	Yes
Briggs Chaney Middle School	1901 Rainbow Drive	Silver Spring	20905	No
Brooke Grove Elementary School	2700 Spartan Road	Olney	20832	No
Brookhaven Elementary School	4610 Renn Street	Rockville	20853	No
Brown Station Elementary School	851 Quince Orchard Boulevard	Gaithersburg	20878	No
Burning Tree Elementary School	7900 Beech Tree Road	Bethesda	20817	Yes
Burnt Mills Elementary School	11211 Childs Street	Silver Spring	20901	No
Burtonsville Elementary School	15516 Old Columbia Pike	Burtonsville	20866	Yes
Cabin John Middle School	10701 Gainsborough Road	Potomac	20854	No
Candlewood Elementary School	7210 Osprey Drive	Rockville	20855	No
Cannon Road Elementary School	901 Cannon Road	Silver Spring	20904	Yes
Carderock Springs Elementary School	7401 Persimmon Tree Lane	Bethesda	20817	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Carson, Rachel Elementary School	100 Tschiffely Square Road	Gaithersburg	20878	Yes
Cashell Elementary School	17101 Cashell Road	Rockville	20853	No
Cedar Grove Elementary School	24001 Ridge Road	Germantown	20876	No
Chevy Chase Elementary School	4015 Rosemary Street	Chevy Chase	20815	No
Churchill, Winston High School	11300 Gainsborough Road	Potomac	20854	No
Clarksburg Elementary School (Includes Annex)	13530 Redgrave Place	Clarksburg	20871	No
Clarksburg High School	22500 Wims Road	Clarksburg	20871	No
Clearspring Elementary School	9930 Moyer Road	Damascus	20872	Yes
Clemente, Roberto Middle School	18808 Waring Station Road	Germantown	20874	No
Clopper Mill Elementary School	18501 Cinnamon Drive	Germantown	20874	Yes
Cloverly Elementary School	800 Briggs Chaney Road	Silver Spring	20905	Yes
Cold Spring Elementary School	9201 Falls Chapel Way	Potomac	20854	Yes
College Gardens Elementary School	1700 Yale Place	Rockville	20850	No
Concord School	7210 Hidden Creek Road	Bethesda	20817	Yes
Cresthaven Elementary School	1234 Cresthaven Drive	Silver Spring	20903	No
Daly, Capt. James E. Elementary School	20301 Brandermill Drive	Germantown	20876	No
Damascus Elementary School	10201 Bethesda Church Road	Damascus	20872	Yes
Damascus High School	25921 Ridge Road	Damascus	20872	Yes
Darnestown Elementary School	15030 Turkey Foot Road	Gaithersburg	20878	Yes
Diamond Elementary School	4 Marquis Drive	Gaithersburg	20878	Yes
Drew, Dr. Charles R. Elementary School	1200 Swingingdale Drive	Silver Spring	20905	No
DuFief Elementary School	15001 DuFief Drive	Gaithersburg	20878	Yes
East Silver Spring Elementary School	631 Silver Spring Avenue	Silver Spring	20910	Yes
Eastern Middle School	300 University Boulevard East	Silver Spring	20901	Yes
Edison, Thomas High School Of Technology	12501 Dalewood Drive	Silver Spring	20906	No
Einstein, Albert High School	11135 Newport Mill Road	Kensington	20895	Yes
Ewing, Blair G. Center	14501 Avery Road	Rockville	20853	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Fairland Center	13313 Old Columbia Pike	Silver Spring	20904	Yes
Fairland Elementary School	14315 Fairdale Road	Silver Spring	20905	Yes
Fallsmead Elementary School	1800 Greenplace Terrace	Rockville	20850	Yes
Farmland Elementary School	7000 Old Gate Road	Rockville	20850	Yes
Farquhar, William H. Middle School	17017 Batchellors Forest Road	Olney	20832	No
Fields Road Elementary School	One School Drive	Gaithersburg	20878	Yes
Flower Hill Elementary School	18425 Flower Hill Way	Gaithersburg	20879	Yes
Flower Valley Elementary School	4615 Sunflower Drive	Rockville	20853	No
Forest Knolls Elementary School	10830 Eastwood Avenue	Silver Spring	20901	No
Forest Oak Middle School	651 Saybrooke Oaks Boulevard	Gaithersburg	20877	No
Fox Chapel Elementary School	19315 Archdale Road	Germantown	20876	Yes
Frost, Robert Middle School	9201 Scott Drive	Rockville	20850	Yes
Gaithersburg Elementary School	35 North Summit Avenue	Gaithersburg	20877	Yes
Gaithersburg High School	101 Education Boulevard	Gaithersburg	20877	No
Gaithersburg Middle School	2 Teachers' Way	Gaithersburg	20877	No
Galway Elementary School	12612 Galway Drive	Silver Spring	20904	No
Garrett Park Elementary School (Includes Annex Building)	4810 Oxford Street	Kensington	20895	No
Georgian Forest Elementary School	3100 Regina Drive	Silver Spring	20906	No
Germantown Elementary School	19110 Liberty Mill Road	Germantown	20874	Yes
Gibbs, Jr., William B. Elementary School	12615 Royal Crown Drive	Germantown	20876	No
Glen Haven Elementary School	10900 Inwood Avenue	Silver Spring	20902	No
Glenallan Elementary School	12520 Heurich Road	Silver Spring	20902	No
Goshen Elementary School	8701 Warfield Road	Gaithersburg	20882	No
Great Seneca Creek Elementary School	13010 Dairymaid Drive	Germantown	20874	No
Greencastle Elementary School	13611 Robey Road	Silver Spring	20904	Yes
Greenwood Elementary School	3336 Gold Mine Road	Brookeville	20833	Yes
Harmony Hills Elementary School	13407 Lydia Street	Silver Spring	20906	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Highland Elementary School	3100 Medway Street	Silver Spring	20902	Yes
Highland View Elementary School	9010 Providence Avenue	Silver Spring	20901	No
Hoover, Herbert Middle School	8810 Postoak Road	Potomac	20854	No
Jackson Road Elementary School	900 Jackson Road	Silver Spring	20904	Yes
Johnson, Walter High School	6400 Rock Spring Drive	Bethesda	20814	No
Jones Lane Elementary School	15110 Jones Lane	Gaithersburg	20878	No
Kemp Mill Elementary School	411 Sisson Street	Silver Spring	20902	No
Kennedy, John F. High School	1901 Randolph Road	Silver Spring	20902	No
Kensington-Parkwood Elementary School	4710 Saul Road	Kensington	20895	Yes
Key, Francis Scott Middle School	910 Schindler Drive	Silver Spring	20903	No
King, Martin Luther Middle School	13737 Wisteria Drive	Germantown	20874	Yes
Kingsview Middle School	18909 Kingsview Road	Germantown	20874	No
Lake Seneca Elementary School	13600 Wanegarden Drive	Germantown	20874	Yes
Lakelands Park Middle School	1200 Main Street	Gaithersburg	20878	No
Lakewood Elementary School	2534 Lindley Terrace	Rockville	20850	Yes
Laytonsville Elementary School	21401 Laytonsville Road	Gaithersburg	20882	No
Leleck, JoAnn Elementary School at Broad Acres	710 Beacon Road	Silver Spring	20903	Yes
Little Bennett Elementary School	23930 Burdette Forest Road	Clarksburg	20871	Yes
Loiederman, A. Mario Middle School	12701 Goodhill Road	Silver Spring	20906	No
Luxmanor Elementary School	6201 Tilden Lane	Rockville	20852	Yes
Lynnbrook Center	8001 Lynbrook Drive	Bethesda	20814	No
Magruder High School	5939 Muncaster Mill Road	Rockville	20855	Yes
Marshall, Thurgood Elementary School	12260 McDonald Chapel Drive	Gaithersburg	20878	No
Maryvale Elementary School	1000 First Street	Rockville	20850	Yes
Matsunaga, Spark M. Elementary School (Includes Longview)	13902 Bromfield Road	Germantown	20874	No
McAuliffe, S. Christa Elementary School	12500 Wisteria Drive	Germantown	20874	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
McNair, Ronald Elementary School	13881 Hopkins Road	Germantown	20874	No
Meadow Hall Elementary School	951 Twinbrook Parkway	Rockville	20851	Yes
Mill Creek Towne Elementary School	17700 Park Mill Drive	Rockville	20855	Yes
Montgomery Knolls Elementary School	807 Daleview Drive	Silver Spring	20901	No
Montgomery Village Middle School	19300 Watkins Mill Road	Montgomery Village	20886	Yes
Montgomery, Richard High School	250 Richard Montgomery Drive	Rockville	20852	No
Montrose Center	12301 Academy Way	Rockville	20852	No
Neelsville Middle School	11700 Neelsville Church Road	Germantown	20876	No
New Hampshire Estates Elementary School	8720 Carroll Avenue	Silver Spring	20903	Yes
Newport Mill Middle School	11311 Newport Mill Road	Kensington	20895	Yes
Nix, Roscoe R. Elementary School	1100 Corliss Street	Silver Spring	20903	No
North Bethesda Middle School	8935 Bradmoor Drive	Bethesda	20817	No
North Chevy Chase Elementary School	3700 Jones Bridge Road	Chevy Chase	20815	Yes
Northwest High School	13501 Richter Farm Road	Germantown	20874	No
Northwood High School	919 University Boulevard West	Silver Spring	20901	Yes
Oak View Elementary School	400 East Wayne Avenue	Silver Spring	20901	Yes
Oakland Terrace Elementary School	2720 Plyers Mill Road	Silver Spring	20902	No
Olney Elementary School	3401 Queen Mary Drive	Olney	20832	No
Page, William Tyler Elementary School	13400 Tamarack Road	Silver Spring	20904	No
Paint Branch High School	14121 Old Columbia Pike	Burtonsville	20866	No
Parkland Middle School	4610 West Frankfort Drive	Rockville	20853	Yes
Parks, Rosa Middle School	19200 Olney Mill Road	Olney	20832	No
Pine Crest Elementary School	201 Woodmoor Drive	Silver Spring	20901	Yes
Piney Branch Elementary School	7510 Maple Avenue	Takoma Park	20912	No
Poole, John Middle School	17014 Tom Fox Avenue	Poolesville	20837	No
Poolesville Elementary School	19565 Fisher Avenue	Poolesville	20837	Yes
Poolesville High School	17501 West Willard Road	Poolesville	20837	Yes

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Potomac Elementary School	10311 River Road	Potomac	20854	Yes
Pyle, Thomas W. Middle School	6311 Wilson Lane	Bethesda	20817	No
Quince Orchard High School	15800 Quince Orchard Road	Gaithersburg	20878	Yes
Redland Middle School	6505 Muncaster Mill Road	Rockville	20855	No
Resnik, Judith A. Elementary School	7301 Hadley Farms Drive	Gaithersburg	20879	No
Ride, Sally K. Elementary School	21301 Seneca Crossing Drive	Germantown	20876	No
Ridgeview Middle School	16600 Raven Rock Drive	Gaithersburg	20878	Yes
Ritchie Park Elementary School	1514 Dunster Road	Rockville	20854	No
Rock Creek Forest Elementary School	8330 Grubb Road	Chevy Chase	20815	No
Rock Creek Valley Elementary School	5121 Russett Road	Rockville	20853	No
Rock Terrace High School	390 Martins Lane	Rockville	20850	No
Rock View Elementary School	3901 Denfeld Avenue	Kensington	20895	Yes
Rockville High School	2100 Baltimore Road	Rockville	20851	No
Rockwell, Lois P. Elementary School	24555 Cutsail Drive	Damascus	20872	No
Rocky Hill Middle School	22401 Brick Haven Way	Clarksburg	20871	No
Rolling Terrace Elementary School	705 Bayfield Street	Takoma Park	20912	Yes
Rosemary Hills Elementary School	2111 Porter Road	Silver Spring	20910	No
Rosemont Elementary School	16400 Alden Avenue	Gaithersburg	20877	No
Sandburg, Carl Center	451 Meadow Hall Drive	Rockville	20851	No
Seneca Valley High School	19401 Crystal Rock Drive	Germantown	20874	No
Sequoyah Elementary School	17301 Bowie Mill Road	Derwood	20855	No
Seven Locks Elementary School	9500 Seven Locks Road	Bethesda	20817	Yes
Shady Grove Middle School	8100 Midcounty Highway	Gaithersburg	20877	Yes
Sherwood Elementary School	1401 Olney-Sandy Spring Road	Sandy Spring	20860	Yes
Sherwood High School	300 Olney-Sandy Spring Road	Sandy Spring	20860	No
Shriver, Sargent Elementary School	12518 Greenly Drive	Silver Spring	20906	No
Silver Creek Middle School	3701 Saul Road	Kensington	20895	No
Silver Spring International Middle	313 Wayne Avenue	Silver Spring	20910	Yes

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Singer, Flora M. Elementary School	2600 Hayden Drive	Silver Spring	20902	No
Sligo Middle School	1401 Dennis Avenue	Silver Spring	20902	Yes
Smith, Lathrope Center	5110 Meadowside Lane	Rockville	20855	Yes
Somerset Elementary School	5811 Warwick Place	Chevy Chase	20815	No
South Lake Elementary School	18201 Contour Road	Gaithersburg	20877	Yes
Spring Mill Center	11721 Kemp Mill Road	Silver Spring	20902	Yes
Springbrook High School	201 Valleybrook Drive	Silver Spring	20904	No
Stedwick Elementary School	10631 Stedwick Road	Gaithersburg	20886	No
Stephen Knolls Center	10731 St Margaret's Way	Kensington	20895	Yes
Stone Mill Elementary School	14323 Stonebridge View Drive	North Potomac	20878	Yes
Stonegate Elementary School	14811 Notley Road	Silver Spring	20905	Yes
Strathmore Elementary School	3200 Beaverwood Lane	Silver Spring	20906	Yes
Strawberry Knoll Elementary School	18820 Strawberry Knoll Road	Gaithersburg	20879	No
Summit Hall Elementary School	101 West Deer Park Road	Gaithersburg	20877	Yes
Takoma Park Elementary School	7511 Holly Avenue	Takoma Park	20912	Yes
Takoma Park Middle School	7611 Piney Branch Road	Silver Spring	20910	No
Tilden Center	6300 Tilden Lane	Rockville	20852	Yes
Tilden Middle School	11211 Old Georgetown Road	Rockville	20852	Yes
Travilah Elementary School	13801 DuFief Mill Road	North Potomac	20878	Yes
Twinbrook Elementary School	5911 Ridgway Avenue	Rockville	20851	Yes
Viers Mill Elementary School	11711 Joseph Mill Road	Silver Spring	20901	Yes
Washington Grove Elementary School	8712 Oakmont Street	Gaithersburg	20877	No
Waters Landing Elementary School	13100 Waters Landing Drive	Germantown	20874	No
Watkins Mill Elementary School	19001 Watkins Mill Road	Montgomery Village	20886	Yes
Watkins Mill High School	10301 Apple Ridge Road	Gaithersburg	20879	No
Wayside Elementary School	10011 Glen Road	Potomac	20854	No
Weller Road Elementary School	3301 Weller Road	Silver Spring	20906	No
Wells, Hallie Middle School	11701 Little Seneca Parkway	Clarksburg	20871	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
West (Julius) Middle	651 Great Falls Road	Rockville	20850	No
Westbrook Elementary School	5110 Allan Terrace	Bethesda	20816	No
Westland Middle School	5511 Massachusetts Avenue	Bethesda	20816	No
Westover Elementary School	401 Hawkesbury Lane	Silver Spring	20904	No
Wheaton High School	12401 Dalewood Drive	Silver Spring	20906	No
Wheaton Woods Elementary School	4510 Faroe Place	Rockville	20853	No
Whetstone Elementary School	19201 Thomas Farm Road	Gaithersburg	20879	No
White Oak Middle School	12201 New Hampshire Avenue	Silver Spring	20904	No
Whitman, Walt High School	7100 Whittier Boulevard	Bethesda	20817	No
Wims, Wilson Elementary School	12520 Blue Sky Drive	Clarksburg	20871	No
Wood Acres Elementary School	5800 Cromwell Drive	Bethesda	20816	No
Wood, Earle B. Middle School	14615 Bauer Drive	Rockville	20853	No
Woodfield Elementary School	24200 Woodfield Road	Gaithersburg	20882	Yes
Woodlin Elementary School	2101 Luzerne Avenue	Silver Spring	20910	Yes
Wootton High School	2100 Wootton Parkway	Rockville	20850	Yes
Wyngate Elementary School	9300 Wadsworth Drive	Bethesda	20817	No
PRINCE GEORGE'S COUNTY				
NO DATA				
QUEEN ANNE'S COUNTY				
Centreville Elementary School	213 Homewood Avenue	Centreville	21617	No
Kennard Elementary School	420 Little Kidwell Avenue	Centreville	21617	No
Kent Island Elementary School	110 Elementary Way	Stevensville	21666	No
ST. MARY'S COUNTY				
Captain Walter Francis Duke Elementary School	23595 Hayden Farm Lane	Leonardtwn	20650	Yes
Esperanza Middle School	22790 Maple Road	Lexington Park	20653	Yes
Evergreen Elementary School	43765 Evergreen Way	California	20619	Yes
Fairfield Academy	20833 Great Mills Road	Great Mills	20634	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
George Washington Carver Elementary School	46155 Carver School Boulevard	Lexington Park	20653	Yes
Great Mills High School	21130 Great Mills Road	Great Mills	20634	Yes
Green Holly Elementary School	46060 Millstone Landing Road	Lexington Park	20653	Yes
Greenview Knolls Elementary School	45711 Military Lane	Great Mills	20634	Yes
Leonardtown Elementary School	22885 Duke Street	Leonardtown	20650	Yes
Lexington Park Elementary School	46763 South Shangri La Drive	Lexington Park	20653	Yes
Park Hall Elementary School	20343 Hermanville Road	Park Hall	20667	Yes
Town Creek Elementary School	45805 Dent Drive	Lexington Park	20653	No
SOMERSET COUNTY				
NO DATA				

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
TALBOT COUNTY				
NO DATA				
WASHINGTON COUNTY				
Bester Elementary School	385 Mill Street	Hagerstown	21740	No
Boonsboro Elementary School	5 Campus Avenue	Boonsboro	21713	Yes
Boonsboro High School	10 Campus Avenue	Boonsboro	21713	Yes
Boonsboro Middle School	1 J-H Wade Drive	Boonsboro	21713	Yes
Cascade Elementary School	14519 Pennersville Road	Cascade	21719	Yes
Claude Kitchens Outdoor School at Fairview	12808 Draper Road	Clear Spring	21740	No
Clear Spring Elementary School	12627 Broadfording Road	Clear Spring	21722	Yes
Clear Spring High School	12630 Broadfording Road	Clear Spring	21722	Yes
Clear Spring Middle School	12628 Broadfording Road	Clear Spring	21722	Yes
E. Russell Hick Middle School	1321 S. Potomac Street	Hagerstown	21740	Yes
Eastern Elementary School	1320 Yale Drive	Hagerstown	21742	No
Emma K Doub Elementary School	1221 S. Potomac Street	Hagerstown	21740	Yes
Fountaindale Elementary School	901 Northern Avenue	Hagerstown	21742	No
Funkstown Elementary School	23 Funkstown Road	Funkstown	21740	Yes
Hancock Elementary School	290 W. Main Street	Hancock	21750	Yes
Hancock Middle/High School	289 W. Main Street	Hancock	21750	Yes
Hickory Elementary School	11101 Hickory School Road	Williamsport	21795	Yes
Jonathan Hager Elementary School	12615 Sedgwick Way	Hagerstown	21740	No
Lincolnshire Elementary School	17545 Lincolnshire Avenue	Hagerstown	21740	No
Marshall Street Center	1350 Marshall Street	Hagerstown	21740	Yes
Maugansville Elementary School	18023 Maugans Avenue	Maugansville	21767	No
North Hagerstown High School	1200 Pennsylvania Avenue	Hagerstown	21742	No
Northern Middle School	701 Northern Avenue	Hagerstown	21742	Yes
Pangborn Elementary School	195 Pangborn Avenue	Hagerstown	21740	No

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Paramount Elementary School	19410 Longmeadow Road	Hagerstown	21742	Yes
Pleasant Valley Elementary School	1707 Rohresville Road	Knoxville	21758	No
Potomac Heights Elementary School	301 E. Magnolia Avenue	Hagerstown	21742	Yes
Rockland Woods Elementary School	18201 Rockland Drive	Hagerstown	21740	Yes
Ruth Ann Monroe Primary School	1311 Yale Drive	Hagerstown	21742	No
Salem Avenue Elementary School	1323 Salem Avenue	Hagerstown	21740	No
Sharpsburg Elementary School	17525 Shepherdstown Pike	Sharpsburg	21782	Yes
Smithsburg Elementary School	67 N. Main Street	Smithsburg	21783	No
Smithsburg High School	66 N Main Street	Smithsburg	21783	Yes
Smithsburg Middle School	68 N. Main Street	Smithsburg	21783	Yes
Springfield Middle School	334 Sunset Avenue	Williamsport	21795	Yes
Washington County Technical High School	50 W. Oak Ridge Drive	Hagerstown	21740	No
Western Heights Middle School	1300 Marshall Street	Hagerstown	21740	Yes
Williamsport Elementary School	1 S. Clifton Drive	Williamsport	21795	No
Williamsport High School	5 S. Clifton Drive	Williamsport	21795	Yes
WICOMICO COUNTY				
Charles H. Chipman Elementary School	711 Lake Street	Salisbury	21801	No
Delmar Elementary School	811 South 2nd Street	Delmar	21875	Yes
East Salisbury School	1201 Old Ocean City Road	Salisbury	21804	Yes
Fruitland Intermediate School	208 West Main Street	Fruitland	21820	Yes
Fruitland Primary School	301 North Division Street	Fruitland	21826	Yes
Glen Avenue Elementary School	1615 Glen Avenue Extension	Salisbury	21804	No
North Salisbury Elementary School	1213 Emerson Avenue	Salisbury	21801	No
Pemberton Elementary School	1300 Pemberton Drive	Salisbury	21801	No
Pinehurst Elementary School	520 South Pinehurst Avenue	Salisbury	21801	Yes
Pittsville Elementary School	34404 Old Ocean City Road	Pittsville	21850	Yes
Prince Street Elementary School	400 Prince Street	Salisbury	21804	No
Westside Intermediate School	8000 Quantico Road	Hebron	21830	Yes

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Wicomico Early Learning Center	1101 Robert Street	Salisbury	21804	No
WORCESTER COUNTY				
NO DATA				

Appendix C: Table 1. Schools Completing Lead Testing - Public Schools - Period Ending July 1, 2018
 *Insufficient documentation provided

Table 2. Schools Completing Lead Testing - Charter Schools				
SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
ANNE ARUNDEL*				
NO DATA				
BALTIMORE CITY*				
NO DATA				
FREDERICK*				
Monocacy Valley Montessori Public Charter School	217 Dill Avenue	Frederick	21701	No
Carroll Creek Montessori Public Charter	7215 Corporate Court	Frederick	21703	No
PRINCE GEORGE'S*				
NO DATA				
ST. MARY'S*				
Chesapeake Public Charter School	20945 Great Mills Road	Lexington Park	20653	No

Appendix C: Table 2. Schools Completing Lead Testing - Charter Schools - Period Ending July 1, 2018

*Only these counties have charter schools

Table 3. Schools Completing Lead Testing - Nonpublic Schools

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
ALLEGANY COUNTY				
NO DATA				
ANNE ARUNDEL COUNTY				
Annapolis Area Christian School	710 Ridgely Avenue	Annapolis	21401	No
Friendship Adventist	901 Andover Road	Linthicum Heights	21090	No
Granite Baptist School	7823 Oakwood Road	Glen Burnie	21061	Yes
Monsignor Slade School	120 Dorsey Road	Glen Burnie	21061	No
St. Martin's In the Field Episcopal School	375 Benfield Road	Severna Park	21146	No
BALTIMORE COUNTY				
Arrow Center for Education Cromwell Bridge	1605 Cromwell Bridge Road	Baltimore	21234	No
Arrow Center for Education Tangram	8824-8832 Orchard Tree Lane, Suite 8830	Towson	21286	No
Baltimore School of Independent Learners	1777 Reisterstown Road, Suite 60	Pikesville	21208	No
Baltimore White Marsh Adventist	7427 Rossville Boulevard	Baltimore	21237	Yes
Calvary Baptist School	7321 Manchester Road	Dundalk	21222	No
Delrey School	3610 Commerce Drive, Suite 804	Baltimore	21227	Yes
Havenwood Preschool Center	100 E. Ridgely Road	Timonium	21093	No
Immaculate Conception School	112 Ware Avenue	Towson	21204	Yes
Lamb of God School	1810 Fairview Avenue	Halethorpe	21227	No
Mt. Pleasant Christian School	6000 Radecke Avenue	Baltimore	21206	No
New Directions Academy	9700 Old Harford Road	Baltimore	21234	No
Our Lady of Victory School*	4416 Wilkens Ave	Baltimore	21229	*
Perry Hall Christian School	3919 Schroeder Avenue	Perry Hall	21128	No
Pilgrim Christian Day School	7200 Liberty Road	Baltimore	21207	No
St. Paul Lutheran	2001 Old Frederick Road	Catonsville	21228	Yes

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
St. Paul's School for Girls	11232 Falls Road	Brooklandville	21022	No
St. Ursula School	8900 Harford Road	Baltimore	21234	Yes
Talmudical Academy	4445 Old Court Road	Baltimore	21208	Yes
Trellis School	15440A York Road	Sparks	21152	No
Yeshivas Toras Simcha	7501 Park Heights Avenue	Baltimore	21208	No
BALTIMORE CITY				
Baltimore Academy	3800 Frederick Avenue	Baltimore	21229	No
Calvert School Lower	105 Tuscany Road	Baltimore	21210	No
Calvert School Middle	4300 North Charles Street	Baltimore	21218	No
Gilman School	5407 Roland Avenue	Baltimore	21210	Yes
Mount Clare Christian School	320 South Vincent Street	Baltimore	21223	No
Ner Tamid Montessori School	6214 Pimlico Road	Baltimore	21209	Yes
Roland Park Country School*	5204 Roland Avenue	Baltimore	21210	*
St. Ignatius Loyola Academy	300 East Gittings Street	Baltimore	21230	No
The New Century School	724 South Ann Street	Baltimore	21231	No
Wilkes School	707 Park Avenue	Baltimore	21201	No
CECIL COUNTY				
Shorehaven School	1040 Singerly Road	Elkton	21921	No
CHARLES COUNTY				
NO DATA				
CAROLINE COUNTY				
NO DATA				
CARROLL COUNTY				
NO DATA				
DORCHESTER COUNTY				

Appendix C: Table 3. Schools Completing Lead Testing - Nonpublic Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
NO DATA				
FREDERICK COUNTY				
Frederick Adventist	6437 Jefferson Pike	Frederick	21703	No
Laurel Hall School	4540 Mack Avenue	Frederick	21703	No
Mother Seton	100 Creamery Road	Emmitsburg	21727	Yes
The Banner School	1730 N. Market Street	Frederick	21701	No
GARRETT COUNTY				
NO DATA				
HARFORD COUNTY				
Arrow Center for Education Riverside	1370 Brass Mill Road	Belcamp	21017	No
New Covenant Christian School - Grammar School*	128 St. Mary's Church Road	Abingdon	21009	*
New Covenant Christian School - Upper School*	1515 Emmorton Road	Bel Air	21014	*
HOWARD COUNTY				
Atholton Adventist Academy	6520 Martin Road	Columbia	21044	Yes
Resurrection St. Paul School*	3155 Paulskirk Drive	Ellicott City	21042	*
Tarbiyah Academy	6785 Business Parkway, Suite 106-110	Elkridge	21075	No
KENT COUNTY				
Chester River Adventist	305 N. Kent Street	Chestertown	21620	No
MONTGOMERY COUNTY				
Barrie School	13500 Layhill Road	Silver Spring	20906	Yes
Bullis School	10601 Falls Road	Potomac	20854	Yes
Christ Episcopal School	109 S. Washington Street	Rockville	20850	No
Church of the Redeemer Christian School	19425 Woodfield Road	Gaithersburg	20879	No
Fernwood Montessori School	10100 Old Georgetown Road	Bethesda	20814	No
French International School	9600 Forest Road	Bethesda	20814	Yes

Appendix C: Table 3. Schools Completing Lead Testing - Nonpublic Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Grace Episcopal Day School	9411 Connecticut Avenue	Kensington	20895	No
Green Acres School	11701 Danville Drive	Rockville	20852	Yes
Holy Redeemer School	9715 Summit Avenue	Kensington	20895	No
House of Hope Maryland Day School	17826 New Hampshire Avenue	Ashton	20861	No
Little Flower School	5601 Massachusetts Avenue	Bethesda	20816	Yes
Living Grace Christian School	20300 Pleasant Ridge Drive	Montgomery Village	20886	No
Mary of Nazareth Catholic School	14131 Seneca Road	Darnestown	20874	No
Our Lady of Lourdes School	7500 Pearl Street	Bethesda	20814	Yes
Paint Branch Montessori School	10309 New Hampshire Avenue	Silver Spring	20903	No
Sidwell Friends Lower School	5100 Edgemoor Lane	Bethesda	20814	Yes
St. John the Baptist Catholic School	12319 New Hampshire Avenue	Silver Spring	20904	No
St. John the Evangelist	10201 Woodland Drive	Silver Spring	20902	No
St. Mary's School	600 Viers Mill Road	Rockville	20852	No
St. Raphael School	1513 Dunster Road	Rockville	20854	No
Stone Ridge School of the Sacred Heart	9101 Rockville Pike	Bethesda	20814	Yes
The Family Academy of Bethesda	4324 Montgomery Avenue	Bethesda	20814	No
The Foundation School	220 Girard Street, Suite 300	Gaithersburg	20877	No
The Primary Day School	7300 River Road	Bethesda	20817	Yes
Village Montessori School	20301 Fulks Farm Road	Montgomery Village	20886	No
Yeshiva of Greater Washington	1216 Arcola Avenue	Silver Spring	20902	Yes
PRINCE GEORGE'S COUNTY				
Chelsea School	2970 Belcrest Center Drive	Hyattsville	20782	No
Cornerstone Christian Academy	16010 Annapolis Road	Bowie	20715	No
Dematha Catholic High School	4313 Madison Street	Hyattsville	20781	Yes
Goddard Child Development Center	8800 Greenbelt Road	Greenbelt	20771	No

Appendix C: Table 3. Schools Completing Lead Testing - Nonpublic Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
Grace Christian School	7210 Racetrack Road	Bowie	20715	No
Holy Trinity Episcopal Day School	13106 Annapolis Road	Bowie	20720	No
Holy Trinity Episcopal Day School	11902 Daisy Lane	Glenn Dale	20769	No
Lanham Christian School	8400 Good Luck Road	Lanham	20706	No
New Hope Academy	7009 Varnum Street	Landover Hills	20784	Yes
St. Mary's Catholic School	7207 Annapolis Road	Landover Hills	20784	Yes
St. Matthew's Early Education Center	14900 Annapolis Road	Bowie	20715	No
The Foundation School	1330 McCormick Drive	Largo	20774	Yes
QUEEN ANNE'S COUNTY				
NO DATA				
ST. MARY'S COUNTY				
Saint Johns School	43900 Saint Johns Road	Hollywood	20636	No
St. Mary's Ryken High School	22600 Camp Calvert Road	Leonardtwn	20650	No
SOMERSET COUNTY				
NO DATA				
TALBOT COUNTY				
Saints Peter and Paul Elementary School	900 High Street	Easton	21601	Yes
Saints Peter and Paul High School	900 High Street	Easton	21601	No
The Country School	716 Goldsborough Street	Easton	21601	No
WASHINGTON COUNTY				
Broadfording Christian Academy	13535 Broadfording Church Road	Hagerstown	21740	No
Grace Academy	13321 Cearfoss Pike	Hagerstown	21740	No
Mount Aetna Adventist Academy	10207 Crystal Falls Drive	Hagerstown	21470	Yes
WICOMICO COUNTY				
Asbury Child Development Center	1401 Camden Avenue	Salisbury	21801	Yes

Appendix C: Table 3. Schools Completing Lead Testing - Nonpublic Schools - Period Ending July 1, 2018

*Insufficient documentation provided

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	ANY ELEVATED LEAD RESULTS?
WORCESTER COUNTY				
Worcester Preparatory School	508 South Main Street	Berlin	21811	Yes

Appendix C: Table 3. Schools Completing Lead Testing - Nonpublic Schools - Period Ending July 1, 2018

*Insufficient documentation provided

APPENDIX D

Tables 4-6. Summary of Lead Samples Collected, Reporting
Period Ending July 1, 2018

Table 4. Lead Samples* Collected - Public Schools

COUNTY	# SCHOOLS** COMPLETING TESTING	TOTAL # SAMPLES	# SAMPLES FROM DRINKING OUTLETS	# SAMPLES FROM NON- CONSUMP- TION OUTLETS	# SAMPLES WITH UNKNOWN USE	TOTAL # ELEVATED SAMPLES	# ELEVATED SAMPLES FROM DRINKING OUTLETS	# ELEVATED SAMPLES FROM NON- CONSUMP- TION OUTLETS	# ELEVATED SAMPLES WITH UNKNOWN USE
ALLEGANY	0								
ANNE ARUNDEL	16	1761	302	697	762	92	10	22	60
BALTIMORE COUNTY	0								
BALTIMORE CITY	0								
CALVERT	8	480	480	0	0	1	1	0	0
CAROLINE	0								
CARROLL	0								
CECIL	0								
CHARLES	0								
DORCHESTER	0								
FREDERICK	0								
GARRETT	12	408	408	0	0	24	24	0	0
HARFORD	12	658	554	104	0	13	5	8	0
HOWARD	0								
KENT	0								
MONTGOMERY	207	13248	13248	0	0	228	228	0	0
PRINCE GEORGE'S	0								
QUEEN ANNE'S	3	61	22	39	0	0	0	0	0
ST. MARY'S	12	1623	1451	119	53	144	67	72	5
SOMERSET	0								
TALBOT	0								
WASHINGTON	39	3041	829	2211	1	120	6	114	0
WICOMICO	13	498	464	34	0	25	21	4	0
WORCESTER	0								
TOTAL	322	21778	17758	3204	816	647	362	220	65

Appendix D: Table 4. Lead Samples Collected - Public Schools - Period Ending July 1, 2018

*All samples are first-draw

**Number zero (0) indicates data is absent or incomplete

Table 5. Lead Samples* Collected - Charter Schools									
COUNTY***	# SCHOOLS** COMPLETING LEAD TESTING	TOTAL # SAMPLES	# SAMPLES FROM DRINKING OUTLETS	# SAMPLES FROM NON- CONSUMP- TION OUTLETS	# SAMPLES WITH UNKNOWN USE	TOTAL # ELEVATED SAMPLES	# ELEVATED SAMPLES FROM DRINKING OUTLETS	# ELEVATED SAMPLES FROM NON- CONSUMP- TION OUTLETS	# ELEVATED SAMPLES WITH UNKNOWN USE
ANNE ARUNDEL	0								
BALTIMORE CITY	0								
FREDERICK	2	44	19	25	0	0	0	0	0
PRINCE GEORGE'S	0								
ST. MARY'S	1	57	57	0	0	0	0	0	0
TOTAL	3	101	76	25	0	0	0	0	0

Appendix D: Table 5. Lead Samples Collected - Period Ending July 1, 2018 - Charter Schools

*All samples are first-draw

**Number zero (0) indicates data is absent or incomplete

***Only these counties have charter schools

Table 6. Lead Samples* Collected - Nonpublic Schools

COUNTY	# SCHOOLS*** COMPLETING TESTING	TOTAL # SAMPLES	# SAMPLES FROM DRINKING OUTLETS	# SAMPLES FROM NON- CONSUMP- TION OUTLETS	# SAMPLES WITH UNKNOWN USE	TOTAL # ELEVATED SAMPLES	# ELEVATED SAMPLES FROM DRINKING OUTLETS	# ELEVATED SAMPLES FROM NON- CONSUMP- TION OUTLETS	# ELEVATED SAMPLES WITH UNKNOWN USE
ALLEGANY	0								
ANNE ARUNDEL	5	162	66	68	28	1	0	1	0
BALTIMORE COUNTY	19	462	241	221	0	8	3	5	0
BALTIMORE CITY	9	474	426	48	0	7	0	7	0
CALVERT	0								
CAROLINE	0								
CARROLL	0								
CECIL	1	17	17	0	0	0	0	0	0
CHARLES	0								
DORCHESTER	0								
FREDERICK	4	75	46	29	0	1	1	0	0
GARRETT	0								
HARFORD	1	5	5	0	0	0	0	0	0
HOWARD	2	55	14	37	4	1	0	1	0
KENT	1	7	2	5	0	0	0	0	0
MONTGOMERY	26	1,626	452	1137	37	35	4	31	0
PRINCE GEORGE'S	12	347	233	114	0	15	5	10	0
QUEEN ANNE	0								
ST. MARY'S	2	69	69	0	0	0	0	0	0
SOMERSET	0								
TALBOT	3	72	35	37	0	2	2	0	0
WASHINGTON	3	60	25	35	0	2	0	2	0
WICOMICO	1	2	2	0	0	1	1	0	0
WORCESTER	1	36	36	0	0	4	4	0	0
TOTAL	90	3469	1669	1731	69	77	20	57	0

Appendix D: Table 6. Lead Samples Collected - Nonpublic Schools - Period Ending July 1, 2018

*All samples are first-draw

***Number zero (0) indicates data is absent or incomplete

APPENDIX E

Tables 7 and 8. Elevated Lead Levels, Reporting Period Ending
July 1, 2018

Table 7. Elevated Lead Levels - Public Schools

KEY						
OUTLET CODE	DESCRIPTION		OUTLET CODE	DESCRIPTION		
BS	Bathroom Sink		KS	Kitchen Sink		
CF	Classroom Combination Drinking Fountain		NO	Nurse's Office		
CR	Classroom Sink		OT	Other		
CS	Classroom Combination Sink		SE	Special Education Classroom Sink		
DF	Drinking Fountain (Bubbler and Water Cooler Style)		TL	Teacher's Lounge Sink		
HD	Hot Drink Machine		USE CODE	DESCRIPTION		
HE	Home Economics Room Sink		CO	Consumption (Regularly Used for Drinking or Food/Drink Preparation)		
IM	Ice Machine		NC	Non-Consumption (Regularly Used for Hand Washing, Dishwashing, Cleaning or Any Other Non-Consumption Use)		
SCHOOL NAME	BUILDING NAME		OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
ALLEGANY COUNTY						
NO DATA						
ANNE ARUNDEL COUNTY						
Belle Grove Elementary	Belle Grove Elementary	OT**		1452 Eye Wash	23.4	
Belle Grove Elementary	Belle Grove Elementary	BS		Bathroom Hand Sink	35.5	
Belle Grove Elementary	Belle Grove Elementary	OT		Hose Bib	26.2	
Belle Grove Elementary	Belle Grove Elementary	OT		Hose Bib	30.6	
Belle Grove Elementary	Belle Grove Elementary	OT		Hose Bib	42.9	
Belle Grove Elementary	Belle Grove Elementary	OT		Hose Bib	49.8	

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Belle Grove Elementary	Belle Grove Elementary	OT		Hose Bib	24.5
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Kindergarten Bathroom Hand Sink	54.7
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Kindergarten 3 Bathroom Hand Sink	24.8
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Boys Bathroom Hand Sink	856
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Custodial Closet Slop Sink	33.6
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink(Left)	21.8
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink(Right)	31.9
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Custodial Closet Slop Sink	317
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Boys Bathroom Hand Sink(Left)	23
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Boys Bathroom Hand Sink(Right)	101
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink	25.9
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink	37.7
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink	27.5
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Boys Bathroom Hand Sink(Center)	131
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Custodial Closet Slop Sink	44.3
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink	45.8
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink	34.8
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Girls Bathroom Hand Sink	24.9
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Median Hall Gooseneck(Left)	52.2
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Median Hall Bubbler(Left)	43.9
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Median Hall Bubbler(Right)	26.4
Brooklyn Park Elementary	Brooklyn Park Elementary	BS		Gym Office Bathroom Hand Sink	40.9
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Hose Bib	33.7
Brooklyn Park Elementary	Brooklyn Park Elementary	OT		Hose Bib	42.1
George Cromwell Elementary	George Cromwell Elementary	BS		Principal's Office Hand Sink	22.9
George Cromwell Elementary	George Cromwell Elementary	BS		Bathroom Hand Sink	23.7
Glendale Elementary	Glendale Elementary	CR	NC	Room B118- C GN	31.8
Glendale Elementary	Glendale Elementary	CR	NC	Room B116 GN	31.5

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Hilltop Elementary	Hilltop Elementary	BS	NC	Boys Restroom Mail Hall	77.7
Hilltop Elementary	Hilltop Elementary	BS	NC	Girls Restroom Main Hall	673
Hilltop Elementary	Hilltop Elementary	CR	NC	Room 105	31
Hilltop Elementary	Hilltop Elementary	BS	NC	Boys Restroom(left, next to Room 7)	318
Hilltop Elementary	Hilltop Elementary	BS	NC	Girls Restroom(right, next to Room 4)	24.3
Hilltop Elementary	Hilltop Elementary	BS	NC	Girls Restroom(middle, next to Room 4)	121
Hilltop Elementary	Hilltop Elementary	DF	CO	Room 104 Bubbler(left)	129
Hilltop Elementary	Hilltop Elementary	DF	CO	Room 104 Bubbler(right)	33.5
Hilltop Elementary	Hilltop Elementary	BS	NC	Room 102B Restroom	65.3
Hilltop Elementary	Hilltop Elementary	CR	CO	Room 102A GN	83.4
Hilltop Elementary	Hilltop Elementary	DF**	CO**	Room 102A Water fountain Bubbler	110
Hilltop Elementary	Hilltop Elementary	BS	NC	Gym Boys Restroom	78
Hilltop Elementary	Hilltop Elementary	BS	CO	Gym Girls Restroom	32.3
Linthicum Elementary	Linthicum Elementary	DF**		Resources Bubbler(Right)	46.7
Linthicum Elementary	Linthicum Elementary	OT		Kindergarten- CPU Room Gooseneck	97.9
Linthicum Elementary	Linthicum Elementary	DF**		Kindergarten- CPU Room Bubbler(Right)	42.5
Linthicum Elementary	Linthicum Elementary	BS		D208 /custodial Closet Slop Sink	23
Linthicum Elementary	Linthicum Elementary	BS		Girls Bathroom hand Sink(Left)	548
Linthicum Elementary	Linthicum Elementary	BS		Boys Bathroom Hand Sink(Center)	73.1
North Glen Elementary	North Glen Elementary	OT		Principal's Office Hand Sink	29.6
Overlook Elementary	Overlook Elementary	OT		Health Room Eye Wash	21.2
Overlook Elementary	Overlook Elementary	OT		A109 Eye Wash	68.4
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	80.6
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	33
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	32.1
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	45.8
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	151
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	39.8
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	45.5
Overlook Elementary	Overlook Elementary	OT		Outside Hose Bib	368

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Park Elementary	Park Elementary	BS		Health Room Bathroom Hand Sink	22.3
Park Elementary	Park Elementary	BS		Custodial Office Bathroom Hand Sink	139
Park Elementary	Park Elementary	BS		121 Bathroom Hand Sink	194
Park Elementary	Park Elementary	OT		116 Gooseneck	24.9
Park Elementary	Park Elementary	DF		116 Bubbler	32.8
Park Elementary	Park Elementary	BS		116 Bathroom Hand Sink	39
Park Elementary	Park Elementary	OT		114 Art Suite Bubbler	24.7
Park Elementary	Park Elementary	OT		109 Science Gooseneck(by desk)	26
Park Elementary	Park Elementary	OT		109 Science Office Gooseneck	424
Park Elementary	Park Elementary	OT		Outside Hose Bib	35
Point Pleasant Elementary	Point Pleasant Elementary	DF	NC	B104 Gooseneck	116
Point Pleasant Resource Center	Point Pleasant Resource Center	DF	CO	Room 111 Bubbler	86.3
Point Pleasant Resource Center	Point Pleasant Resource Center	CR	NC	Infant toddler GN	32.8
Point Pleasant Resource Center	Point Pleasant Resource Center	OT	NC	Second Floor Slop Sink	130
Point Pleasant Resource Center	Point Pleasant Resource Center	DF	CO	Room 202 Bubbler	22.8
Point Pleasant Resource Center	Point Pleasant Resource Center	CR	NC	Room 203 GN	39.8
Point Pleasant Resource Center	Point Pleasant Resource Center	DF	CO	Room 203 Bubbler	52
Point Pleasant Resource Center	Point Pleasant Resource Center	CR	NC	Room 205 GN	33.5
Point Pleasant Resource Center	Point Pleasant Resource Center	DF	CO	Room 205 Bubbler	24.8
Point Pleasant Resource Center	Point Pleasant Resource Center	DF	CO	Room 207 Bubbler	20.7

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Point Pleasant Resource Center	Point Pleasant Resource Center	BS	NC	Boys Restroom(Right Center)	22.8
Point Pleasant Resource Center	Point Pleasant Resource Center	DF	CO	Room 213 Bubbler	28.6
Richard Henry Lee Elementary	Richard Henry Lee Elementary	CR	NC	Next to Room 306 GN	101
Richard Henry Lee Elementary	Richard Henry Lee Elementary	BS**	NC	Room 231 Girls Bathroom Hand Sink	30.2
Solley Elementary	Solley Elementary	BS	NC	110 Bathroom Hand Sink	52.5
Solley Elementary	Solley Elementary	CR	NC	Stem Classroom Gooseneck(Left)	22.2
Solley Elementary	Solley Elementary	CR	NC	Stem Classroom Gooseneck(Corner)	37.7
Solley Elementary	Solley Elementary	BS	NC	Boys Bathroom Hand Sink	22.5
BALTIMORE COUNTY					
NO DATA					
BALTIMORE CITY					
CANNOT BE DETERMINED BASED ON DOCUMENTATION PROVIDED					
CALVERT COUNTY					
Beach Elementary	Main Building	CF	CO	bubbler in A-1	34.6
CECIL COUNTY					
NO DATA					
CHARLES COUNTY					
NO DATA					
CAROLINE COUNTY					
NO DATA					
CARROLL COUNTY					
NO DATA					
DORCHESTER COUNTY					
NO DATA					
FREDERICK COUNTY					
NO DATA					

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
GARRETT COUNTY					
Accident Elementary	Accident Elementary School	BS	CO	105	54.9
Accident Elementary	Accident Elementary School	CF	CO	Media	30.0
Accident Elementary	Accident Elementary School	KS	CO	Kitchen Dishroom	141.0
Accident Elementary	Accident Elementary School	KS	CO	Kitchen	80.8
Accident Elementary	Accident Elementary School	OT	CO	Office	35.4
Accident Elementary	Accident Elementary School	OT	CO	Kettle	28.3
Broad Ford Elementary	Broad Ford Elementary School	CR	CO	105B	238.0
Broad Ford Elementary	Broad Ford Elementary School	CR	CO	101B	22.1
Broad Ford Elementary	Broad Ford Elementary School	OT	CO	Outside 161	29.6
Friendsville Elementary	Friendsville Elementary School	CR	CO	202 East	24.6
Friendsville Elementary	Friendsville Elementary School	KS	CO	Dishwash South	54.6
Friendsville Elementary	Friendsville Elementary School	KS	CO	Dishwash North	27.1
Friendsville Elementary	Friendsville Elementary School	OT	CO	AA22	23.3
Grantsville Elementary	Grantsville Elementary School	CF	CO	130	32.7

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Grantsville Elementary	Grantsville Elementary School	KS	CO	C2000 East	24.1
Grantsville Elementary	Grantsville Elementary School	OT	CO	114 Workroom	32.4
Hickory	Hickory Environmental Education Center	BS	CO	Mt. Laurel Right	21.9
Northern High	Northern Garrett High School	CR	CO	209	21.4
Southern High	Southern Garrett High School	CR	CO	1242 W	27.0
Southern High	Southern Garrett High School	OT	CO	Media Office	611.0
Southern Middle	Southern Middle School	CF	CO	B104	20.6
Southern Middle	Southern Middle School	CR	CO	B109	23.3
Southern Middle	Southern Middle School	DF	CO	Main Cor E	29.7
Southern Middle	Southern Middle School	TL	CO	B114/B112	33.2
HARFORD COUNTY					
Old Post Road Elementary School	Old Post Road Elementary	CR	CO	Classroom A-3 sink	342.0
William Paca Elementary School	William Paca Elementary	DF	CO	Room 3 drinking fountain	51.9
Riverside Elementary	Riverside Elementary	BS	NC	K 1 Restroom Sink, Left	61.2
Riverside Elementary	Riverside Elementary	BS	NC	K 1 Restroom Sink, Right	26.9
Riverside Elementary	Riverside Elementary	BS	NC	Room 2 Restroom Sink	53.1
Riverside Elementary	Riverside Elementary	BS	NC	K 3 Restroom Sink, Left	39.8
Riverside Elementary	Riverside Elementary	DF	CO	Room 15 Drinking Fountain	22.1
Riverside Elementary	Riverside Elementary	DF	CO	Room 8 Drinking Fountain	256.0
Riverside Elementary	Riverside Elementary	DF	CO	Room 1 Drinking Fountain	53.7
Abingdon Elementary School	Abingdon Elementary	DF	CO	Copier Room Drinking Fountain	29.2

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Abingdon Elementary School	Abingdon Elementary	DF**	CO**	Media Center Right Office 110 B Drinking Fountain	34.9
Ring Factory Elementary School	Ring Factory Elementary	BS	NC	Room 107, Restroom Sink	23.4
Ring Factory Elementary School	Ring Factory Elementary	CS	NC	Room 103, Classroom Sink	22.8
HOWARD COUNTY					
NO DATA					
KENT COUNTY					
NO DATA					
MONTGOMERY COUNTY					
Baker, John T. MS	Baker, John T. MS	HE	CO	Faucet 125 Home Economics	195.0
Bannockburn ES	Bannockburn ES	CR	CO	Faucet Office Media Center	28.1
Barnsley ES @ Northlake Center	Barnsley ES @ Northlake Center	CR	CO	Faucet 10 Classroom	27.5
Barnsley ES @ Northlake Center	Barnsley ES @ Northlake Center	DF	CO	Bubbler - Indoor 1 Classroom	356.0
Barnsley ES @ Northlake Center	Barnsley ES @ Northlake Center	DF	CO	Bubbler - Indoor 22 Classroom	26.6
Barnsley ES @ Northlake Center	Barnsley ES @ Northlake Center	KS	CO	Faucet Kitchen	20.9
Barnsley ES @ Northlake Center	Barnsley ES @ Northlake Center	OT	CO	Faucet Workroom Media Center Office	74.3
Beall ES	Beall ES	CR	CO	Faucet 9 Classroom	58.6
Beall ES	Beall ES	CR	CO	Faucet 003 Classroom	22.1
Belmont ES	Belmont ES	CR	CO	Faucet 10 Classroom	39.3
Belmont ES	Belmont ES	CR	CO	Faucet 8 Classroom	28.6
Belmont ES	Belmont ES	KS	CO	Faucet Kitchen Cafeteria	21.1
Bethesda Chevy Chase HS	Bethesda Chevy Chase HS	OT	CO	Faucet B226A Material Prep	55.5
Blake, James Hubert HS	Blake, James Hubert HS	IM	CO	Ice Maker B110E Kitchen	100.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Bradley Hills ES	Bradley Hills ES	CR	CO	Faucet 150 Classroom	36.1
Bradley Hills ES	Bradley Hills ES	CR	CO	Faucet 118 Classroom	35.0
Bradley Hills ES	Bradley Hills ES	DF	CO	Bubbler - Indoor 108 Classroom	42.8
Bradley Hills ES	Bradley Hills ES	DF	CO	Bubbler - Indoor 118 Classroom	35.9
Bradley Hills ES	Bradley Hills ES	DF	CO	Bubbler - Indoor 109 Classroom	34.9
Bradley Hills ES	Bradley Hills ES	OT	CO	Faucet 145A Workroom Media Center inside IMC	22.3
Burning Tree ES	Burning Tree ES	KS	CO	Faucet Kitchen All Purpose Room	35.2
Burning Tree ES	Burning Tree ES	OT	CO	Faucet Workroom Administration	22.8
Burtonsville ES	Burtonsville ES	CR	CO	Faucet 8 Classroom	23.5
Burtonsville ES	Burtonsville ES	DF	CO	Bubbler - Indoor 8 Classroom	48.6
Cannon Road ES	Cannon Road ES	OT	CO	Faucet 158 Inst Music	22.1
Carson, Rachel ES	Carson, Rachel ES	CR	CO	Faucet 131 Classroom	34.2
Carson, Rachel ES	Carson, Rachel ES	CR	CO	Faucet 127 Classroom	32.0
Clearspring ES	Clearspring ES	CR	CO	Faucet 4 Classroom	51.3
Clopper Mill ES	Clopper Mill ES	CR	CO	Faucet 6 Classroom	24.8
Clopper Mill ES	Clopper Mill ES	DF	CO	Cooler 4 Hallway Across From	31.3
Clopper Mill ES	Clopper Mill ES	KS	CO	Faucet Kitchen Cafeteria	26.0
Clopper Mill ES	Clopper Mill ES	OT	CO	Faucet Workroom Admin	21.2
Cloverly ES	Cloverly ES	CR	CO	Faucet 11 Classroom	40.3
Cold Spring ES	Cold Spring ES	CR	CO	Faucet 19 Classroom	41.0
Cold Spring ES	Cold Spring ES	CR	CO	Faucet 1 Classroom	26.2
Cold Spring ES	Cold Spring ES	DF	CO	Bubbler - Indoor 20 Computer Lab	79.1
Cold Spring ES	Cold Spring ES	DF	CO	Bubbler - Indoor 13 Classroom	56.3
Cold Spring ES	Cold Spring ES	DF	CO	Bubbler - Indoor 19 Classroom	36.1
Cold Spring ES	Cold Spring ES	DF	CO	Bubbler - Indoor 24 Classroom	35.9
Cold Spring ES	Cold Spring ES	DF	CO	Bubbler - Indoor 5 Classroom	24.2
Cold Spring ES	Cold Spring ES	OT	CO	Faucet Media Center	72.6
Cold Spring ES	Cold Spring ES	OT	CO	Faucet 20 Computer Lab	30.1
Concord School	Concord School	CR	CO	Faucet 10 Administration Classroom	238.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Damascus ES	Damascus ES	CR	CO	Faucet 11 Classroom	30.7
Damascus ES	Damascus ES	DF	CO	Bubbler - Indoor 12 Classroom	175.0
Damascus HS	Damascus HS	KS	CO	Faucet 113 Kitchen	39.5
Damascus HS	Damascus HS	KS	CO	Faucet 113 Kitchen	30.5
Damascus HS	Damascus HS	KS	CO	Faucet 113 Kitchen	29.6
Damascus HS	Damascus HS	KS	CO	Faucet 113 Kitchen	20.8
Darnestown ES	Darnestown ES	CR	CO	Faucet 115 Classroom	25.5
Darnestown ES	Darnestown ES	CR	CO	Faucet 113 Classroom	24.0
Darnestown ES	Darnestown ES	DF	CO	Bubbler - Indoor 002 Classroom	20.8
Darnestown ES	Darnestown ES	KS	CO	Faucet Kitchen	32.9
Diamond ES	Diamond ES	CR	CO	Faucet 122 Classroom	163.0
DuFief ES	DuFief ES	CR	CO	Faucet 13 Classroom	34.9
DuFief ES	DuFief ES	CR	CO	Faucet 2 Classroom	21.9
DuFief ES	DuFief ES	DF	CO	Bubbler - Indoor SP Speech Therapy	46.0
DuFief ES	DuFief ES	KS	CO	Faucet Kitchen	42.5
East Silver Spring ES	East Silver Spring ES	DF	CO	Bubbler - Indoor 108 Inst Music	27.7
East Silver Spring ES	East Silver Spring ES	OT	CO	Faucet Media Center	49.8
Eastern MS	Eastern MS	CR	CO	Faucet 707 Classroom Stage Between CR 705 and 707	24.2
Eastern MS	Eastern MS	KS	CO	Faucet 905 Classroom	56.6
Eastern MS	Eastern MS	OT	CO	Faucet Science Rm Between CR 806 and 804	64.9
Eastern MS	Eastern MS	OT	CO	Faucet Science Rm Between CR 806 and 804	34.9
Einstein, Albert HS	Einstein, Albert HS	KS	CO	Faucet 116K Kitchen Cafeteria	700.0
Fairland Center	Fairland Center	CR	CO	Faucet 1 Classroom	115.0
Fairland Center	Fairland Center	KS	CO	Faucet Kitchen	29.6
Fairland Center	Fairland Center	OT	CO	Faucet R3 Weight Room	1410.0
Fairland ES	Fairland ES	CR	CO	Faucet 6 Classroom	56.0
Fairland ES	Fairland ES	CR	CO	Faucet 205 Classroom ESOL	42.2

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Fairland ES	Fairland ES	DF	CO	Bubbler - Indoor 19 Classroom	47.0
Fallsmead ES	Fallsmead ES	CR	CO	Faucet G5 Classroom	32.7
Farmland ES	Farmland ES	DF	CO	Bubbler - Indoor 264 ESOL	564.0
Fields Road ES	Fields Road ES	CR	CO	Faucet 119 Computer Lab	259.0
Fields Road ES	Fields Road ES	CR	CO	Faucet 108 Classroom	121.0
Fields Road ES	Fields Road ES	CR	CO	Faucet 168 Classroom	43.5
Fields Road ES	Fields Road ES	DF	CO	Bubbler - Indoor 126 Classroom	99.0
Fields Road ES	Fields Road ES	DF	CO	Bubbler - Indoor 124 Classroom	51.8
Fields Road ES	Fields Road ES	DF	CO	Bubbler - Indoor 131 Classroom	21.2
Fields Road ES	Fields Road ES	KS	CO	Faucet Kitchen	21.7
Flower Hill ES	Flower Hill ES	CR	CO	Faucet 22 Classroom	85.8
Flower Hill ES	Flower Hill ES	CR	CO	Faucet 21 Classroom	44.0
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor Workroom Media Center	151.0
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor 28 Classroom	82.4
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor 26 Classroom	74.2
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor 30 Classroom	55.7
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor 24 Classroom	38.1
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor 6 Classroom	36.9
Flower Hill ES	Flower Hill ES	DF	CO	Bubbler - Indoor 4 Classroom	31.5
Fox Chapel ES	Fox Chapel ES	CR	CO	Faucet 40 Classroom	51.3
Fox Chapel ES	Fox Chapel ES	DF	CO	Bubbler - Indoor 125 Reading	88.3
Fox Chapel ES	Fox Chapel ES	DF	CO	Bubbler - Indoor 8 Computer Lab	87.0
Fox Chapel ES	Fox Chapel ES	DF	CO	Bubbler - Indoor 36 Classroom	29.2
Fox Chapel ES	Fox Chapel ES	OT	CO	Faucet 8 Computer Lab	21.8
Frost, Robert MS	Frost, Robert MS	CR	CO	Faucet 101 Classroom	145.0
Frost, Robert MS	Frost, Robert MS	OT	CO	Faucet 220 B Team Room	62.5
Frost, Robert MS	Frost, Robert MS	OT	CO	Faucet 233 Music	39.2
Gaithersburg ES	Gaithersburg ES	DF	CO	Bubbler - Indoor 14 Classroom	253.0
Gaithersburg ES	Gaithersburg ES	DF	CO	Bubbler - Indoor 11 Classroom	83.6
Germantown ES	Germantown ES	CR	CO	Faucet 9 Classroom	222.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Germantown ES	Germantown ES	CR	CO	Faucet 16 Classroom	41.8
Germantown ES	Germantown ES	CR	CO	Faucet 14 Classroom	28.5
Germantown ES	Germantown ES	DF	CO	Bubbler - Indoor G2 Classroom	171.0
Germantown ES	Germantown ES	DF	CO	Bubbler - Indoor K-1 Classroom	37.6
Germantown ES	Germantown ES	KS	CO	Faucet Kitchen All Purpose Room	41.6
Greencastle ES	Greencastle ES	CR	CO	Faucet 3 Classroom	45.5
Greenwood ES	Greenwood ES	CR	CO	Faucet 18 Classroom	48.9
Greenwood ES	Greenwood ES	CR	CO	Faucet 8 Classroom	26.5
Greenwood ES	Greenwood ES	DF	CO	Bubbler - Indoor 18 Classroom	22.3
Highland ES	Highland ES	CR	CO	Faucet 12 Classroom	75.5
Jackson Road ES	Jackson Road ES	DF	CO	Bubbler - Indoor 135 ESOL	40.9
Kensington-Parkwood ES	Kensington-Parkwood ES	OT	CO	Faucet 104 Workroom	27.9
King, Martin Luther MS	King, Martin Luther MS	KS	CO	Faucet Kitchen	30.8
Lake Seneca ES	Lake Seneca ES	DF	CO	Bubbler - Indoor 9 Classroom	38.1
Lake Seneca ES	Lake Seneca ES	DF	CO	Bubbler - Indoor 34 Classroom	29.6
Lakewood ES	Lakewood ES	KS	CO	Faucet 125 Kitchen	27.7
Leleck, JoAnn ES at Broad Acres	Leleck, JoAnn ES at Broad Acres	CR	CO	Faucet 304 Classroom	85.7
Leleck, JoAnn ES at Broad Acres	Leleck, JoAnn ES at Broad Acres	CR	CO	Faucet 309 Classroom	20.9
Leleck, JoAnn ES at Broad Acres	Leleck, JoAnn ES at Broad Acres	DF	CO	Bubbler - Indoor 304 Classroom	37.2
Leleck, JoAnn ES at Broad Acres	Leleck, JoAnn ES at Broad Acres	DF	CO	Bubbler - Indoor 406 Art	27.9
Leleck, JoAnn ES at Broad Acres	Leleck, JoAnn ES at Broad Acres	KS	CO	Faucet 220 Kitchen	22.3
Little Bennett ES	Little Bennett ES	OT	CO	Faucet 111 Workroom Media Center	21.8
Luxmanor ES	Luxmanor ES	KS	CO	Faucet Kitchen	80.0
Magruder HS	Magruder HS	OT	CO	Faucet Biology Office	70.0
Maryvale ES	Maryvale ES	CR	CO	Faucet 606 Classroom	310.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Maryvale ES	Maryvale ES	CR	CO	Faucet 2 Classroom	27.8
Maryvale ES	Maryvale ES	DF	CO	Bubbler - Indoor 203 Classroom	53.1
Maryvale ES	Maryvale ES	OT	CO	Faucet Conference Room	67.3
Meadow Hall ES	Meadow Hall ES	DF	CO	Bubbler - Indoor 45 Classroom	165.0
Mill Creek Towne ES	Mill Creek Towne ES	CR	CO	Faucet 143 Classroom	110.0
Montgomery Village MS	Montgomery Village MS	CR	CO	Faucet 153B Classroom	45.6
New Hampshire Estates ES	New Hampshire Estates ES	DF	CO	Bubbler - Indoor 309 Classroom	42.5
Newport Mill MS	Newport Mill MS	SE	CO	Faucet 304 Classroom Special Education	55.0
North Chevy Chase ES	North Chevy Chase ES	KS	CO	Faucet Kitchen	22.0
Northwood HS	Northwood HS	OT	CO	Faucet Workroom Administration	128.0
Oak View ES	Oak View ES	DF	CO	Bubbler - Indoor 209 Classroom	37.6
Parkland MS	Parkland MS	KS	CO	Faucet 1109 Kitchen	33.9
Pine Crest ES	Pine Crest ES	DF	CO	Bubbler - Indoor 30 Classroom	28.4
Pine Crest ES	Pine Crest ES	OT	CO	Faucet Office Next To 27	31.9
Poolesville ES	Poolesville ES	CR	CO	Faucet 17 Classroom	60.3
Poolesville ES	Poolesville ES	CR	CO	Faucet 1 Classroom	47.0
Poolesville ES	Poolesville ES	CR	CO	Faucet 20 Classroom	31.2
Poolesville ES	Poolesville ES	CR	CO	Faucet 19 Classroom	26.3
Poolesville ES	Poolesville ES	CR	CO	Faucet 10 Classroom	23.7
Poolesville ES	Poolesville ES	CR	CO	Faucet 7 Classroom	22.5
Poolesville ES	Poolesville ES	DF	CO	Bubbler - Indoor 21 Classroom	32.2
Poolesville ES	Poolesville ES	KS	CO	Faucet Kitchen	31.2
Poolesville ES	Poolesville ES	KS	CO	Faucet Kitchen	25.6
Poolesville ES	Poolesville ES	KS	CO	Faucet Kitchen	20.5
Poolesville HS	Poolesville HS	CR	CO	Faucet 24 Classroom	195.0
Poolesville HS	Poolesville HS	CR	CO	Faucet 61 Classroom	30.0
Poolesville HS	Poolesville HS	KS	CO	Faucet Kitchen	90.4
Poolesville HS	Poolesville HS	KS	CO	Faucet Kitchen	25.1
Poolesville HS	Poolesville HS	KS	CO	Faucet Kitchen	23.1
Poolesville HS	Poolesville HS	OT	CO	Faucet 37 Office Math	77.8

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Poolesville HS	Poolesville HS	OT	CO	Faucet Dressing	28.5
Poolesville HS	Poolesville HS	OT	CO	Faucet 28 Computer Lab	21.7
Potomac ES	Potomac ES	OT	CO	Faucet Workroom Media Center	42.1
Quince Orchard HS	Quince Orchard HS	OT	CO	Faucet Training Room	29.1
Ridgeview MS	Ridgeview MS	NO	CO	Faucet 11 Health Room Administration Inside Rm Next to 013 Storage in Health	23.1
Rock View ES	Rock View ES	CR	CO	Faucet 205 Classroom	40.6
Rolling Terrace ES	Rolling Terrace ES	CR	CO	Faucet B107 Classroom	21.6
Rolling Terrace ES	Rolling Terrace ES	DF	CO	Bubbler - Indoor B214 Classroom	21.9
Seven Locks ES	Seven Locks ES	CR	CO	Faucet 220 Classroom	47.1
Shady Grove MS	Shady Grove MS	KS	CO	Faucet Kitchen	21.7
Sherwood ES	Sherwood ES	DF	CO	Bubbler - Indoor 134 Classroom	90.9
Sherwood ES	Sherwood ES	KS	CO	Faucet Kitchen	22.9
Sherwood ES	Sherwood ES	OT	CO	Faucet 102 Workroom Administration	44.8
Silver Spring International MS & Sligo Creek ES	Silver Spring International MS & Sligo Creek ES	CR	CO	Faucet 130 Classroom	29.0
Silver Spring International MS & Sligo Creek ES	Silver Spring International MS & Sligo Creek ES	OT	CO	Faucet 308 Workroom	31.0
Sligo MS	Sligo MS	KS	CO	Faucet Kitchen Cafeteria	29.0
Sligo MS	Sligo MS	TL	CO	Faucet 111 Break Room	50.6
Smith, Lathrope Center	Smith, Lathrope Center	OT	CO	Faucet Retriever Rm Inside Of White Oak Hall	148.0
Smith, Lathrope Center	Smith, Lathrope Center	OT	CO	Faucet Retriever Rm Inside Of White Oak Hall	79.8
South Lake ES	South Lake ES	CR	CO	Faucet CR 10 Classroom	431.0
South Lake ES	South Lake ES	CR	CO	Faucet CR 24 Classroom	174.0
South Lake ES	South Lake ES	CR	CO	Faucet CR 18 Classroom	97.6
South Lake ES	South Lake ES	CR	CO	Faucet CR 6 Classroom	66.1
South Lake ES	South Lake ES	CR	CO	Faucet CR 2 Classroom	54.3
South Lake ES	South Lake ES	CR	CO	Faucet CR 7 Classroom	28.6

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
South Lake ES	South Lake ES	CR	CO	Faucet CR 15 Classroom	28.4
South Lake ES	South Lake ES	DF	CO	Bubbler - Indoor 12C Classroom	25.3
Spring Mill Center	Spring Mill Center	DF	CO	Cooler Hallway Lower level Hall	31.0
Stephen Knolls Center	Stephen Knolls Center	KS	CO	Faucet Kitchen By C1	48.1
Stephen Knolls Center	Stephen Knolls Center	KS	CO	Faucet Kitchen By C1	42.4
Stephen Knolls Center	Stephen Knolls Center	OT	CO	Faucet D7 Media Center	29.3
Stone Mill ES	Stone Mill ES	CR	CO	Faucet 1 Classroom	35.4
Stone Mill ES	Stone Mill ES	KS	CO	Faucet Kitchen	23.0
Stonegate ES	Stonegate ES	CR	CO	Faucet 23 Classroom	29.6
Stonegate ES	Stonegate ES	DF	CO	Bubbler - Indoor 15 Classroom	68.8
Stonegate ES	Stonegate ES	DF	CO	Bubbler - Indoor 24 Classroom	37.2
Stonegate ES	Stonegate ES	OT	CO	Faucet Office Gymnasium	163.0
Stonegate ES	Stonegate ES	OT	CO	Faucet Workroom Front Office Workroom	25.2
Strathmore ES	Strathmore ES	CR	CO	Faucet 123 Classroom	30.3
Strathmore ES	Strathmore ES	KS	CO	Faucet Kitchen	51.8
Summit Hall ES	Summit Hall ES	CR	CO	Faucet 19 Classroom	32.4
Summit Hall ES	Summit Hall ES	CR	CO	Faucet 23 Classroom	21.5
Takoma Park ES	Takoma Park ES	CR	CO	Faucet 500 Classroom	39.2
Tilden Center	Tilden Center	CR	CO	Faucet 224 Classroom	182.0
Tilden Center	Tilden Center	CR	CO	Faucet 202 Classroom	101.0
Tilden Center	Tilden Center	CR	CO	Faucet A108 Classroom	52.0
Tilden Center	Tilden Center	CR	CO	Faucet A108 Classroom	22.1
Tilden Center	Tilden Center	DF	CO	Cooler Hallway Next To C134	42.9
Tilden Center	Tilden Center	KS	CO	Faucet B107 Kitchen	54.1
Tilden Center	Tilden Center	KS	CO	Faucet B107 Kitchen	26.9
Tilden Center	Tilden Center	OT	CO	Faucet B101A Storage Music	51.9
Tilden Center	Tilden Center	TL	CO	Faucet 218 Break Room	93.0
Tilden MS	Tilden MS	HE	CO	Faucet A133 Home Economics	48.1
Travilah ES	Travilah ES	KS	CO	Faucet 113 Kitchen	25.3

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Twinbrook ES	Twinbrook ES	CR	CO	Faucet B5 Classroom	29.0
Twinbrook ES	Twinbrook ES	CR	CO	Faucet 303 Classroom	21.0
Twinbrook ES	Twinbrook ES	DF	CO	Bubbler - Indoor 400 Classroom	42.7
Twinbrook ES	Twinbrook ES	DF	CO	Bubbler - Indoor 205 Classroom	27.8
Twinbrook ES	Twinbrook ES	DF	CO	Bubbler - Indoor 204 Classroom	23.5
Viers Mill ES	Viers Mill ES	CR	CO	Faucet 311 Classroom	59.9
Watkins Mill ES	Watkins Mill ES	CR	CO	Faucet 10 Classroom	95.4
Watkins Mill ES	Watkins Mill ES	DF	CO	Bubbler - Indoor 12 Classroom	46.6
Watkins Mill ES	Watkins Mill ES	OT	CO	Faucet 16 Workroom	55.7
Watkins Mill ES	Watkins Mill ES	SE	CO	Faucet 1 Special Ed	107.0
Woodfield ES	Woodfield ES	CR	CO	Faucet 21 Classroom	141.0
Woodfield ES	Woodfield ES	CR	CO	Faucet 23 Classroom	38.6
Woodfield ES	Woodfield ES	CR	CO	Faucet 2 Classroom	33.0
Woodfield ES	Woodfield ES	CR	CO	Faucet 9 Classroom	23.7
Woodfield ES	Woodfield ES	CR	CO	Faucet 3 Classroom	22.2
Woodlin ES	Woodlin ES	CR	CO	Faucet 9 Classroom	40.0
Woodlin ES	Woodlin ES	DF	CO	Bubbler - Indoor 25 Classroom	106.0
Woodlin ES	Woodlin ES	DF	CO	Bubbler - Indoor 23 Classroom	41.4
Wootton HS	Wootton HS	OT	CO	Faucet 111 Computer Lab	112.0
PRINCE GEORGE'S COUNTY					
NO DATA					
QUEEN ANNE'S COUNTY					
NO DATA					
ST. MARY'S COUNTY					
Captain Walter Francis Duke Elementary School	Captain Walter Francis Duke Elementary School	OT	CO	kitchen steamer bottom	105.0
Captain Walter Francis Duke Elementary School	Captain Walter Francis Duke Elementary School	OT	CO	kitchen steamer top	134.0
Evergreen Elementary School	Evergreen Elementary School	IM	CO	Lounge refrigerator ice maker left	75.6

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Evergreen Elementary School	Evergreen Elementary School	IM	CO	Lounge refrigerator ice maker right	43.4
Evergreen Elementary School	Evergreen Elementary School	CR	CO	2nd floor #C-44 sink faucet	34.9
Evergreen Elementary School	Evergreen Elementary School	CR	CO	2nd floor #C-41 right sink faucet	20.9
Evergreen Elementary School	Evergreen Elementary School	CR	CO	2nd floor #C-18 sink	42.3
Evergreen Elementary School	Evergreen Elementary School	CR	CO	2nd floor #C-15 sink	32.2
Evergreen Elementary School	Evergreen Elementary School	CR	CO	2nd floor #C-35 left sink	25.0
Evergreen Elementary School	Evergreen Elementary School	KS	CO	1st floor kitchen oven	50.0
Evergreen Elementary School	Evergreen Elementary School	CR	CO	CR#B-35 Sink	48.6
Evergreen Elementary School	Evergreen Elementary School	CR	CO	CR#B-40 Sink	54.0
Evergreen Elementary School	Evergreen Elementary School	CR	CO	CR#B-27 Sink	62.9
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#307 (front hall) Sink Faucet	1140.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#246 Sink Faucet Right	999.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#247 Sink Faucet Right	787.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#245 Sink Faucet Right	315.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#248 BR Sink	313.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#246 Sink Faucet Left	177.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#311 Sink B	171.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#247 BR Sink	153.0
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#307 (back hall) Sink Faucet	106.0
George Washington Carver Elementary School	George Washington Carver Elementary School	DF	CO	CR#307 (back hall) Sink WF	96.4
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#248 Sink Faucet Left	91.4
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#248 Sink Faucet Right	90.4
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#241 BR Sink	71.0
George Washington Carver Elementary School	George Washington Carver Elementary School	KS	CO	Kdgt. Pod Kitchen Sink	50.7
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	Boy's BR by CR#242 Sink	50.5
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#245 BR Sink	47.7
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#217 Sink Faucet	40.9
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#209 Sink Faucet	40.7
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	Room #123 Sink	37.8
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	Girl's BR by CR#242 Sink	33.5

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
George Washington Carver Elementary School	George Washington Carver Elementary School	KS	CO	Main Office Workroom Sink	28.1
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#241 Sink Faucet	25.9
George Washington Carver Elementary School	George Washington Carver Elementary School	CR	CO	CR#311 Sink C	22.0
George Washington Carver Elementary School	George Washington Carver Elementary School	DF	CO	CR#209 Sink WF	20.7
Great Mills High School	Great Mills High School	CR	NC	CR#B-45 Sink R	20.6
Great Mills High School	Great Mills High School	CR	NC	CR#B-45 Sink A	23.1
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink I	23.3
Great Mills High School	Great Mills High School	CR	CO	Gym Concession Stand 3-Cmpt Sink	23.8
Great Mills High School	Great Mills High School	CR	CO	CR#-50 Sink H	24.3
Great Mills High School	Great Mills High School	CR	NC	2nd floor CR#A-01 Sink G	25.1
Great Mills High School	Great Mills High School	CR	NC	CR#B-55 Right Wall Sink	25.5
Great Mills High School	Great Mills High School	CR	NC	2nd floor CR#A-01 Sink E	25.7
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink B	25.8
Great Mills High School	Great Mills High School	CR	NC	CR#B-47 Sink Q	26.9
Great Mills High School	Great Mills High School	CR	CO	CR#-50 Sink Q	27.1
Great Mills High School	Great Mills High School	CR	NC	2nd floor CR#A-01 Sink F	27.1
Great Mills High School	Great Mills High School	CR		Rm. #H-34 Slnk	31.5
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink E	32.1
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink F	32.6
Great Mills High School	Great Mills High School	CR	CO	2nd floor CR#A-07 Sink D	33.4
Great Mills High School	Great Mills High School	CS	CO	CR#-50 Teacher's Desk Sink	34.9
Great Mills High School	Great Mills High School	CR	CO	2nd floor CR#A-07 Sink C	35.2
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink G	39.2
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink D	40.0
Great Mills High School	Great Mills High School	CR	NC	CR#B-43 Sink H	40.1
Great Mills High School	Great Mills High School	CR	NC	2nd floor CR#A-01 Sink D	42.2

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Great Mills High School	Great Mills High School	TL	CO	Lounge BR Sink near Sect. J	47.2
Great Mills High School	Great Mills High School	CR	NC	2nd floor CR#A-01 Sink B	52.8
Great Mills High School	Great Mills High School	CR	CO	2nd floor CR#A-07 Sink B	53.5
Great Mills High School	Great Mills High School	CR	NC	CR#B-55 Teacher's Desk Sink	59.7
Great Mills High School	Great Mills High School	CR	NC	CR#B-45 Sink Q	118.0
Great Mills High School	Great Mills High School	KS		Kitchen Steamer by Oven	134.0
Great Mills High School	Great Mills High School	CR	NC	CR#B-47 Sink E	153.0
Great Mills High School	Great Mills High School	CR	NC	CR#B-45 Sink P	192.0
Green Holly Elementary School	Green Holly Elementary School	CR	CO	CR#44 center sink	50.5
Green Holly Elementary School	Green Holly Elementary School	CR	CO	CR#36 BR sink	73.4
Green Holly Elementary School	Green Holly Elementary School	CR	CO	CR#12 sink faucet	38.5
Greenview Knolls Elementary School	Greenview Knolls Elementary School	IM	CO	lounge 2 refrigerator ice maker	22.5
Leonardtown Elementary School	Leonardtown Elementary School	IM	CO	Rm 309 ice maker	36.0
Leonardtown Elementary School	Leonardtown Elementary School	IM	CO	lounge refrigerator ice maker	46.6
Leonardtown Elementary School	Leonardtown Elementary School	CR	CO	CR 700 sink faucet	21.0
Park Hall Elementary School	Park Hall ES	CR	CO	CR#31 Sink left	20.9
Park Hall Elementary School	Park Hall ES	CR	CO	CR#10 BR Sink	22.9
Park Hall Elementary School	Park Hall ES	CR	CO	Small Music Rm. Sink Faucet	24.0
Park Hall Elementary School	Park Hall ES	TL	CO	Library Office Sink	25.8

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Park Hall Elementary School	Park Hall ES	CR	CO	CR#7 BR Sink	26.5
Park Hall Elementary School	Park Hall ES	CR	CO	CR#28 Sink	33.2
Park Hall Elementary School	Park Hall ES	CR	CO	CR#26 Sink	48.2
Park Hall Elementary School	Park Hall ES	IM	CO	Kdgt. Pod Refrig. Ice Maker	70.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 261 SINK 7	20.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 257 SINK 5	21.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 257 SINK 6	22.9
Esperanza Middle School	Esperanza MS	CR	NC	CR D 257 SINK 2	23.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 257 SINK 3	23.5
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 3	24.1
Esperanza Middle School	Esperanza MS	KS	CO	KITCHEN SINK A	25.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 261 SINK 5	25.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 5	25.2
Esperanza Middle School	Esperanza MS	CR	NC	CR D 261 SINK 6	25.4
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 1	25.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 3	26.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 6	26.2
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 7	26.6
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 4	26.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 261 SINK 3	27.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 4	27.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 2	28.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 7	28.4
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 1	28.6
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 5	28.8
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 2	28.9

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Esperanza Middle School	Esperanza MS	CR	NC	CR D 261 SINK 4	29.2
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 8	29.8
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 7	30.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 6	30.4
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 6	30.6
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 4	31.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 WORKROOM SINK	31.2
Esperanza Middle School	Esperanza MS	KS	CO	KITCHEN SINK D	32.3
Esperanza Middle School	Esperanza MS	OT	NC	CRS D 120/ D 121 STORAGE ROOM SINK	32.4
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 6	33.1
Esperanza Middle School	Esperanza MS	CR	CO	CR E 122 3 FAUCET SINK CENTER	33.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 3	34.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 7	34.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 3	35.5
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 5	38.4
Esperanza Middle School	Esperanza MS	KS	CO	KITCHEN SINK G	43.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 2	46.2
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 1	46.6
Esperanza Middle School	Esperanza MS	CR	NC	CR D 120 SINK 2	50.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 261 SINK 8	51.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 OUTSIDE WALL SINK 2	60.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 9	63.3
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 4	64.2
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 1	65.1
Esperanza Middle School	Esperanza MS	CR	NC	CR D 260 SINK 9	66.3
Esperanza Middle School	Esperanza MS	CR	NC	CR D 256 SINK 8	68.7
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 OUTSIDE WALL SINK 1	73.8
Esperanza Middle School	Esperanza MS	CR	CO	CR E 122 3 FAUCET SINK RIGHT	80.4
Esperanza Middle School	Esperanza MS	CR	CO	CR E 123 SINK C	81.2
Esperanza Middle School	Esperanza MS	CR	CO	RM D 259 PREP ROOM SINK	81.6

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Esperanza Middle School	Esperanza MS	CR	CO	CR E 122 3 FAUCET SINK LEFT	81.9
Esperanza Middle School	Esperanza MS	CR	NC	CR D 121 SINK 8	83.1
Esperanza Middle School	Esperanza MS	IM	CO	LOUNGE REFRIG ICE MAKER	103.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 OUTSIDE WALL SINK 4	113.0
Esperanza Middle School	Esperanza MS	CR	CO	CR E 123 SINK A	119.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 OUTSIDE WALL SINK 3	126.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 INSIDE WALL SINK 2	136.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 CENTER ISLAND SINK	143.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 INSIDE WALL SINK 1	219.0
Esperanza Middle School	Esperanza MS	CR	NC	CR D 116 INSIDE WALL SINK 3	250.0
SOMERSET COUNTY					
NO DATA					
TALBOT COUNTY					
NO DATA					
WASHINGTON COUNTY					
Boonsboro Elementary		CR	NC	classroom 9	23.0
Boonsboro Elementary		CR	NC	classroom 8	49.0
Boonsboro Elementary		CR	NC	classroom 6	27.0
Boonsboro Elementary		CR	NC	classroom 1	47.0
Boonsboro Elementary		CR	NC	classroom 3	61.0
Boonsboro Elementary		CR	NC	classroom 7	21.0
Boonsboro High		BS	NC	Boys C71 center	32.0
Boonsboro High		BS	NC	Boys B47 far right	23.0
Boonsboro High		OT	NC	Art room back left	600.0
Boonsboro High		OT	NC	Art room back right	3400.0
Boonsboro High		OT	NC	Art room front right	2400.0
Boonsboro High		CR	NC	Band room storage	34.0
Boonsboro High		CR	NC	Media center office	100.0
Boonsboro High		OT	NC	Art room front left	5800.0
Boonsboro Middle		BS	NC	Handicap restroom near main office	25.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Boonsboro Middle		CR	NC	wet area between classroom 17 and 18	21.0
Boonsboro Middle		CR	NC	classroom 13	560.0
Boonsboro Middle		CR	NC	copy room adjacent to teacher's lounge	560.0
Boonsboro Middle		OT	NC	room near main office adjacent to special education classroom	45.0
Cascade Elementary		DF	CO**	drinking fountain in food pantry	110.0
Cascade Elementary		BS	NC	boys restroom adjacent to multipurpose room	33.0
Cascade Elementary		CR	NC	media center workroom	38.0
Cascade Elementary		CR	NC	room 14 storage	30.0
Cascade Elementary		CR	NC	room 16 storage	39.0
Cascade Elementary		CR	NC	room 10 enrichment	27.0
Clear Spring Elementary		CS	NC	classroom 110	21.0
Clear Spring High		BS	NC	girls' dressing room right side	23.0
Clear Spring High		BS	NC	boys' locker room restroom left	22.0
Clear Spring High		BS	NC	girls' locker room office restroom	28.0
Clear Spring High		BS	NC	men's faculty restroom English area	34.0
Clear Spring High		BS	NC	women's faculty restroom near classroom 63 right side	23.0
Clear Spring High		OT	NC	art room sink along exterior wall	130.0
Clear Spring High		CR	NC	classroom 37B	36.0
Clear Spring Middle		OT	NC	dark room	45.0
Clear Spring Middle		OT	NC	common room between art and industrial arts	1900.0
Clear Spring Middle		HE	NC	home ec area sink in corner adjacent to storage	150.0
Clear Spring Middle		BS	NC	home ec area restroom sink	43.0
Clear Spring Middle		BS	NC	girls' restroom across from science lab, left sink	24.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Clear Spring Middle		BS	NC	girls' restroom across from science lab, center sink	22.0
Clear Spring Middle		BS	NC	women's staff restroom adjacent to media center storage	24.0
Clear Spring Middle		BS	NC	men's staff restroom in main office	21.0
Clear Spring Middle		BS	NC	women's staff restroom in main office	29.0
Clear Spring Middle		BS	NC	girls' locker room office	33.0
Clear Spring Middle		BS	NC	girls' locker room restroom, left side	23.0
Clear Spring Middle		BS	NC	girls' locker room restroom, right side	27.0
Clear Spring Middle		BS	NC	boys' locker room restroom left side	49.0
Clear Spring Middle		BS	NC	boys' locker room restroom right side	31.0
Clear Spring Middle		BS	NC	boys' locker room office	21.0
Clear Spring Middle		BS	NC	boys' bathroom center left	22.0
Clear Spring Middle		BS	NC	boys' bathroom far left	29.0
Clear Spring Middle		BS	NC	girls' bathroom center	21.0
Clear Spring Middle		OT	NC	kitchen hand washing sink	88.0
E. Russell Hicks Middle		CR	NC	classroom 39 right sink	84.0
E. Russell Hicks Middle		CR	NC	classroom 39 center sink	31.7
E. Russell Hicks Middle		CR	NC	teachers workroom sink main office	79.4
E. Russell Hicks Middle		BS	NC	girls' restroom near gym, center right	59.5
E. Russell Hicks Middle		BS	NC	girls' restroom near gym, left	105.3
Emma K Doub Elementary		DF	CO	drinking fountain classroom 5	90.0
Funkstown Elementary		CR	NC	mail room sink	42.0
Hancock Elementary		CR	NC	Wet area in Grade 4/5	25.0
Hancock Elementary		CR	NC	media production room	21.0
Hancock Elementary		CR	NC	media restroom	28.0
Hancock Middle/High		BS	NC	custodial restroom	62.0
Hancock Middle/High		SE	NC	special ed classroom	23.0
Hancock Middle/High		BS	NC	women's toilet, auditorium left	75.0
Hancock Middle/High		BS	NC	women's toilet, auditorium center	40.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Hancock Middle/High		BS	NC	women's toilet, auditorium right	49.0
Hancock Middle/High		BS	NC	men's toilet, auditorium left	170.0
Hancock Middle/High		BS	NC	men's toilet, auditorium right	36.0
Hancock Middle/High		CR	NC	band storage room	40.0
Hancock Middle/High		BS	NC	boys' locker room office restroom	28.0
Hancock Middle/High		BS	NC	boys' locker room restroom left	56.0
Hancock Middle/High		BS	NC	girls' locker room office restroom	54.0
Hancock Middle/High		BS	NC	girls' locker room restroom right	30.0
Hancock Middle/High		BS	NC	girls' locker room restroom left	48.0
Hancock Middle/High		BS	NC	auxiliary gym women's restroom left	22.0
Hancock Middle/High		TL	NC	teacher's room	32.0
Hancock Middle/High		CR	NC	computer lab 104	21.0
Hancock Middle/High		CR	NC	art suite	22.0
Hancock Middle/High		CR	NC	classroom A11	74.0
Hancock Middle/High		BS	NC	girls' toilet A18 center	31.0
Hancock Middle/High		CR	NC	classroom A08	24.0
Hancock Middle/High		OT	NC	hand washing sink in kitchen	40.0
Hickory Elementary		CR	NC	Wet area classroom 6 left	24.0
Hickory Elementary		CR	NC	wet area classroom 6 right	390.0
Marshall Street Center		CR	NC	wet area activity room left sink	21.0
Marshall Street Center		CR	NC	wet area, activity room, right sink	88.0
Marshall Street Center		CR	NC	wet area between media center and room 501, center right sink	85.0
Northern Middle		BS	NC	restroom in nurse's office	39.0
Northern Middle		HE	CO	back right sink in classroom RA-1	67.0
Northern Middle		HE	CO	sink adjacent to stg 090 in classroom RA-1	51.0
Paramount Elementary		CR	NC	instructional material room sink	21.0
Paramount Elementary		CR	NC	kindergarten classroom sink	32.0
Paramount Elementary		CR	NC	project challenge room sink	110.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Potomac Heights Elementary		DF	CO	drinking fountain outside special purpose room	290.0
Rockland Woods Elementary		TL	CO	1st floor	99.0
Sharpsburg Elementary		TL	NC	workroom sink in main office	24.0
Sharpsburg Elementary		BS	NC	restroom sink in main office	47.0
Sharpsburg Elementary		CR	NC	classroom 3 sink	24.0
Sharpsburg Elementary		CR	NC	classroom 4 sink	38.0
Sharpsburg Elementary		TL	CO	professional workroom sink	24.0
Sharpsburg Elementary		CR	NC	media office sink	210.0
Sharpsburg Elementary		BS	NC	Boys' toilet next to media center, left sink	28.0
Sharpsburg Elementary		CR	NC	classroom 6 sink	58.0
Sharpsburg Elementary		CR	NC	classroom 7 sink	98.0
Sharpsburg Elementary		CR	NC	classroom 8 sink	33.0
Sharpsburg Elementary		CR	NC	classroom 10 sink	46.0
Smithsburg High		BS	NC	girls' locker room office restroom	22.0
Smithsburg Middle		CR	NC	wet area sink near computer lab	100.0
Smithsburg Middle		BS	NC	boys toilet sink near computer lab	380.0
Smithsburg Middle		CR	NC	art room, left sink	120.0
Smithsburg Middle		CR	NC	left hand washing sink	26.0
Smithsburg Middle		BS	NC	faculty restroom near classroom 19, left sink	27.0
Smithsburg Middle		BS	NC	faculty restroom near classroom 19, right sink	58.0
Smithsburg Middle		BS	NC	faculty restroom sink, lower level	33.0
Springfield Middle		BS	NC	men's toilet next to vocal music center sink	69.0
Springfield Middle		CR	NC	conference room off professional area	41.7
Western Heights Middle		CR	NC	no description provided	21.0
Williamsport High		CR	NC	drafting room sink	33.0
Williamsport High		BS	NC	boys' restroom 161 right sink	230.0

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
WICOMICO COUNTY					
Delmar Elementary School	Delmar Elementary School	CF	CO	Classroom C126 CF	80.2
Delmar Elementary School	Delmar Elementary School	CF	CO	Classroom C102 CF	33.2
Delmar Elementary School	Delmar Elementary School	KS	CO	Kitchen Steamer Faucet	40.9
Delmar Elementary School	Delmar Elementary School	NO	NC	Nurse's Office Hand Sink- 15 second drip	28.0
East Salisbury Elementary School	East Salisbury Elementary School	CF	CO	Room 16 CF	25.0
East Salisbury Elementary School	East Salisbury Elementary School	CR	CO	Room 30 sink right	25.2
East Salisbury Elementary School	East Salisbury Elementary School	CS	CO	Room 15 CS	54.9
East Salisbury Elementary School	East Salisbury Elementary School	CS	CO	Room 14 CS	40.1
Fruitland Intermediate School	Fruitland Intermediate School	CS	NC	Communication Room 38 CS	159.0
Fruitland Primary School	Fruitland Primary School	DF	CO	Cafeteria (B1) Short DF	46.9
Pinehurst Elementary School	Pinehurst Elementary School	CF	CO	Classroom 205 CF (right)	21.3
Pinehurst Elementary School	Pinehurst Elementary School	CR	NC	W9 Sink	20.9
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	CR	CO	Room F3 sink	44.4
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 3	54.8
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 1	43.5
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 3	43.1
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 1	42.1

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 4	40.9
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 4	32.1
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 2	31.6
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	HE	CO	Room C5 Prep Sink 2	27.2
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	KS	CO	Kitchen Prep Sink	127.0
Pittsville Elementary and Middle School	Pittsville Elementary and Middle School	KS	CO	Kitchen Prep Sink	110.0
Westside Intermediate School	Westside Intermediate School	CR	CO	Classroom C21 Sink middle left	44.6
Westside Intermediate School	Westside Intermediate School	CR	NC	Classroom C27 Sink right	36.7
WORCESTER COUNTY					
NO DATA					

Appendix E: Table 7. Elevated Lead Levels - Public Schools - Period Ending July 1, 2018

*As reported by school

**Corrected by MDE based on description

Table 8. Elevated Lead Levels - Nonpublic Schools						
KEY						
OUTLET CODE	DESCRIPTION		OUTLET CODE	DESCRIPTION		
BS	Bathroom Sink		KS	Kitchen Sink		
CF	Classroom Combination Drinking Fountain		NO	Nurse's Office		
CR	Classroom Sink		OT	Other		
CS	Classroom Combination Sink		SE	Special Education Classroom Sink		
DF	Drinking Fountain (Bubbler and Water Cooler Style)		TL	Teacher's Lounge Sink		
HD	Hot Drink Machine		USE CODE	DESCRIPTION		
HE	Home Economics Room Sink		CO	Consumption (Regularly Used for Drinking or Food/Drink Preparation)		
IM	Ice Machine		NC	Non-Consumption (Regularly Used for Hand Washing, Dishwashing, Cleaning or Any Other Non-Consumption Use)		
SCHOOL NAME	BUILDING NAME		OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
ALLEGANY COUNTY						
NO DATA						
ANNE ARUNDEL COUNTY						
Granite Baptist School	Granite Baptist School	BS	NC	Pastor's office restroom sink	29.2	
BALTIMORE COUNTY						
Baltimore-White Marsh Adventist	Main Building	BS	NC	Bathroom Sink	59.0	
Delrey School	Main Building	OT	CO	Prevocation Center Rm 19	61.2	

Appendix E: Table 8. Elevated Lead Levels - Nonpublic Schools - Period Ending July 1, 2018

*As reported by school

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Immaculate Conception School	Middle School	CR	NC	Sink, Science room 301 (storage area)	30.0
Saint Paul Lutheran School	School	CR	CO	ST. P. - ML - 204	24.0
St. Ursula School	Main Building	BS	NC	Sink 1, Boy's room 200	32.0
Talmudical Academy	Elementary Building	BS	NC	Bathroom in Classroom #102 – South	152.0
Talmudical Academy	Main Building	OT	CO	West Kitchen – East side – over stove	21.9
Talmudical Academy	Middle School Building	CR	NC	Classroom #206 – South side	51.1
BALTIMORE CITY					
Gilman School	Middle School	CR	NC		21.0
Gilman School	Science Bldg	CR	NC		51.8
Ner Tamid - Montessori Pikesville	School Wing	BS	NC	Boys Bathroom	32.0
Ner Tamid - Montessori Pikesville	Synagogue Wing	BS	NC	Womens Bathroom	33.7
Ner Tamid - Montessori Pikesville	Synagogue Wing	BS	NC	Womens Bathroom	27.5
Ner Tamid - Montessori Pikesville	Synagogue Wing	BS	NC	Womens Bathroom	29.6
Ner Tamid - Montessori Pikesville	Synagogue Wing	BS	NC	Unisex Bathroom	142.0
CALVERT COUNTY					
NO DATA					
CECIL COUNTY					
NO DATA					
CHARLES COUNTY					
NO DATA					
CAROLINE COUNTY					
NO DATA					
CARROLL COUNTY					

Appendix E: Table 8. Elevated Lead Levels - Nonpublic Schools - Period Ending July 1, 2018

*As reported by school

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
NO DATA					
DORCHESTER COUNTY					
NO DATA					
FREDERICK COUNTY					
Mother Seton School	MAIN BUILDING	KS	CO		110.0
GARRETT COUNTY					
NO DATA					
HARFORD COUNTY					
NO DATA					
HOWARD COUNTY					
Atholton Adventist Academy	Main Building	CR	NC	Classroom Sink	30.0
KENT COUNTY					
NO ELEVATED LEAD SAMPLE RESULTS IN RESULTS SUBMITTED					
MONTGOMERY COUNTY					
Barrie School	North Building	BS	NC	Girl's Bathroom Sink in North Building	22.9
Barrie School	Upper Elementary	BS	NC	Upper Elementary Music Room Bathroom Sink	540.0
Bullis School	Founder Hall	OT	NC	Conference room sink	62.0
Bullis School	Old Gym	CS	NC	Trainer's Room Sink 3	30.9
French International School	Middle School	OT	NC	Girl's bathroom middle sink	21.1
Green Acres School	Gym	OT	NC	Women's Bathroom Sink A	500.0
Green Acres School	Main Building	OT	NC	Faucet outside of Development Office	308.0
Little Flower Parish School	1st Floor	CR	NC	Pre-K Room Sink A	35.9
Little Flower Parish School	2nd Floor	BS	NC	2/3 Grade Hallway Women's Bathroom Sink A	26.8
Our Lady of Lourdes	Main Building	CR	NC	Room 12 sink	28.4

Appendix E: Table 8. Elevated Lead Levels - Nonpublic Schools - Period Ending July 1, 2018

*As reported by school

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Our Lady of Lourdes	Main Building	CR	NC	Room 17 sink	131.0
Primary Day School	Main Building	OT	NC	Water Spigot Outside Pre-K "A"	143.0
Sidwell Friends Lower School	Exterior	OT	NC	Hose Bib outside Room 108	1720.0
Sidwell Friends Lower School	Manor House	DF	CO	2nd Floor Math Water Fountain	26.0
Sidwell Friends Lower School	Manor House	OT	NC	2nd Floor Janitors Closet Sink	90.0
Sidwell Friends Lower School	Manor House	OT	NC	Hose Bib Left of Front Porch	57.5
Sidwell Friends Lower School	Manor House	OT	NC	Hose Bib Right of Front Porch	36.7
Sidwell Friends Lower School	SAM	CR	NC	Science Room Sink A	285.0
Sidwell Friends Lower School	SAM	CR	NC	Science Room Sink C	69.6
Stone Ridge	Gym	OT	NC	1st Floor Women's Locker Shower 1	27.7
Stone Ridge	Gym	OT	NC	Middle School Girls Locker Shower 1	22.4
Stone Ridge	Gym	OT	NC	Middle School Girls Locker Shower 2	23.6
Stone Ridge	Gym	OT	NC	Middle School Girls Locker Shower 3	91.4
Stone Ridge	Gym	OT	NC	Middle School Girls Locker Shower 4	237.0
Stone Ridge	Gym	OT	NC	Middle School Girls Locker Shower 6	295.0
Stone Ridge	Gym	OT	NC	Theater Sink 1	881.0
Stone Ridge	Lower School	BS	NC	Room 256 Right BR Sink 2	25.8
Stone Ridge	Lower School	OT	NC	Head of School Shower	127.0
Stone Ridge	Main School Building	CF	NC	Room 624 Sink Hose	239.0
Stone Ridge	Main School Building	CS	NC	Room 624 Sink	28.1
Stone Ridge	Main School Building	OT	NC	Science 581 Eye Wash	40.1
Stone Ridge	Upper School	OT	NC	4th Floor Janitor Slop Sink	21.1

Appendix E: Table 8. Elevated Lead Levels - Nonpublic Schools - Period Ending July 1, 2018

*As reported by school

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
Yeshiva of Greater Washington Tiferes Gedaliah		KS	CO	cafeteria	228
Yeshiva of Greater Washington Tiferes Gedaliah		KS	CO	cafeteria	30.2
Yeshiva of Greater Washington Tiferes Gedaliah		KS	CO	cafeteria	25.1
PRINCE GEORGE'S COUNTY					
Dematha Catholic High School	Main	UNK	CO	101 teacher sink	51.2
Dematha Catholic High School	Main	UNK	CO	103 teacher sink	20.9
Dematha Catholic High School	Main	UNK	CO	104 teacher sink	67.2
Dematha Catholic High School	Main	UNK	CO	108 teacher desk	36.1
New Hope Academy	South-wing	CS	NC	CS Science room	30.2
New Hope Academy	South-wing	CS	NC	CS Language Art	27.1
New Hope Academy	South-wing	CS	NC	CS Social Studies	55.0
New Hope Academy	South-wing	CS	NC	CS Literacy	76.2
St. Mary's Catholic - Landover Hills	2nd Floor	BS	NC	Staff Lavatory Sink A	139.0
St. Mary's Catholic - Landover Hills	2nd Floor	BS	NC	Staff Lavatory Sink C	441.0
St. Mary's Catholic - Landover Hills	2nd Floor	BS	NC	Staff Lavatory Sink G	388.0

Appendix E: Table 8. Elevated Lead Levels - Nonpublic Schools - Period Ending July 1, 2018

*As reported by school

SCHOOL NAME	BUILDING NAME	OUTLET CODE*	USE CODE*	OUTLET DESCRIPTION/ LOCATION	LEAD SAMPLE RESULT (ppb)
St. Mary's Catholic - Landover Hills	Basement	BS	NC	Girls Bathroom Sink B	35.7
The Foundation School	Foundation School	CR	NC	Sink, Cold Tap, FS-CR-NW-FL2-335	90.0
The Foundation School	Foundation School	CR	NC	Sink, Cold Tap, FS-CR-C-FL2-337	120.0
The Foundation School	Foundation School	KS	CO	Sink, Cold Tap, FS-KS-FL2-HSMPR	57.0
QUEEN ANNE'S COUNTY					
NO DATA					
ST. MARY'S COUNTY					
NO ELEVATED LEAD SAMPLE RESULTS IN RESULTS SUBMITTED					
SOMERSET COUNTY					
NO DATA					
TALBOT COUNTY					
St. Peter and Paul	Elementary	KS	CO	Cafeteria Back Sink #3	21.3
St. Peter and Paul	Elementary	KS	CO	Cafeteria Back Sink #1	41.2
WASHINGTON COUNTY					
Mt. Aetna SDA	Main Building	BS	NC	Men	21.0
Mt. Aetna SDA	Main Building	CR	NC	Classroom	53.0
WICOMICO COUNTY					
Asbury Child Development Center	Asbury United Methodist Church	DF	CO	Drinking Fountain, Education Wing	21.6
WORCESTER COUNTY					
Worcester Preparatory School	APAC	KS	CO	APAC 4	38.1
Worcester Preparatory School	CC	KS	CO	CC 1	36.4
Worcester Preparatory School	MB	DF	CO	MB 8	38.8
Worcester Preparatory School	MB	DF	CO	MB 10	23.9

Appendix E: Table 8. Elevated Lead Levels - Nonpublic Schools - Period Ending July 1, 2018

*As reported by school

APPENDIX F

Tables 9-12. Deferral Applications Received, Reporting Period
Ending July 1, 2018

Table 9. Twelve-Month Deferrals* - Public Schools				
SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
ALLEGANY COUNTY				
NO APPLICATIONS RECEIVED				
ANNE ARUNDEL COUNTY				
Annapolis Elementary	180 Green Street	Annapolis	21401	Annapolis Elementary
Annapolis High	2700 Riva Road	Annapolis	21401	Annapolis High
Annapolis Middle	1399 Forest Drive	Annapolis	21403	Annapolis Middle
Arnold Elementary	241 Peninsula Farm Road	Arnold	21012	Arnold Elementary
Arundel High	1001 Annapolis Road	Gambrills	21054	Arundel High
Arundel Middle	1179 Hammond Lane	Odenton	21113	Arundel Middle
Bates Middle	701 Chase Street	Annapolis	21401	Bates Middle
Belvedere Elementary	360 Broadwater Road	Arnold	21012	Belvedere Elementary
Benfield Elementary	365 Lynwood Drive	Severna Park	21146	Benfield Elementary
Broadneck Elementary	470 Shore Acres Road	Arnold	21012	Broadneck Elementary
Broadneck High	1265 Green Holly Drive	Annapolis	21409	Broadneck High
Brock Bridge Elementary	405 Brock Bridge Road	Laurel	20724	Brock Bridge Elementary
Cape St. Claire Elementary	931 Blue Ridge Drive	Annapolis	21409	Cape St. Claire Elementary
Center of Applied Technology North	800 Stevenson Road	Severn	21144	Center of Applied Technology North
Center of Applied Technology South	211 Central Avenue East	Edgewater	21037	Center of Applied Technology South
Central Elementary	130 Stepney Lane	Edgewater	21037	Central Elementary
Central Middle	221 Central Avenue East	Edgewater	21037	Central Middle
Central Special	140 Stepney Lane	Edgewater	21037	Central Special
Crofton Elementary	1405 Duke of Kent Drive	Crofton	21114	Crofton Elementary
Crofton Meadows Elementary	2020 Tilghman Drive	Crofton	21114	Crofton Meadows Elementary
Crofton Middle	2301 Davidsonville Road	Gambrills	21054	Crofton Middle
Crofton Woods Elementary	1750 Urby Drive	Crofton	21114	Crofton Woods Elementary
Eastport Elementary	420 Fifth Street	Annapolis	21403	Eastport Elementary
Folger McKinsey Elementary	175 Arundel Beach Road	Severna Park	21146	Folger McKinsey Elementary
Four Seasons Elementary	979 Waugh Chapel Road	Gambrills	21054	Four Seasons Elementary
Frank Hebron-Harman Elementary	7660 Ridge Chapel Road	Hanover	21076	Hebron-Harman Elementary
Georgetown East Elementary	111 Dogwood Road	Annapolis	21403	Georgetown East Elementary
Germantown Elementary	200 Windell Avenue	Annapolis	21401	Germantown Elementary
Hillsmere Elementary	3052 Arundel on the Bay Road	Annapolis	21403	Hillsmere Elementary
Jessup Elementary	2900 Elementary School Lane	Jessup	20794	Jessup Elementary
Jones Elementary	122 Hoyle Lane	Severna Park	21146	Jones Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
MacArthur Middle	3500 Rockenbach Road	Fort Meade	20755	MacArthur Middle
Magothy River Middle	241 Peninsula Farm Road	Arnold	21012	Magothy River Middle
Manor View Elementary	2900 MacArthur Road	Fort Meade	20755	Manor View
Mary Moss at J. Albert Adams Academy	245 Clay Street	Annapolis	21401	J.Albert Adams Academy
Maryland City Elementary	3359 Crumpton South	Laurel	20742	Maryland City Elementary
Maryland Hall	801 Chase Street	Annapolis	21401	Maryland Hall
Meade Heights Elementary	1925 Reece Road	Fort Meade	20755	Meade Heights Elementary
Meade High	1100 Clark Road	Fort Meade	20755	Meade High
Mills-Parole Elementary	1 George and Marion Phelps Lane	Annapolis	21401	Mills-Parole Elementary
Nantucket Elementary	2350 Nantucket Drive	Crofton	21114	Nantucket Elementary
Oak Hill Elementary	34 Truckhouse Road	Severna Park	21146	Oak Hill Elementary
Odenton Elementary	1290 Odenton Road	Odenton	21113	Odenton Elementary
Old Mill High	600 Patriot Lane	Millersville	21108	Old Mill High
Old Mill Middle North	610 Patriot Lane	Millersville	21108	Old Mill Middle North
Old Mill Middle South	620 Patriot Lane	Millersville	21108	Old Mill Middle South
Pasadena Elementary	401 East Pasadena Road	Pasadena	21122	Pasadena Elementary
Pershing Hill Elementary	7600 29th Division Road	Fort Meade	20755	Pershing Hill Elementary
Phoenix Academy	1411 Cedar Park Road	Annapolis	21401	Phoenix Academy
Piney Orchard Elementary	2641 Strawberry Lake Way	Odenton	21113	Piney Orchard Elementary
Quarterfield Elementary	7967 Quarterfield Road	Severn	21144	Quarterfield Elementary
Ridgeway Elementary	1440 Evergreen Road	Severn	21144	Ridgeway Elementary
Rippling Woods Elementary	539 Nolfield Drive	Glen Burnie	21061	Rippling Woods Elementary
Rolling Knolls Elementary	1985 Valley Road	Annapolis	21401	Rolling Knolls Elementary
Ruth Parker Eason	648 Old Mill Road	Millersville	21108	Ruth Parker Eason
Seven Oaks Elementary	1905 Town Center Boulevard	Odenton	21113	Seven Oaks Elementary
Severn Elementary	838 Reece Road	Severn	21144	Severn Elementary
Severn River Middle	241 Peninsula Farm Road	Arnold	21012	Severn River Middle
Severna Park Elementary	6 Riggs Avenue	Severna Park	21146	Severna Park Elementary
Shipley's Choice Elementary	310 Governor Stone Parkway	Millersville	21108	Shipley's Choice Elementary
South River High	201 Central Avenue East	Edgewater	21037	South River High
Southgate Elementary	290 Shetlands Lane Glen Burnie	Glen Burnie	21061	Southgate Elementary
Studio 39	291 Locust Avenue	Annapolis	21401	Studio 39
Tyler Heights Elementary	200 Janwall Street	Annapolis	21403	Tyler Heights Elementary
Van Bokkelen Elementary	1140 Reece Road	Severn	21144	Van Bokkelen Elementary
Waugh Chapel Elementary	840 Sunflower Drive	Odenton	21113	Waugh Chapel Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
West Annapolis Elementary	505 Melvin Avenue	Annapolis	21401	West Annapolis Elementary
West Meade EEC	7722 Ray Street	Fort Meade	20755	West Meade EEC
Windsor Farm Elementary	591 Broadneck Road	Annapolis	21409	Windsor Farm Elementary
BALTIMORE COUNTY				
Arbutus Elementary School	1300 Sulphur Spring Road	Baltimore	21227	Arbutus Elementary School
Arbutus Middle School	5525 Shelbourne Road	Baltimore	21227	Arbutus Middle School
Baltimore Highlands Elementary School	4200 Annapolis Road	Baltimore	21227	Baltimore Highlands Elementary School
Battle Grove Elementary School	7828 Saint Patricia Lane	Baltimore	21222	Battle Grove Elementary School
Battle Monument Special School	7801 East Collingham Drive	Baltimore	21222	Battle Monument Special School
Bear Creek Elementary School	1601 Melbourne Road	Baltimore	21222	Bear Creek Elementary School
Bedford Elementary School	7407 Dorman Dr	Baltimore	21208	Bedford Elementary School
Berkshire Elementary School	7431 Poplar Ave	Baltimore	21224	Berkshire Elementary School
Campfield Early Childhood Center School	6834 Alter St	Baltimore	21207	Campfield Early Childhood Center School
Carney Elementary School	3131 East Joppa Road	Baltimore	21234	Carney Elementary School
Catonsville Center for Alternative Studies	901 South Rolling Road	Baltimore	21228	Catonsville Center for Alternative Studies
Catonsville Elementary School	106 Bloomsbury Ave	Baltimore	21228	Catonsville Elementary School
Catonsville High School	421 Bloomsbury Ave	Baltimore	21228	Catonsville High School
Catonsville Middle School	2301 Edmondson Ave	Baltimore	21228	Catonsville Middle School
Cedarmere Elementary School	17 Nicodemus Road	Reisterstown	21136	Cedarmere Elementary School
Chadwick Elementary School	1918 Winder Road	Baltimore	21244	Chadwick Elementary School
Chapel Hill Elementary School	5200 Joppa Road	Perry Hall	21128	Chapel Hill Elementary School
Charlesmont Elementary School	7800 West Collingham Dr	Baltimore	21222	Charlesmont Elementary School
Chase Elementary School	11701 Eastern Ave	Baltimore	21220	Chase Elementary School
Chatsworth Elementary School	222 New Ave	Reisterstown	21136	Chatsworth Elementary School
Chesapeake High School	1801 Turkey Point Road	Baltimore	21221	Chesapeake High School
Chesapeake Terrace Elementary School	2112 Lodge Farm Road	Baltimore	21219	Chesapeake Terrace Elementary School
Church Lane Elementary School	3820 Fernside Road	Randallstown	21133	Church Lane Elementary School
Cockeysville Middle School	10401 Greenside Drive	Cockeysville	21030	Cockeysville Middle School
Cromwell Valley Elementary Magnet School	825 Providence Road	Towson	21286	Cromwell Valley Elementary Magnet School
Deep Creek Elementary School	1101 East Homberg Ave	Baltimore	21221	Deep Creek Elementary School
Deep Creek Middle School	1000 Marlyn Ave	Baltimore	21221	Deep Creek Middle School
Deer Park Elementary School	9809 Lyons Mill Road	Owings Mills	21117	Deer Park Elementary School
Deer Park Middle Magnet School	9830 Winands Road	Randallstown	21133	Deer Park Middle Magnet School
Dogwood Elementary School	7215 Dogwood Road	Baltimore	21244	Dogwood Elementary School
Dulaney High School	255 Padonia Road	Timonium	21093	Dulaney High School

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Dumbarton Middle School	300 Dumbarton Middle	Baltimore	21212	Dumbarton Middle School
Dundalk Elementary School	2717 Playfield St	Baltimore	21222	Dundalk Elementary School
Dundalk Middle School	7400 Dunmanway	Baltimore	21222	Dundalk Middle School
Eastern Technical High School	1100 Mace Ave	Baltimore	21221	Eastern Technical High School
Edgemere Elementary School	7201 North Point Road	Baltimore	21219	Edgemere Elementary School
Edmondson Heights Elementary School	1600 Langford Road	Baltimore	21207	Edmondson Heights Elementary School
Elmwood Elementary School	531 Dale Ave	Baltimore	21206	Elmwood Elementary School
Essex Elementary School	100 Mace Ave	Baltimore	21221	Essex Elementary School
Featherbed Lane Elementary School	6700 Richardson Road	Baltimore	21207	Featherbed Lane Elementary School
Fort Garrison Elementary School	3310 Woodvalley Dr	Baltimore	21208	Fort Garrison Elementary School
Franklin Elementary School	33 Cockeys Mill Road	Reisterstown	21136	Franklin Elementary School
Franklin High School	12000 Reisterstown Road	Reisterstown	21136	Franklin High School
Franklin Middle School	10 Cockeys Mill Road	Reisterstown	21136	Franklin Middle School
Fullerton Elementary School	4400 Fullerton Ave	Baltimore	21236	Fullerton Elementary School
General John Stricker Middle School	7855 Trappe Road	Baltimore	21222	General John Stricker Middle School
Glenmar Elementary School	9700 Community Drive	Baltimore	21220	Glenmar Elementary School
Glyndon Elementary School	445 Glyndon Dr	Reisterstown	21136	Glyndon Elementary School
Golden Ring Middle School	6700 Kenwood Ave	Baltimore	21237	Golden Ring Middle School
Grange Elementary School	2000 Church Road	Baltimore	21222	Grange Elementary School
Gunpowder Elementary School	9540 Holiday Manor Road	Baltimore	21236	Gunpowder Elementary School
Halethorpe Elementary School	4300 Maple Ave	Baltimore	21227	Halethorpe Elementary School
Halstead Academy	1111 Halstead Road	Baltimore	21234	Halstead Academy
Hampton Elementary School	1115 Charmuth Road	Lutherville	21093	Hampton Elementary School
Harford Hills Elementary School	8902 Old Harford Road	Baltimore	21234	Harford Hills Elementary School
Hawthorne Elementary School	125 Kingston Road	Baltimore	21220	Hawthorne Elementary School
Hebbsville Elementary School	3335 Washington Ave	Baltimore	21244	Hebbsville Elementary School
Hernwood Elementary School	9919 Marriottsville Road	Randallstown	21133	Hernwood Elementary School
Hillcrest Elementary School	1500 Frederick Road	Baltimore	21228	Hillcrest Elementary School
Holabird Middle School	1701 Delvale Ave	Baltimore	21222	Holabird Middle School
Home and Hospital Program	6229 Falls Road	Baltimore	21209	Home and Hospital Program
Johnnycake Elementary School	5910 Craigmont Road	Baltimore	21228	Johnnycake Elementary School
Joppa View Elementary School	8727 Honeygo Blvd	Baltimore	21128	Joppa View Elementary School
Kenwood High School	501 Stemmers Run Road	Baltimore	21221	Kenwood High School
Kingsville Elementary School	7300 Sunshine Ave	Kingsville	21087	Kingsville Elementary School
Lansdowne High School	3800 Hollins Ferry Road	Baltimore	21227	Lansdowne High School

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Lansdowne Middle School	2400 Lansdowne Road	Baltimore	21227	Lansdowne Middle School
Loch Raven High School	1212 Cowpens Ave	Baltimore	21286	Loch Raven High School
Loch Raven Technical Academy	8101 LaSalle Road	Baltimore	21286	Loch Raven Technical Academy
Logan Elementary School	7601 Dunmanway	Baltimore	21222	Logan Elementary School
Lutherville Laboratory	1700 North York Road	Lutherville	21093	Lutherville Laboratory
Lyons Mill Elementary School	9435 Lyons Mill Road	Owings Mills	21117	Lyons Mill Elementary School
Maiden Choice School	4901 Shelbourne Road	Baltimore	21227	Maiden Choice School
Mars Estates Elementary School	1500 East Homberg Ave	Baltimore	21221	Mars Estates Elementary School
Martin Boulevard Elementary School	210 Riverton Road	Baltimore	21220	Martin Boulevard Elementary School
Mays Chapel Elementary School	12250 Roundwood Road	Timonium	21093	Mays Chapel Elementary School
McCormick Elementary School	5101 Hazelwood Ave	Baltimore	21206	McCormick Elementary School
Middle River Middle School	800 Middle River Road	Baltimore	21220	Middle River Middle School
Middleborough Elementary School	313 West Road	Baltimore	21221	Middleborough Elementary School
Middlesex Elementary School	142 Bennett Road	Baltimore	21221	Middlesex Elementary School
Milbrook Elementary School	4300 Crest Heights Road	Baltimore	21215	Milbrook Elementary School
Milford Mill Academy	3800 Washington Ave	Baltimore	21244	Milford Mill Academy
New Town Elementary School	4924 New Town Blvd	Owings Mills	21117	New Town Elementary School
Northwest Academy of Health Sciences	4627 Old Court Road	Baltimore	21208	Northwest Academy of Health Sciences
Norwood Elementary School	1700 Delvale Ave	Baltimore	21222	Norwood Elementary School
Oakleigh Elementary School	1900 White Oak Ave	Baltimore	21234	Oakleigh Elementary School
Oliver Beach Elementary School	12912 Cunninghill Cove Road	Baltimore	21220	Oliver Beach Elementary School
Orems Elementary School	711 Highvilla Road	Baltimore	21221	Orems Elementary School
Overlea High School	5401 Kenwood Ave	Baltimore	21206	Overlea High School
Owings Mills Elementary School	10824 Reisterstown Road	Owings Mills	21117	Owings Mills Elementary School
Owings Mills High School	124 Tollgate Road	Owings Mills	21117	Owings Mills High School
Padonia International Elementary School	9834 Greenside Dr	Cockeysville	21030	Padonia International Elementary School
Parkville High School	2600 Putty Hill Ave	Baltimore	21234	Parkville High School
Parkville Middle School	8711 Avondale Road	Baltimore	21234	Parkville Middle School
Patapsco High School & Center for Arts	8100 Wise Ave	Baltimore	21222	Patapsco High School & Center for Arts
Perry Hall Elementary School	9021 Belair Road	Baltimore	21236	Perry Hall Elementary School
Perry Hall High School	4601 Ebenezer Road	Baltimore	21236	Perry Hall High School
Perry Hall Middle School	4300 Ebenezer Road	Baltimore	21236	Perry Hall Middle School
Pikesville High School	7621 Labyrinth Road	Baltimore	21208	Pikesville High School
Pikesville Middle School	7701 Seven Mile Lane	Baltimore	21208	Pikesville Middle School
Pine Grove Elementary School	2701 Summit Ave	Baltimore	21234	Pine Grove Elementary School

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Pine Grove Middle School	9200 Old Harford Road	Baltimore	21234	Pine Grove Middle School
Pinewood Elementary School	200 Rickswood Road	Timonium	21093	Pinewood Elementary School
Pleasant Plains Elementary School	8300 Pleasant Plains Road	Baltimore	21286	Pleasant Plains Elementary School
Pot Spring Elementary School	2410 Springlake Dr	Timonium	21093	Pot Spring Elementary School
Powhatan Elementary School	3300 Kelox Road	Baltimore	21207	Powhatan Elementary School
Randallstown Elementary School	9013 Liberty Road	Randallstown	21133	Randallstown Elementary School
Randallstown High School	4000 Offutt Road	Randallstown	21133	Randallstown High School
Red House Run Elementary School	1717 Weyburn Road	Baltimore	21237	Red House Run Elementary School
Reisterstown Elementary School	223 Walgrove Road	Reisterstown	21136	Reisterstown Elementary School
Relay Elementary School	5885 Selford Road	Baltimore	21227	Relay Elementary School
Riderwood Elementary School	1711 Landrake Road	Baltimore	21204	Riderwood Elementary School
Ridge Ruxton School	6916 Charles St	Baltimore	21204	Ridge Ruxton School
Ridgely Middle School	121 Ridgely Road	Lutherville	21093	Ridgely Middle School
Riverview Elementary School	3298 Kessler Road	Baltimore	21227	Riverview Elementary School
Rodgers Forge Elementary School	250 Dumbarton Road	Baltimore	21212	Rodgers Forge Elementary School
Sandalwood Elementary School	900 South Marlyn Ave	Baltimore	21221	Sandalwood Elementary School
Sandy Plains Elementary School	8330 Kavanagh Road	Baltimore	21222	Sandy Plains Elementary School
Scotts Branch Elementary School	8220 Tawnmoore Road	Baltimore	21244	Scotts Branch Elementary School
Seneca Elementary School	545 Carrollwood Road	Baltimore	21220	Seneca Elementary School
Seven Oaks Elementary School	9220 Seven Courts Road	Baltimore	21236	Seven Oaks Elementary School
Seventh District Elementary School	20300 York Road	Baltimore	21120	Seventh District Elementary School
Shady Spring Elementary School	8868 Goldenwood Road	Baltimore	21237	Shady Spring Elementary School
Southwest Academy School	6200 Johnnycake Road	Baltimore	21207	Southwest Academy School
Sparks Elementary School	601 Belfast Road	Sparks	21152	Sparks Elementary School
Sparrows Point Middle/High School	7400 North Point Road	Baltimore	21219	Sparrows Point Middle/High School
Stemmers Run Middle School	201 Stemmers Run Road	Baltimore	21221	Stemmers Run Middle School
Stoneleigh Elementary School	900 Pemberton Road	Baltimore	21212	Stoneleigh Elementary School
Sudbrook Magnet Middle School	4300 Bedford Road	Baltimore	21208	Sudbrook Magnet Middle School
Summit Park Elementary School	6920 Diana Road	Baltimore	21209	Summit Park Elementary School
Sussex Elementary School	515 South Woodward Dr	Baltimore	21221	Sussex Elementary School
Timber Grove Elementary School	701 Academy Ave	Owings Mills	21117	Timber Grove Elementary School
Timonium Elementary School	2001 Eastridge Road	Timonium	21093	Timonium Elementary School
Towson High School	69 Cedar Ave	Towson	21286	Towson High School
Villa Cresta Elementary School	2600 Rader Ave	Baltimore	21234	Villa Cresta Elementary School
Vincent Farm Elementary School	6019 Ebenezer Road	White Marsh	21162	Vincent Farm Elementary School

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Warren Elementary School	900 Bosley Road	Cockeysville	21030	Warren Elementary School
Wellwood International Elementary School	2901 Smith Ave	Baltimore	21208	Wellwood International Elementary School
West Towson Elementary School	6914 North Charles St	Towson	21204	West Towson Elementary School
Westchester Elementary School	2300 Old Frederick Road	Baltimore	21228	Westchester Elementary School
Western School of Technology/Science	100 Kenwood Ave	Baltimore	21228	Western School of Technology/Science
Westowne Elementary School	401 Harlem Lane	Catonsville	21228	Westowne Elementary School
White Oak Special Education School	8401 Leefield Road	Baltimore	21234	White Oak Special Education School
Winand Elementary School	8301 Scotts Level Road	Baltimore	21208	Winand Elementary School
Winfield Elementary School	8300 Carlson Lane	Baltimore	21244	Winfield Elementary School
Woodbridge Elementary School	1410 Pleasant Valley Drive	Baltimore	21228	Woodbridge Elementary School
Woodholme Elementary School	300 Mount Wilson	Baltimore	21208	Woodholme Elementary School
Woodlawn High School	1801 Woodlawn Dr	Baltimore	21207	Woodlawn High School
Woodlawn Middle School	3033 Saint Lukes Lane	Baltimore	21207	Woodlawn Middle School
Woodmoor Elementary School	3200 Elba Dr	Baltimore	21207	Woodmoor Elementary School
BALTIMORE CITY				
NO APPLICATIONS RECEIVED				
CALVERT COUNTY				
NO APPLICATIONS RECEIVED				
CAROLINE COUNTY				
Denton Elementary	303 Sharp Road	Denton	21629	5.0301
Federalsburg Elementary School	302 S. University Ave	Federalsburg	21632	5.0501
Greensboro Elementary	625 North Main Street	Greensboro	21629	5.0201
Lockerman Middle School	410 Lockerman Street	Denton	21629	5.0302
Preston Elementary	225 Main Street	Preston	21655	5.0401
Ridgely Elementary	118 North Central Ave	Ridgely	21660	5.0701
CARROLL COUNTY				
Carrolltowne Elementary	6542 Ridge Road	Sykesville	21784	Carrolltowne Elementary
Friendship Valley	1100 Gist Road	Westminster	21157	Friendship Valley
Mt. Airy Elementary**	405 North Main Street	Mt. Airy	21771	Mt. Airy Elementary
Piney Ridge Elementary	6351 Freedom Avenue	Sykesville	21784	Piney Ridge Elementary
Robert Moton Elementary**	1413 Washington Road	Westminster	21157	Robert Moton Elementary
Spring Garden Elementary	700 Boxwood	Hampstead	21074	Spring Garden Elementary
Taneytown Elementary	100 Kings Drive	Taneytown	21787	Taneytown Elementary
CECIL COUNTY				
Bay View Elementary	910 North East Road	North East	21901	Bay View Elementary 07.0510

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Cecilton Elementary	251 West Main Street	Cecilton	21913	Cecilton Elementary 07.0104
Charlestown Elementary	550 Baltimore St	Charlestown	21914	Charlestown Elementary 07.0513
Cherry Hill Middle	2535 Singerly Road	Elkton	21921	Cherry Hill Middle 07.0313
Chesapeake City Elementary	214 Third St	Chesapeake City	21915	Chesapeake City Elementary 07.0205
Holly Hall Elementary	233 Whitehall Road	Elkton	21921	Holly Hall Elementary 07.0311
Kenmore Elementary	2475 Singerly Road	Elkton	21921	Kenmore Elementary 07.0317
North East Elementary	301 Thomas Avenue	North East	21901	North East Elementary 07.0506
North East High	300 Irishtown Road	North East	21901	North East High Sports Service Building
North East High	300 Irishtown Road	North East	21901	North East High School 07.0514
North East Middle	200 East Cecil Ave	North East	21901	North East Middle 07.0504
Perryville Elementary	901 Maywood Ave	Perryville	21903	Perryville Elementary 07.0703
Perryville High	1696 Perryville Road	Perryville	21903	Perryville High 07.0705
Thomson Estates Elementary	203 E. Thomson Drive	Elkton	21921	Thomson Estates 07.0316
CHARLES COUNTY				
Arthur H. Middleton Elementary	1109 Copley Avenue	Waldorf	20602	CCPS #09 Facility #080612
Benjamin Stoddert Middle	2040 St. Thomas Drive	Waldorf	20602	CCPS #38 Facility #080613
Berry Elementary	10155 Berry Road	Waldorf	20603	CCPS #22 Facility #080622
C. Paul Barnhart Elementary	4800 Lancaster Circle	Waldorf	20603	CCPS #21 Facility #080620
Daniel of St. Thomas Jennifer	2820 Jennifer School Lane	Waldorf	20603	CCPS #18 Facility #080617
Dr. Brown Elementary	421 University Drive	Waldorf	20602	CCPS #01 Facility #080611
Eva Turner Elementary	1000 Bannister Circle	Waldorf	20602	CCPS #15 Facility #080616
F.B. Gwynn Center	5998 Radio Station Road	LA Plata	20646	CCPS #54 Facility # 080107
General Smallwood Middle	4990 Indian Head Highway	Indian Head	20640	CCPS #36 Facility #080705
Indian Head Elementary	4200 Indian Head Highway	Indian Head	20640	CCPS #06 Facility #080710
J.C Parks Elementary	3505 Livingston Road	Indian Head	20640	CCPS #13 Facility #080703
J.P. Ryon Elementary	12140 Vivian Adams Drive	Waldorf	20601	CCPS #14 Facility #080606
John Hanson Middle	12350 Vivian Adams Drive	Waldorf	20601	CCPS #33 Facility #080608
La Plata High	6035 Radio Station Road	La Plata	20646	CCPS #54 Facility # 080106
Mary Bourgress Neal	12105 St. George's Drive	Waldorf	20602	CCPS #24 Facility #08062
Mary H. Matula Elementary	6025 Radio Station Road	LA Plata	20646	CCPS #20 Facility #080109
Milton Somers Middle	300 Willow Lane	La Plata	20646	CCPS #37 Facility #080104
Walter J. Mitchell Elementary	400 Willow Lane	La Plata	20646	CCPS #10 Facility #08105
William A. Diggs Elementary	2615 Davis Road	Waldorf	20603	CCPS #23 Facility #080624
William B. Wade Elementary	2300 Smallwood Drive	Waldorf	20603	CCPS #19 Facility #080618
DORCHESTER COUNTY				

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Cambridge South Dorchester High	2475 Cambridge Beltway	Cambridge	21613	Dorchester Student Services LEA# 09.0714
Choptank Elementary	1103 Maces Lane Road.	Cambridge	21613	Choptank Elementary LEA# 09.0716
Dorchester Student Services Center	2455 Cambridge Beltway	Cambridge	21613	Dorchester Student Services LEA# 09.0714
Hurlock Elementary	301 Charles St	Hurlock	21643	Hurlock Elementary09.1503
Judy Hoyer Center	1405 Glasgow Street	Cambridge	21613	Judy Center LEA# 09.0709
Maces Lane Middle	1101 Maces Lane Road.	Cambridge	21613	Maces Lane Middle LEA# 09.0707
Maple Elementary	5225 Egypt Road.	Cambridge	21613	Maple Elementary LEA# 09.711
Sandy Hill Elementary	1503 Glasgow Street	Cambridge	21613	Sandy Hill LEA#09.710
Vienna Elementary	4905 Ocean Gateway	Vienna	21869	Vienna Elementary/LEA 09.0302
Warwick Elementary	155 Main Street	Secretary	21664	Warwick Elementary/LEA 09.0205
FREDERICK COUNTY				
Ballenger Creek Elementary	5250 Kingsbrook Dr	Frederick	21703	Ballenger Creek Elementary
Brunswick Elementary	400 Central Ave	Brunswick	21716	Brunswick Elementary
Brunswick High	101 Cummings Dr	Brunswick	21716	Brunswick High
Brunswick Middle	301 Cummings Dr	Brunswick	21716	Brunswick Middle
Career and Technology Center	7922 Opossumtown Pike	Frederick	21702	Career and Technology Center
Carroll Manor Elementary	5624 Adamstown Road	Adamstown	21710	Carroll Manor Elementary
Catoctin High	14745 Sabillasville Road	Thurmont	21788	Catoctin High
Centerville Elementary	3601 Carriage Hill Dr	Frederick	21704	Centerville Elementary
Crestwood Middle	7100 Foxcroft Dr	Frederick	21703	Crestwood Middle
Deer Crossing Elementary	10601 Finn Dr	New Market	21774	Deer Crossing Elementary
Earth and Space Science Lab	210 Madison St	Frederick	21701	Earth and Space Science Lab
Emmitsburg Elementary	300 S Seton Ave	Emmitsburg	21727	Emmitsburg Elementary
Glade Elementary	9525 Glade Road	Walkersville	21793	Glade Elementary
Gov. Thomas Johnson High	1501 North Market Street	Frederick	21701	Gov. Thomas Johnson High
Hillcrest Elementary	1285 Hillcrest Dr	Frederick	21703	Hillcrest Elementary
Lewistown Elementary	11119 Hessong Bridge Road	Thurmont	21788	Lewistown Elementary
Lincoln Elementary	200 Madison Street	Frederick	21701	Lincoln Elementary
Lincoln Elementary A	201 Madison Street	Frederick	21701	Lincoln Elementary A
Middletown Elementary	201 E. Green St	Middletown	21769	Middletown Elementary
Middletown High	200 Schoolhouse Drive	Middletown	21769	Middletown High
Middletown Middle	100 Martha Mason Street	Middletown	21769	Middletown Middle
Middletown Primary	403 Franklin St	Middletown	21769	Middletown Primary
Monocacy Elementary	7421 Hayward Road	Frederick	21702	Monocacy Elementary
Monocacy Middle	8009 Opossumtown Pike	Frederick	21702	Monocacy Middle

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Myersville Elementary	429 Main St	Myersville	21773	Myersville Elementary
New Market Elementary	93 W Main St	New Market	21774	New Market Elementary
New Market Middle	125 W Main St	New Market	21774	New Market Middle
North Frederick Elementary	1010 Fairview Avenue	Frederick	21701	North Frederick Elementary
Oakdale Elementary	5830 Oakdale School Road	Ijamsville	21754	Oakdale Elementary
Orchard Grove Elementary	5898 Hannover Dr	Frederick	21703	Orchard Grove Elementary
Parkway Elementary	300 Carroll Pkwy	Frederick	21701	Parkway Elementary
Rock Creek Center Special Education	191 Waverley Dr	Frederick	21702	Rock Creek Center Special Education
Sabillasville Elementary	16210 Sabillasville Road	Sabillasville	21780	Sabillasville Elementary
Spring Ridge Elementary	9051 Ridgefield Dr	Frederick	21701	Spring Ridge Elementary
Thurmont Elementary	805 E Main St	Thurmont	21788	Thurmont Elementary
Thurmont Middle	408 East Main Street	Thurmont	21788	Thurmont Middle
Thurmont Primary	7989 Rocky Ridge Road	Thurmont	21788	Thurmont Primary
Tuscarora Elementary	6321 Lambert Dr	Frederick	21703	Tuscarora Elementary
Twin Ridge Elementary	1106 Leafy Hollow Cir	Mt. Airy	21771	Twin Ridge Elementary
Urbana Elementary	3554 Urbana Pike	Frederick	21704	Urbana Elementary
Walkersville Elementary	83 W Frederick St	Walkersville	21793	Walkersville Elementary
Walkersville High	81 W Frederick Street	Walkersville	21793	Walkersville High
Walkersville Middle	55 W Frederick Street	Walkersville	21793	Walkersville Middle
Waverley Elementary	201 Waverley Dr	Frederick	21702	Waverley Elementary
West Frederick Middle	515 W Patrick Street	Frederick	21701	West Frederick Middle
Whittier Elementary	2400 Whittier Dr	Frederick	21702	Whittier Elementary
Woodsboro Elementary	101 Liberty Road	Woodsboro	21798	Woodsboro Elementary
GARRETT COUNTY				
NO APPLICATIONS RECEIVED				
HARFORD COUNTY				
Aberdeen Middle	111 Mount Royal Avenue	Aberdeen	21001	Aberdeen Middle
Bakerfield Elementary	36 Baker Street	Aberdeen	21001	Bakerfield Elementary
Bel Air Middle	99 Idlewild Street	Bel Air	21014	Bel Air Middle
C. Milton Wright High	1301 Fountain Green Road.	Bel Air	21015	C. Milton Wright High
CEO Building	253 Paradise Road.	Aberdeen	21001	CEO Building
Church Creek Elementary	4299 Church Creek Road.	Belcamp	21017	Church Creek Elementary
Deerfield Elementary	2307 Willoughby Beach Road.	Edgewood	21040	Deerfield Elementary
Edgewood Middle	2311 Willoughby Beach Road.	Edgewood	21040	Edgewood Middle
Emmorton Elementary	2502 Tollgate Road.	Bel Air	21014	Emmorton Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Hall's Cross Roads Elementary	203 East Bel Air Avenue	Aberdeen	21001	Hall's Cross Roads Elementary
Havre de Grace Elementary	600 Juniata Street	Havre de Grace	21078	Havre de Grace Elementary
Havre de Grace High	700 Congress Avenue	Havre de Grace	21078	Havre de Grace High
Havre de Grace Middle	401 Lewis La.	Havre de Grace	21078	Havre de Grace Middle
Hickory Elementary	2100 Conowingo Road	Bel Air	21014	Hickory Elementary
Homestead/Wakefield Elementary	900 South Main Street	Bel Air	21014	Homestead/Wakefield Elementary
Joppatowne High	555 Joppa Farm Road.	Bel Air	21015	Joppatowne High
Magnolia Elementary	901 Trimble Road.	Joppa	21085	Magnolia Elementary
Magnolia Middle	299 Fort Hoyle Road.	Joppa	21085	Magnolia Middle
Meadowvale Elementary	910 Grace View Dr.	Havre de Grace	21078	Meadowvale Elementary
Red Pump Elementary	600 Red Pump Road.	Bel Air	21014	Red Pump Elementary
Roye-Williams Elementary	201 Oakington Road.	Havre de Grace	21078	Roye-Williams Elementary
Southampton Middle	1200 Moores Mill Road.	Bel Air	21014	Southampton Middle
William S. James Elementary	1 Laurentum Pkwy.	Abingdon	21009	William S. James Elementary
HOWARD COUNTY				
Applications and Research Laboratory	10920 Clarksville Pike	Ellicott City	21042	Applications and Research Laboratory
Atholton Elementary School	6700 Seneca Dr	Columbia	21046	Atholton Elementary
Atholton High	6520 Freetown Road	Columbia	21044	Atholton High
Bellows Spring Elementary	8125 Old Stockbridge Dr	Ellicott City	21043	Bellows Spring Elementary
Bollman Bridge Elementary	8200 Savage Guilford Road	Jessup	20794	Bollman Bridge Elementary
Bryant Woods Elementary	5450 Blue Heron Lane	Columbia	21044	Bryant Woods Elementary
Centennial High	4300 Centennial Lane	Ellicott City	21042	Centennial High
Centennial Lane Elementary	3825 Centennial Lane	Ellicott City	21042	Centennial Lane Elementary
Clarksville Elementary	12041 Clarksville Pike (Route 108)	Clarksville	21029	Clarksville Elementary
Clarksville Middle	6535 S Trotter Road	Clarksville	21029	Clarksville Middle
Clemens Crossing Elementary	10320 Quarterstaff Road	Columbia	21044	Clemens Crossing Elementary
Cradlerock Elementary	6700 Cradlerock Way	Columbia	21045	Cradlerock Elementary
Deep Run Elementary	6925 Old Waterloo Road	Elkridge	21075	Deep Run Elementary
Ducketts Lane Elementary	6501 Ducketts Lane	Elkridge	21075	Ducketts Lane Elementary
Dunloggin Middle	9129 Northfield Road	Ellicott City	21042	Dunloggin Middle
Elkridge Elementary	7075 Montgomery Road	Elkridge	21075	Elkridge Elementary
Forest Ridge Elementary	9550 Gorman Road	Laurel	20723	Forest Ridge Elementary
Fulton Elementary	11600 Scaggsville Road	Fulton	20759	Fulton Elementary
Gorman Crossing Elementary	9999 Winter Sun Road	Laurel	20723	Gorman Crossing Elementary
Guilford Elementary	7335 Oakland Mills Road	Columbia	21046	Guilford Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Hammond Elementary	8110 Aladdin Dr	Laurel	20723	Hammond Elementary
Hammond High	8800 Guilford Road	Columbia	21046	Hammond High
Hammond Middle	8110 Aladdin Dr	Laurel	20723	Hammond Middle
Hanover Hills Elementary	7030 Banbury Drive	Hanover	21076	Hanover Hills Elementary
Harper's Choice Middle	5450 Beaverkill Road	Columbia	21044	Harper's Choice Middle
Hollifield Station Elementary	8701 Stonehouse Dr	Ellicott City	21043	Hollifield Station Elementary
Howard High	8700 Old Annapolis Road	Ellicott City	21043	Howard High
Ilchester Elementary	4981 Ilchester Road	Ellicott City	21043	Ilchester Elementary
Jeffers Hill Elementary	6000 Tamar Dr	Columbia	21045	Jeffers Hill Elementary
Lake Elkhorn Middle	6680 Cradlerock Way	Columbia	21045	Lake Elkhorn Middle
Laurel Woods Elementary	9250 N Laurel Road	Laurel	20723	Laurel Woods Elementary
Lisbon Elementary	15901 Frederick Road	Woodbine	21797	Lisbon Elementary
Longfellow Elementary	5470 Hesperus Dr	Columbia	21044	Longfellow Elementary
Manor Woods Elementary	11575 Frederick Road	Ellicott City	21042	Manor Woods Elementary
Mt. Hebron High	9440 Old Frederick Road	Ellicott City	21042	Mt. Hebron High
New Cedar Lane School	11631 Scaggsville Road	Fulton	20759	New Cedar Lane School
Northfield Elementary	9125 Northfield Road	Ellicott City	21042	Northfield Elementary
Oakland Mills High	9410 Kilimanjaro Road	Columbia	21045	Oakland Mills High
Oakland Mills Middle	9540 Kilimanjaro Road	Columbia	21045	Oakland Mills Middle
Old Cedar Lane School	11630 Scaggsville Road	Fulton	20759	Old Cedar Lane School
Patapsco Middle	8885 Old Frederick Road	Ellicott City	21043	Patapsco Middle
Patuxent Valley Middle	9151 Vollmerhausen Road	Savage	20763	Patuxent Valley Middle
Phelps Luck Elementary	5370 Old Stone Ct	Columbia	21045	Phelps Luck Elementary
Pointers Run Elementary	6600 S Trotter Road	Clarksville	21029	Pointers Run Elementary
Rockburn Elementary	6145 Montgomery Road	Elkridge	21075	Rockburn Elementary
Running Brook Elementary	5215 W Running Brook Road	Columbia	21044	Running Brook Elementary
St. John's Lane Elementary	2960 St Johns Lane	Ellicott City	21042	St. John's Lane Elementary
Stevens Forest Elementary	6045 Stevens Forest Road	Columbia	21045	Stevens Forest Elementary
Swansfield Elementary	5610 Cedar Lane	Columbia	21044	Swansfield Elementary
Talbott Springs Elementary	9550 Basket Ring Road	Columbia	21045	Talbott Springs Elementary
Thunder Hill Elementary	9357 Mellenbrook Road	Columbia	21045	Thunder Hill Elementary
Veterans Elementary	4355 Montgomery Road	Ellicott City	21043	Veterans Elementary
Waterloo Elementary	5940 Waterloo Road	Columbia	21045	Waterloo Elementary
Waverly Elementary	10220 Wetherburn Road	Ellicott City	21042	Waverly Elementary
West Friendship Elementary	12500 Frederick Road	West Friendship	21794	West Friendship Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Worthington Elementary	4570 Roundhill Road	Ellicott City	21043	Worthington Elementary
KENT COUNTY				
NO APPLICATIONS RECEIVED				
MONTGOMERY COUNTY				
NO APPLICATIONS RECEIVED				
PRINCE GEORGE'S COUNTY				
Apple Grove Elementary**	7400 Bellefield Ave	Fort Washington	20744	Apple Grove Elementary
Beacon Heights Elementary**	6929 Furman Parkway	Riverdale	20737	Beacon Heights Elementary
Beltsville Academy**	4300 Wicomico Ave	Beltsville	20705	Beltsville Academy
Benjamin Stoddert Middle**	2501 Olson St	Temple Hills	20748	Benjamin Stoddert Middle
Bond Mill Elementary**	16001 Sherwood Ave	Laurel	20707	Bond Mill Elementary
Bowie High**	15200 Annapolis Road	Bowie	20715	Bowie High
Bradbury Heights Elementary**	1401 Glacier Ave	Capitol Heights	20743	Bradbury Heights Elementary
Brandywine Elementary**	14101 Brandywine Road	Brandywine	20613	Brandywine Elementary
C.E.Rieg Regional School**	15542 Peach Walker Dr	Mitchellville	20716	C.E.Rieg Regional School
Capitol Heights Elementary**	601 Suffolk Ave	Capitol Heights	20743	Capitol Heights Elementary
Carrollton Elementary**	8300 Quintana St	New Carrollton	20784	Carrollton Elementary
Catherine T. Reed Elementary**	9501 Greenbelt Road	Lanham	20706	Catherine T. Reed Elementary
Chapel Forge ECC**	12711 Milan Way	Bowie	20715	Chapel Forge ECC
Charles H. Flowers High**	10001 Ardwick-Ardmore Road	Springdale	20774	Charles H. Flowers High
Clinton Grove Elementary**	9420 Temple Hill Road	Clinton	20735	Clinton Grove Elementary
Columbia Park Elementary**	1901 Kent Village Dr	Landover	20785	Columbia Park Elementary
Concord Elementary**	2004 Concord Lane	District Heights	20747	Concord Elementary
Cool Springs Elementary**	8910 Riggs Road	Adelphi	20783	Cool Springs Elementary
Croom RICA High**	9400 Surratts Road	Cheltenham	20623	Croom RICA High
Deerfield Run Elementary**	13000 Laurel-Bowie Road	Laurel	20708	Deerfield Run Elementary
District Heights Elementary**	7001 Beltz Dr	Forestville	20747	District Heights Elementary
Dora Kennedy French Immersion**	8950 Edmonston Road	Greenbelt	20770	Dora Kennedy French Immersion
Doswell E. Brooks Elementary**	1301 Brooke Road	Capitol Heights	20743	Doswell E. Brooks Elementary
DuVal High School**	9880 Good Luck Road	Lanham	20706	DuVal High School
DuVal High School Annex**	9880 Good Luck Road	Lanham	20706	DuVal High School Annex
Dwight D. Eisenhower Middle**	13725 Briarwood Drive	Laurel	20708	Dwight D. Eisenhower Middle
Eleanor Roosevelt High**	7601 Hanover Parkway	Greenbelt	20770	Eleanor Roosevelt High
Ernest Everett Just Middle**	1300 Campus - North Way	Mitchellville	20721	Ernest Everett Just Middle
Flintstone Elementary**	800 Comanche Drive	Oxon Hill	20745	Flintstone Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Fort Washington Forest Elementary**	1300 Fillmore Road	Fort Washington	20744	Fort Washington Forest Elementary
Frances Fuchs ECC**	11011 Cherry Hill Road	Beltsville	20705	Frances Fuchs ECC
Francis Scott Key Elementary**	2301 Scott Key Dr	District Heights	20747	Francis Scott Key Elementary
Gaywood Elementary**	6701 97th Ave	Seabrook	20706	Gaywood Elementary
Glassmanor Elementary**	1011 Marcy Avenue	Oxon Hill	20745	Glassmanor Elementary
Glenridge Elementary**	7200 Gallatin Street	Landover Hills	20784	Glenridge Elementary
Gwynn Park Middle**	8000 Dyson Road	Brandywine	20613	Gwynn Park Middle
Heather Hills Elementary**	12605 Heming Lane	Bowie	20716	Heather Hills Elementary
Hollywood Elementary	9811 49th Avenue	College Park	20740	Hollywood Elementary
Howard B. Owens Science Center**	9601 Greenbelt Road	Lanham	20706	Howard B. Owens Science Center
Isaac J. Gourdine Middle**	8700 Allentown Road	Fort Washington	20744	Isaac J. Gourdine Middle
J. Frank Dent Elementary**	2700 Corning Avenue	Fort Washington	20744	J. Frank Dent Elementary
James Duckworth Regional School**	11201 Evans Trail	Beltsville	20705	James Duckworth Regional School
James H. Harrison Elementary**	13200 Larchdale Road	Laurel	20708	James H. Harrison Elementary
James Madison Middle**	7300 Woodyard Road	Upper Marlboro	20772	James Madison Middle
James McHenry Elementary**	8909 McHenry Lane	Lanham	20706	James McHenry Elementary
James Ryder Randall Elementary**	5410 Kirby Road	Clinton	20735	James Ryder Randall Elementary
John Bayne Elementary**	7010 Walker Mill Road	Capitol Heights	20743	John Bayne Elementary
John Hanson Montessori**	6360 Oxon Hill Road	Oxon Hill	20745	John Hanson Montessori
Judith Hoyer Early Childhood**	929 Hill Road	Landover	20785	Judith Hoyer Early Childhood
Kenmoor ECC**	3211 82nd Avenue	Landover	20785	Kenmoor ECC
Kenmoor Middle**	2500 Kenmoor Drive	Landover	20785	Kenmoor Middle
Kettering Elementary**	11000 Layton Street	Upper Marlboro	20772	Kettering Elementary
Kingsford Elementary**	1401 Enterprise Road	Mitchellville	20721	Kingsford Elementary
Lamont Elementary**	7101 Good Luck Road	New Carrollton	20784	Lamont Elementary
Largo High**	505 Largo Road	Upper Marlboro	20772	Largo High
Laurel High**	8000 Cherry Lane	Laurel	20707	Laurel High
Laurel High Auditorium**	8000 Cherry Lane	Laurel	20707	Laurel High Auditorium
Longfields Elementary**	3300 Newkirk Avenue	Forestville	20747	Longfields Elementary
Margaret Brent Regional**	5816 Lamont Terrace	New Carrollton	20784	Margaret Brent Regional
Marlton Elementary**	8506 Old Colony - South Drive	Upper Marlboro	20772	Marlton Elementary
Maya Angelou French Immersion**	2000 Callaway Street	Temple Hills	20748	Maya Angelou French Immersion
Montpelier Elementary**	9200 Muirkirk Road	Laurel	20708	Montpelier Elementary
Oaklands Elementary**	13710 Laurel-Bowie Road	Laurel	20708	Oaklands Elementary
Oxon Hill Elementary**	7701 Livingston Road	Oxon Hill	20745	Oxon Hill Elementary

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Phyllis E. Williams Spanish Immersion**	9601 Prince Place	Upper Marlboro	20772	Phyllis E. Williams Elementary
Pointer Ridge Elementary**	1110 Parkington Lane	Bowie	20716	Pointer Ridge Elementary
Port Towns Elementary**	4351 58th Avenue	Bladensburg	20710	Port Towns Elementary
Potomac High**	5211 Boydell Avenue	Oxon Hill	20745	Potomac High
Potomac Landing Elementary**	12500 Fort Washington Road	Fort Washington	20744	Potomac Landing Elementary
Riverdale Elementary**	5006 Riverdale Road	Riverdale	20737	Riverdale Elementary
Robert Goddard Montessori**	9850 Good Luck Road	Seabrook	20706	Robert Goddard Montessori
Rocklege Elementary**	7701 Laurel-Bowie Road	Bowie	20715	Rocklege Elementary
Roger's Heights Elementary**	4301 58th Avenue	Bladensburg	20710	Roger's Heights Elementary
Samuel Chase Elementary**	5700 Fisher Road	Temple Hills	20748	Samuel Chase Elementary
Samuel Ogle Middle**	4111 Chelmont Lane	Bowie	20715	Samuel Ogle Middle
Samuel P. Massie Academy**	3301 Regency Parkway	Forestville	20747	Samuel P. Massie Academy
Suitland Elementary**	4650 Homer Avenue	Suitland	20746	Suitland Elementary
Suitland High**	5200 Silver Hill Road	Forestville	20747	Suitland High
Surratsville High**	6101 Garden Drive	Clinton	20735	Surratsville High
Tall Oaks Vocational High**	2112 Church Road	Bowie	20716	Tall Oaks Vocational High
Thomas Johnson Middle**	5401 Barker Place	Lanham	20706	Thomas Johnson Middle
Thurgood G. Marshall Middle**	4909 Brinkley Road	Temple Hills	20748	Thurgood G. Marshall Middle
Whitehall Elementary**	3901 Woodhaven Lane	Bowie	20715	Whitehall Elementary
William Beanes Elementary**	5108 Dianna Drive	Suitland	20746	William Beanes Elementary
William W. Hall Academy**	5200 Marlboro Pike	Capitol Heights	20743	William W. Hall Academy
William Wirt Middle**	6200 Tuckerman Street	Riverdale	20737	William Wirt Middle
Woodmore Elementary**	12500 Woodmore Road	Mitchellville	20721	Woodmore Elementary
Yorktown Elementary**	7301 Race Track Road	Bowie	20715	Yorktown Elementary
QUEEN ANNE'S COUNTY				
NO APPLICATIONS RECEIVED				
SAINT MARY'S COUNTY				
NO APPLICATIONS RECEIVED				
SOMERSET COUNTY				
Carter G. Woodson Elementary	281A Woodson School Road	Crisfield	21817	Carter G. Woodson Elementary
Crisfield Academy & High	210 North Somerset Avenue	Crisfield	21817	Crisfield Academy & High School
Ewell Elementary School	4005 Smith Island Road	Ewell	21824	Ewell Elementary School
Greenwood Elementary	11412 Dryden Road	Princess Anne	21853	Greenwood Elementary
Princess Anne Elementary	11576 Lankford Avenue	Princess Anne	21853	Princess Anne
Washington Academy & High	10902 Old Princess Anne Road	Princess Anne	21853	Washington Academy and High

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
TALBOT COUNTY				
NO APPLICATIONS RECEIVED				
WASHINGTON COUNTY				
NO APPLICATIONS RECEIVED				
WICOMICO COUNTY				
Willards Elementary	36161 Richland Road	Willards	21874	Bldg ID #22.1404
WORCESTER COUNTY				
Berlin Intermediate School	309 Franklin Avenue	Berlin	21811	BIS 23.0311
Buckingham Elementary School	100 Buckingham Road	Berlin	21811	BES 23.0901
Cedar Chapel Special School	510 Coulbourne Lane	Snow Hill	21863	CCSS 23.0401
Ocean City Elementary	12828 Center Drive	Ocean City	21842	OCES #23.1001
Pocomoke Elementary School	2119 Pocomoke Beltway	Pocomoke	21851	PES 23.0102
Pocomoke Middle School	800 Eighth Street	Pocomoke	21851	PMS 23. 0108
Showell Elementary School	11318 Showell School Road	Berlin	21811	SES 23.0312
Snow Hill Elementary School	515 Coulbourne Lane	Snow Hill	21863	SHES 23.0205
Snow Hill Middle School	522 Coulbourne Lane	Snow Hill	21863	SHMS 23.0208

Appendix F: Table 9. Twelve-Month Deferrals - Public Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

Table 10. Twelve-Month Deferrals* - Charter Schools				
SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
ANNE ARUNDEL COUNTY				
Monarch Academy-Annapolis, MD	2000 Capital Drive	Annapolis	21401	Monarch Academy-Annapolis, MD
Monarch Academy-Laurel, MD	430 Brock Bridge Road	Laurel	20724	Monarch Academy-Laurel, MD
PRINCE GEORGE'S COUNTY				
Excel Academy Public Charter	7910 Scott Road	Landover	20785	Excel Academy Public Charter
Imagine Andrews Public Charter	4701 San Antonio Boulevard	Andrews Air Force	20762	Imagine Andrews Public Charter
Imagine Foundations at Morning Side Public Charter	6900 Ames Street	Morning Side	20746	Imagine Foundations at Morning Side
Imagine Lincoln Public Charter	4702 Norcross Street	Temple Hills	20748	Imagine Lincoln Public Charter

Appendix F: Table 10. Twelve-Month Deferrals - Charter Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

Table 11. Twelve-Month Deferrals* - Nonpublic Schools

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
ALLEGANY COUNTY				
Beginnings Montessori	15 North Smallwood Street	Cumberland	21502	St. Paul's Lutheran Church
Calvary Christian Academy	14517 McMullen Highway	Cresaptown	21502	Calvary Christian Academy
ANNE ARUNDEL COUNTY				
Calvary Baptist Church Academy	407 Marley Station Road	Glen Burnie	21060	Elementary/Bldg 1
Creative Garden School	1560 Crofton Parkway	Crofton	21114	Creative Garden School
School of the Incarnation	2601 Symphony Lane	Bal Gambrells	21054	School of the Incarnation
St. Jane Frances School	8513 St. Jane Drive	Pasadena	21122	Main School
St. Martin's Lutheran School	1120 Spa Road	Annapolis	21403	School
St. Paul's Lutheran School	308 Oak Manor Drive	Glen Burnie	21061	Bldg ID #40356
St. Philip Neri School	6401 South Orchard Road	Linthicum	21090	St. Phillip Neri School
The Harbour School at Annapolis	1277 Green Holly Drive	Annapolis	21409	The Harbour School at Annapolis
BALTIMORE COUNTY				
Baltimore Actors Theatre Conservatory	300 Dumbarton Road	Baltimore	21212	Dumbarton House
GLA Academy 'School of Excellence'	6247 Kenwood Avenue	Baltimore	21237	GLA Academy School of Excellence
Good Shepherd School	1401 Carrollton Avenue	Towson	21204	Good Shepherd School
Holy Angels Catholic School	1201 South Caton Avenue	Baltimore	21227	Holy Angels Catholic School
Immaculate Heart of Mary School	8501 LochRaven Boulevard	Towson	21286	Immaculate Heart of Mary School
Jewish Community of Greater Baltimore	3506 GwynnBrook Avenue	Owings Mills	21117	Bldg ID #15258
Mount de Sales Academy	700 Academy Road	Baltimore	21228	Main Academic Building
Sacred Heart School	63 Sacred Heart Lane P.O. Box 3672	Glyndon	21071	Sacred Heart School
Sisters Academy of Baltimore	139 First Avenue	Baltimore	21227	Sisters Academy of Baltimore/09-033897
St. Joseph School - Cockeysville	105 Church Lane	Cockeysville	21030	New School Building
St. Joseph School - Cockeysville	105 Church Lane	Cockeysville	21030	Main School Building
St. Joseph School - Cockeysville	105 Church Lane	Cockeysville	21030	Old School Building
St. Joseph School - Fullerton	8416 Belair Road	Baltimore	21236	Main Bldg- St. Joseph School Fullerton
St. Peter's Christian Day School	7910 Belair Road	Baltimore	21236	St. Peter's North and South Buildings
The Harbour School at Baltimore	11251 Dolfield Boulevard	Owings Mills	21117	The Harbour School at Baltimore
Torah Institute of Baltimore	35 Rosewood Lane	Owings Mills	21117	Harry and Jeanette Weinberg Educational
BALTIMORE CITY				
Archbishop Curley High	3701 Sinclair Lane	Baltimore	21213	Main School Bldg, Concession Stand
Archbishop Borders School	3500 Foster Avenue	Baltimore	21224	Archbishop Borders School
Baltimore Lab School, Inc.	2220 Saint Paul Street	Baltimore	21218	Baltimore Lab School
Bnos Yisroel of Baltimore	6300 Park Heights Avenue	Baltimore	21215	Bnos Yisroel of Baltimore

Appendix F: Table 11. Twelve-Month Deferrals - Nonpublic Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Williams/Hopkins/Sinclair Halls (High School)
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Gelston Gymnasium
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Bookstore/Shop/Apartment
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Julian Smith Alumni House
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Erhardt Hall (Lower School)
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Carolyn Smith Library
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Smith Hall
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Middle School/Iglehart Gymnasium
Boys' Latin School	822 West Lake Avenue	Baltimore	21210	Solarium (Robotics/Storage)
Cheder Chabad, Inc	5713 Park Heights	Baltimore	21215	Cheder Chabad
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Dining Hall #8A
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Forbush Building #3
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Lower School #2
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Middle School #7
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Pre-Primary Building #11
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Science/Math Building #5
Friends School of Baltimore	5121 N. Charles Street	Baltimore	21210	Upper School #4
Grace United Methodist Preschool LOC#15346	5407 North Charles Street	Baltimore	21210	Grace United Methodist Church
Greater Youth Academy	200 North Bentalou Street	Baltimore	21223	Greater Church of the Risen Savior
Jewels School	5713-B Park Heights Avenue	Baltimore	21215	Jewels School
Jewish Community of Greater Baltimore	5700 Park Heights Avenue	Baltimore	21215	Bldg ID # 15383
Kennedy Krieger Institute- Leap	3835 Greenspring Avenue	Baltimore	21211	Kennedy Krieger Institute-Leap
Kennedy Krieger Institute - Lower/Middle	1750 East Fairmount Avenue	Baltimore	21231	Kennedy Krieger Institute - Lower/Middle
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Autism Blind LAC
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Autism/Blind A/B Cottage (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Autism/Blind C Cottage (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Brick Rancher (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Case Hall
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	ILH Rancher (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Knefely Gymnasium
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Multiple Disability Blind Cottage (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Multiple Disability Blind Program
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Preschool/Outreach

Appendix F: Table 11. Twelve-Month Deferrals - Nonpublic Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Randall Hall (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Russo Center
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Sipple Pool
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Thompson Hall (dorm)
Maryland School for the Blind	3501 Taylor Avenue	Baltimore	21236	Wolfe Center
Mount St. Joseph High School	4403 Frederick Avenue	Baltimore	21229	Ryken Hall
Progressive Education Center, Inc	5506 Jonquil Avenue	Baltimore	21215	Progressive Education Center , Inc
Saint Casimir Catholic School	1035 South Kenwood Street	Baltimore	21224	Saint Casimir Catholic School
School of the Cathedral of Mary Our Queen	111 Amberly Way	Baltimore	21210	School of the Cathedral of Mary Our Queen
St. David's Day School	4700 Roland Avenue	Baltimore	21210	St. David's Day School
St. James and John Catholic School	1012 Somerset Street	Baltimore	21202	St. James and John
St. Mark School	26 Melvin Avenue	Catonsville	21228	St. Mark School
St. Michael- St. Clement School	10 Willow Avenue	Baltimore	21206	St. Michael- St. Clement School
The Community School	337 West 30th Street	Baltimore	21211	2939-41 Huntington
CALVERT COUNTY				
Our Lady Star of the Sea School	90 Alexander Street	Solomons	20688	Bldg ID #433
CAROLINE COUNTY				
NO APPLICATIONS RECEIVED				
CARROLL COUNTY				
Carroll Christian Schools	550 Baltimore Boulevard	Westminster	21157	Carroll Christian Schools
St. James' Nursery School	1307 N. Main Street	Mt. Airy	21771	St. James' Episcopal Church
St. Stephen's Classical Christian Academy	2275 Liberty Road	ELdersburg	21784	St. Stephen's Classical Christian Academy
St. John Catholic School	45 Monroe Street	Westminster	21157	St. John Catholic School
CECIL COUNTY				
Good Shepherd Catholic School	800 Aiken Avenue	Perryville	21903	Good Shepherd Catholic School
Immaculate Conception School	452 Bow Street	Elkton	21921	Immaculate Conception School
CHARLES COUNTY				
Archbishop Neale School	104 Port Tobacco Road	La Plata	20646	Archbishop Neale School
DORCHESTER COUNTY				
NO APPLICATIONS RECEIVED				
FREDERICK COUNTY				
Friends Meeting School	3232 Green Valley Road	Ijamsville	21754	Founders Hall
St. John Regional Catholic School	8414 Opposumtown Pike	Frederick	21702	St. John Regional Catholic School
GARRETT COUNTY				
NO APPLICATIONS RECEIVED				

Appendix F: Table 11. Twelve-Month Deferrals - Nonpublic Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
HARFORD COUNTY				
St. Joan of Arc School	230 South Law St	Aberdeen	21001	St Joan of Arc School
St. Matthew Preschool	1200 East Churchville Road	Bel Air	21014	St. Matthew Preschool
Trinity Lutheran Christian School & Early Learning Center	1100 Philadelphia Road	Joppa	21085	Trinity Luteran Christian & Early Learning
HOWARD COUNTY				
Bryant Woods Montessori Children's House	10449 Green mountain Circle	Columbia	21044	3531- Bryant Woods Neighborhood
Columbia Montessori	10508 Marble Faun Lane	Ellicot City	21044	Columbia Montessori
High Road Academy Howard County	9705 Washington Boulevard	Laurel	20723	High Road Academy
Our Lady of Perpetual Help	4801 Ilchester Road	Ellicot City	21043	Our Lady of Perpetual Help
Phillips School Laurel	8920 Whiskey Bottom Road	Laurel	20723	Phillips School Laurel
St. Augustine School	5990 Old Washington Road	Elkridge	21075	St. Augustine School
KENT COUNTY				
NO APPLICATIONS RECEIVED				
MONTGOMERY COUNTY				
Brookewood School	10401 Armory Avenue	Kensington	20895	St. Paul's Methodist Church
Georgetown Preparatory School	10900 Rockville Pike	North Bethesda	20852	Chapel
Georgetown Preparatory School	10900 Rockville Pike	North Bethesda	20852	Gunlocke Hall
Georgetown Preparatory School	10900 Rockville Pike	North Bethesda	20852	Louis J. Boland Hall
Georgetown Preparatory School	10900 Rockville Pike	North Bethesda	20852	MackKavanagh Hall
Georgetown Preparatory School	10900 Rockville Pike	North Bethesda	20852	Power Plant
Georgetown Preparatory School	10900 Rockville Pike	North Bethesda	20852	William L. George S.J. Center
German International School	8617 Chateau Drive	Potomac	20854	German International School
Grace Episcopal Day School	9411 Connecticut Ave	Kensington	20895	Grace Episcopal Day School
Holy Cross School	4900 Strathmore Ave	Garrett Park	20896	Project ID # ADWPB-008
Jamon Montessori Day School	52 Randolph Road	Silver Spring	20904	Jamon Montessori Day School
Mother of God School	20501 Goshen Road	Gaithersburg	20879	Main School Building
Mysa School	8011 Woodmont Ave	Bethesda	20814	Bethesda Campus
Olney Adventist Preparatory School	4100 Olney Laytonsville Road	Olney	20832	Olney Adventist Preparatory School
Potomac Glen Day School Inc.	9908 South Glen Road	Potomac	20854	Potomac United Methodist Church Parish H
Saint Francis International School	1500 St. Camillus Drive	Silver Spring	20903	1500 St. Camillus Drive
Saint Peter's School	2900 Olney- Sandy Spring Road	Olney	20832	Saint Peter's School
St Andrew Apostle School	11602 Kemp Mill Road	Silver Spring	20902	St. Andrew Apostle School
St Elizabeth School	917 Montrose Road	Rockville	20852	St Elizabeth School
St. Bartholomew	6900 River Road	Bethesda	20817	Administration Building

Appendix F: Table 11. Twelve-Month Deferrals - Nonpublic Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
St. Bartholomew	6900 River Road	Bethesda	20817	School Building
St. Bernadette School	80 University Boulevard	Silver Spring	20901	St. Bernadette School
St. Jane de Chantal	9525 Old Georgetown Road	Bethesda	20814	St. Jane de Chantal
St. John's Episcopal School	3427 Olney Laytonsville Road	Olney	20832	Bldg #00579186
The Avalon School	10811 Claridge Road	Wheaton	20902	former St.Catherine Labourne School
The Harbor School	7701 Bradley Boulevard	Bethesda	20817	St. George Church
The Siena School	1300 Forest Glen Road	Silver Spring	20901	The Siena School
Washington Christian Academy	16227 Batchellors Forest Road	Olney	20832	Academic Building
Washington Christian Academy	16227 Batchellors Forest Road	Olney	20832	Gym
Washington Waldorf School	4800 Sangamore Road	Bethesda	20816	Washington Waldorf School
PRINCE GEORGE'S COUNTY				
Elizabeth Seton High School	5715 Emerson St	Bladensburg	20710	Main Building
First Baptist School of Laurel	15002 First Baptist Lane	Laurel	20707	First Baptist School of Laurel
High Road Academy of PG County	5100 Philadelphia Way Suite P	Lanham	20706	High Road Academy PG County
High Road School of PG County	9701 Philadelphia Court Suite P	Lanham	20706	High Road School of PG County
High Road Upper School of PG County	9701 Philadelphia Court Suite M	Lanham	20706	High Road Upper School of PG County
Holy Redeemer School	4902 Berwyn Road	College Park	20740	Holy Redeemer School
Independent Baptist Academy	9255 Piscataway Road	Clinton	20735	Academy
Independent Baptist Academy	9255 Piscataway Road	Clinton	20735	Cafeteria
Independent Baptist Academy	9255 Piscataway Road	Clinton	20735	Church
Independent Baptist Academy	9255 Piscataway Road	Clinton	20735	Gym
Independent Baptist Academy	9255 Piscataway Road	Clinton	20735	Preschool
St. Columba School**	7800 Livingston Road	Oxon Hill	20745	St. Columba School
St. Jerome's School	5207 42nd Place	Hyattsville	20781	St. Jerome's School
St. John the Evangelist School- Clinton	8912 Old Branch Avenue	Clinton	20735	Main Building
St. Joseph's Catholic School	11011 Montgomery Road	Beltsville	20705	St. Joseph's School
St. Mary of the Assumption	4610 Largo Road	Upper Marlboro	20772	St. Mary of the Assumption School
St. Mary's of Piscataway	13407 Piscataway Road	Clinton	20735	St. Mary's of Piscataway
St. Vincent Pallotti High School	113 St. Mary's Place	Laurel	20707	Bldg # 2545
The Academy of St. Matthias the Apostle	9473 Annapolis Road	Lanham	20706	The Academy of St. Matthias the Apostle
Village Academy of Maryland	8601 Ashwood Drive	Capitol Heights	20743	Village Academy of Maryland
QUEEN ANNE'S COUNTY				
NO APPLICATIONS RECEIVED				
SAINT MARY'S COUNTY				
Father Andrew White, SJ School	22850 Washington Street	Leonardtwn	20650	Father Andrew White, SJ School

Appendix F: Table 11. Twelve-Month Deferrals - Nonpublic Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID #
Leonard Hall Junior Naval Academy	41740 Baldrige Street	Leonardtown	20650	Leonard Hall Junior Naval Academy 1
SOMERSET COUNTY				
NO APPLICATIONS RECEIVED				
TALBOT COUNTY				
NO APPLICATIONS RECEIVED				
WASHINGTON COUNTY				
Saint Mary Catholic School	218 West Washington Street	Hagerstown	21740	Saint Mary Catholic School
Truth Christian Academy	41 Bryan Circle	Hagerstown	21740	Truth Christian Academy
WICOMICO COUNTY				
NO APPLICATIONS RECEIVED				
WORCESTER COUNTY				
NO APPLICATIONS RECEIVED				

Appendix F: Table 11. Twelve-Month Deferrals - Nonpublic Schools - Period Ending July 1, 2018

*All twelve-month deferrals have been granted unless otherwise noted.

**School has also applied for a three-year deferral.

Table 12. Three-Year Deferrals* - Public, Charter, and Nonpublic Schools

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
BALTIMORE	Nonpublic	Notre Dame Preparatory School	815 Hampton Lane	Towson	21286	Notre Dame Preparatory School
BALTIMORE CITY	Charter	Patterson Park Public Charter	27 North Lakewood Avenue	Baltimore	21224	Patterson Public Charter School 0327
CARROLL	Public	Carroll Springs School	495 South Center Street	Westminster	21157	Carroll Springs 06.0712
CARROLL	Public	Cranberry Station Elementary	505 North Center Street	Westminster	21157	Cranberry Station Elementary
CARROLL	Public	Ebb Valley Elementary	3100 Swiper Road	Manchester	21102	Ebb Valley Elementary
CARROLL	Public	Eldersburg Elementary	1021 Johnsville Road	Sykesville	21784	Eldersburg Elementary
CARROLL	Public	Elmer Wolfe Elementary	119 North Main Street	Union Bridge	21791	Elmer Wolfe Elementary
CARROLL	Public	Freedom Elementary	5626 Sykesville Road	Sykesville	21784	Freedom Elementary
CARROLL	Public	Linton Springs Elementary	375 Ronsdale Road	Sykesville	21784	Linton Springs Elementary
CARROLL	Public	Mt. Airy Elementary	405 North Main Street	Mt. Airy	21771	Mt. Airy Elementary
CARROLL	Public	Piney Ridge Elementary	6351 Freedom Avenue	Sykesville	21784	Piney Ridge Elementary
CARROLL	Public	Robert Moton	1413 Washington Road	Westminster	21157	Robert Moton
CARROLL	Public	Winters Mill High	560 Gorsuch Road	Westminster	21157	Winters Mill High
MONTGOMERY	Nonpublic	Washington Episcopal	5600 Little Falls Parkway	Bethesda	20816	Washington Episcopal
PRINCE GEORGE'S	Public	Apple Grove Elementary	7400 Bellefield Avenue	Fort Washington	20744	Apple Grove Elementary
PRINCE GEORGE'S	Public	Beacon Heights Elementary	6929 Furman Parkway	Riverdale	20737	Beacon Heights Elementary

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
PRINCE GEORGE'S	Public	Beltsville Academy	4300 Wicomico Avenue	Beltsville	20705	Beltsville Academy
PRINCE GEORGE'S	Public	Benjamin Stoddert Middle	2501 Olson Street	Temple Hills	20748	Benjamin Stoddert Middle
PRINCE GEORGE'S	Public	Bond Mill Elementary	16001 Sherwood Avenue	Laurel	20707	Bond Mill Elementary
PRINCE GEORGE'S	Public	Bowie High	15200 Annapolis Road	Bowie	20715	Bowie High
PRINCE GEORGE'S	Public	Bradbury Heights Elementary	1401 Glacier Avenue	Capitol Heights	20743	Bradbury Heights Elementary
PRINCE GEORGE'S	Public	Brandywine Elementary	14101 Brandywine Road	Brandywine	20613	Brandywine Elementary
PRINCE GEORGE'S	Public	C. Elizabeth Rieg Regional	15542 Peach Walker Drive	Mitchellville	20716	C. Elizabeth Rieg Regional
PRINCE GEORGE'S	Public	Capitol Heights Elementary	601 Suffolk Avenue	Capitol Heights	20745	Capitol Heights Elementary
PRINCE GEORGE'S	Public	Carrollton Elementary	8300 Quintana Street	New Carrollton	20784	Carrollton Elementary
PRINCE GEORGE'S	Public	Catherine T. Reed Elementary	9501 Greenbelt Road	Lanham	20706	Catherine T. Reed Elementary
PRINCE GEORGE'S	Public	Chapel Forge Early Childhood Center	12711 Milan Way	Bowie	20715	Chapel Forge Early Childhood Center
PRINCE GEORGE'S	Public	Charles T. Flowers High	10001 Ardwick-Ardmore Road	Springdale	20774	Charles T. Flowers High
PRINCE GEORGE'S	Public	Clinton Grove Elementary	9420 Temple Hill Road	Clinton	20735	Clinton Grove Elementary
PRINCE GEORGE'S	Public	Columbia Park Elementary	1901 Kent Village Drive	Landover	20785	Columbia Park Elementary
PRINCE GEORGE'S	Public	Concord Elementary	2004 Concord Lane	District Heights	20747	Concord Elementary

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
PRINCE GEORGE'S	Public	Cool Spring Elementary	8910 Riggs Road	Adelphi	20783	Cool Spring Elementary
PRINCE GEORGE'S	Public	Croom RICA High	9400 Surratts Road	Cheltenham	20623	Croom RICA High
PRINCE GEORGE'S	Public	Deerfield Run Elementary	13000 Laurel-Bowie Road	Laurel	20708	Deerfield Run Elementary
PRINCE GEORGE'S	Public	District Heights Elementary	2200 County Road	District Heights	20747	District Heights Elementary
PRINCE GEORGE'S	Public	Dora Kennedy French Immersion	8950 Edmonston Road	Greenbelt	20770	Dora Kennedy French Immersion
PRINCE GEORGE'S	Public	Doswell E. Brooks Elementary	1301 Brooke Road	Capitol Heights	20743	Doswell E. Brooks Elementary
PRINCE GEORGE'S	Public	DuVal High	9880 Good Luck Road	Lanham	20706	DuVal High
PRINCE GEORGE'S	Public	DuVal High Annex	9880 Good Luck Road	Lanham	20706	DuVal High Annex
PRINCE GEORGE'S	Public	Dwight D. Eisenhower Middle	13725 Briarwood Drive	Laurel	20708	Dwight D. Eisenhower Middle
PRINCE GEORGE'S	Public	Earnest Everett Just Middle	1300 Campus-North Wat	Mitchellville	20721	Earnest Everett Just Middle
PRINCE GEORGE'S	Public	Eleanor Roosevelt High	7601 Hanover Parkway	Greenbelt	20770	Eleanor Roosevelt High
PRINCE GEORGE'S	Charter	Excel Academy Public Charter	7910 Scott Road	Landover	20785	16.1317
PRINCE GEORGE'S	Public	Flintstone Elementary	800 Comanche Drive	Oxon Hill	20745	Flintstone Elementary
PRINCE GEORGE'S	Public	Fort Washington Forest Elementary	1300 Fillmore Road	Fort Washington	20744	Fort Washington Forest Elementary
PRINCE GEORGE'S	Public	Frances Fuchs Early Childhood Center	11011 Cherry Hill Road	Beltsville	20705	Frances Fuchs Early Childhood Center

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
PRINCE GEORGE'S	Public	Francis Scott Key Elementary	2301 Scott Key Drive	District Heights	20747	Francis Scott Key Elementary
PRINCE GEORGE'S	Public	Gaywood Elementary	6701 97th Avenue	Seabrook	20706	Gaywood Elementary
PRINCE GEORGE'S	Public	Glassmanor Elementary	1011 Marcy Avenue	Oxon Hill	20745	Glassmanor Elementary
PRINCE GEORGE'S	Public	Glenridge Elementary	7200 Gallatin Street	Landover Hills	20784	Glenridge Elementary
PRINCE GEORGE'S	Public	Gwynn Park Middle	8000 Dyson Road	Brandywine	20613	Gwynn Park Middle
PRINCE GEORGE'S	Public	Heather Hills Elementary	12605 Heming Lane	Bowie	20716	Heather Hills Elementary
PRINCE GEORGE'S	Public	Hollywood Elementary	9811 49th Avenue	College Park	20740	Hollywood Elementary
PRINCE GEORGE'S	Public	Howard B. Owens Science Center	9601 Greenbelt Road	Lanham	20706	Howard B. Owens Science Center
PRINCE GEORGE'S	Public	Isaac J. Gourdine Middle	8700 Allentown Road	Fort Washington	20744	Isaac J. Gourdine Middle
PRINCE GEORGE'S	Public	J. Frank Dent Elementary	2700 Corning Road	Fort Washington	20744	J. Frank Dent Elementary
PRINCE GEORGE'S	Public	James E. Duckworth Regional	11201 Evans Trail	Beltsville	20705	James E. Duckworth Regional
PRINCE GEORGE'S	Public	James H. Harrison Elementary	13200 Larchdale Road	Laurel	20708	James H. Harrison Elementary
PRINCE GEORGE'S	Public	James Madison Middle	7300 Woodyard Road	Upper Marlboro	20772	James Madison Middle
PRINCE GEORGE'S	Public	James McHenry Elementary	8909 McHenry Lane	Lanham	20706	James McHenry Elementary
PRINCE GEORGE'S	Public	James Ryder Randall Elementary	5410 Kirby Road	Clinton	20735	James Ryder Randall Elementary

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
PRINCE GEORGE'S	Public	John H. Bayne Elementary	7010 Walker Mill Road	Capitol Heights	20743	John H. Bayne Elementary
PRINCE GEORGE'S	Public	John Hanson Montessori	6360 Oxon Hill Road	Oxon Hill	20745	John Hanson Montessori
PRINCE GEORGE'S	Public	Judith P. Hoyer Early Childhood Center	2300 Belleview Avenue	Cheverly	20785	Judith P. Hoyer Early Childhood Center
PRINCE GEORGE'S	Public	Kenmoor Early Childhood Center	3211 82nd Avenue	Landover	20785	Kenmoor Early Childhood Center
PRINCE GEORGE'S	Public	Kenmoor Middle	2500 Kenmoor Drive	Landover	20785	Kenmoor Middle
PRINCE GEORGE'S	Public	Kettering Elementary	11000 Layton Street	Upper Marlboro	20772	Kettering Elementary
PRINCE GEORGE'S	Public	Kingsford Elementary	1401 Enterprise Road	Mitchellville	20721	Kingsford Elementary
PRINCE GEORGE'S	Public	Lamont Elementary	7101 Good Luck Road	New Carrollton	20784	Lamont Elementary
PRINCE GEORGE'S	Public	Largo High	505 Largo Road	Upper Marlboro	20772	Largo High
PRINCE GEORGE'S	Public	Laurel High	8000 Cherry Lane	Laurel	20707	Laurel High
PRINCE GEORGE'S	Public	Laurel High Auditorium	8000 Cherry Lane	Laurel	20707	Laurel High Auditorium
PRINCE GEORGE'S	Public	Longfields Elementary	3300 Newkirk Avenue	Forestville	20747	Longfields Elementary
PRINCE GEORGE'S	Public	Margaret Brent Regional	5816 Lamont Terr.	New Carrollton	20784	Margaret Brent Regional
PRINCE GEORGE'S	Public	Marlton Elementary	8506 Old Colony-South Drive	Upper Marlboro	20772	Marlton Elementary
PRINCE GEORGE'S	Public	Maya Angelou French Immersion	2000 Callaway Street	Temple Hills	20748	Maya Angelou French Immersion

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
PRINCE GEORGE'S	Public	Montpelier Elementary	9200 Muirkirk Road	Laurel	20708	Montpelier Elementary
PRINCE GEORGE'S	Public	Oaklands Elementary	13710 Laurel-Bowie Road	Laurel	20708	Oaklands Elementary
PRINCE GEORGE'S	Public	Oxon Hill Elementary	7701 Livingston Road	Oxon Hill	20745	Oxon Hill Elementary
PRINCE GEORGE'S	Public	Phyllis E. Williams Spanish Immersion	9601 Prince Place	Upper Marlboro	20772	Phyllis E. Williams Spanish Immersion
PRINCE GEORGE'S	Public	Pointer Ridge Elementary	1110 Parkington Lane	Bowie	20716	Pointer Ridge Elementary
PRINCE GEORGE'S	Public	Port Towns Elementary	4351 58th Avenue	Bladensburg	20710	Port Towns Elementary
PRINCE GEORGE'S	Public	Potomac High	5211 Boydell Avenue	Oxon Hill	20745	Potomac High
PRINCE GEORGE'S	Public	Potomac Landing Elementary	12500 Fort Washington Road	Fort Washington	20744	Potomac Landing Elementary
PRINCE GEORGE'S	Public	Riverdale Elementary	5006 Riverdale Road	Riverdale	20737	Riverdale Elementary
PRINCE GEORGE'S	Public	Robert Goddard Montessori	9850 Good Luck Road	Seabrook	20706	Robert Goddard Montessori
PRINCE GEORGE'S	Public	Rockledge Elementary	7701 Laurel-Bowie Road	Bowie	20715	Rockledge Elementary
PRINCE GEORGE'S	Public	Rogers Heights Elementary	4301 58th Avenue	Bladensburg	20710	Rogers Heights Elementary
PRINCE GEORGE'S	Public	Samuel Chase Elementary	5700 Fisher Road	Temple Hills	20748	Samuel Chase Elementary
PRINCE GEORGE'S	Public	Samuel Ogle Middle	4111 Chelmont Lane	Bowie	20715	Samuel Ogle Middle
PRINCE GEORGE'S	Public	Samuel P. Massie Academy	3301 Regency Parkway	Forestville	20747	Samuel P. Massie Academy

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID
PRINCE GEORGE'S	Nonpublic	St. Columba School	7800 Livingston Road	Oxon Hill	20745	St. Columba School
PRINCE GEORGE'S	Nonpublic	St. Mary's	106 St. Mary's Place	Laurel	20707	St. Mary's
PRINCE GEORGE'S	Public	Suitland Elementary	4650 Homer Avenue	Suitland	20746	Suitland Elementary
PRINCE GEORGE'S	Public	Suitland High	5200 Silver Hill Road	Forestville	20747	Suitland High
PRINCE GEORGE'S	Public	Surrattsville High	6101 Garden Drive	Clinton	20735	Surrattsville High
PRINCE GEORGE'S	Public	Tall Oaks High	2112 Church Road	Bowie	20716	Tall Oaks High
PRINCE GEORGE'S	Public	Thomas Johnson Middle	5401 Barker Pl.	Lanham	20706	Thomas Johnson Middle
PRINCE GEORGE'S	Public	Thurgood Marshall Middle	4909 Brinkley Road	Temple Hills	20748	Thurgood Marshall Middle
PRINCE GEORGE'S	Public	Whitehall Elementary	3901 Woodhaven Lane	Bowie	20715	Whitehall Elementary
PRINCE GEORGE'S	Public	William Wirt Middle	6200 Tuckerman Street	Riverdale	20737	William Wirt Middle
PRINCE GEORGE'S	Public	William Beanes Elementary	5108 Dianna Drive	Suitland	20746	William Beanes Elementary
PRINCE GEORGE'S	Public	William W. Hall Elementary	5200 Marlboro Pike	Capitol Heights	20743	William W. Hall Elementary
PRINCE GEORGE'S	Public	Woodmore Elementary	12500 Woodmore Road	Mitchellville	20721	Woodmore Elementary
PRINCE GEORGE'S	Public	Yorktown Elementary	7301 Race Track Road	Bowie	20715	Yorktown Elementary

Appendix F: Table 12. Three-Year Deferrals - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018
*NOTE: All three-year deferrals are currently under review. Some schools have also applied for a twelve-month deferral.

APPENDIX G

Tables 13-15. Waiver Applications Received, Reporting Period
Ending July 1, 2018

Table 13. Waivers - Prior Testing (Type 1) - Public, Charter, and Nonpublic Schools

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Charter	Afya Public Charter School	2800 Brendan Avenue	Baltimore	21213	Afya Public Charter School	Under Review
BALTIMORE CITY	Nonpublic	Arts and Ideas Sudbury School	4915 Holder Avenue	Baltimore	21214	Arts and Ideas Sudbury School	Under Review
BALTIMORE CITY	Charter	The Green School	2851 Kentucky Avenue	Baltimore	21213	The Green School	Under Review
BALTIMORE CITY	Charter	Tunbridge Public Charter School	5504 York Road	Baltimore	21212	Tunbridge Public Charter School	Under Review
CALVERT	Nonpublic	Our Lady Star of the Sea School	90 Alexander Lane	Solomons	20688	Our Lady Star of the Sea School	Denied
CHARLES	Nonpublic	Archbishop Neale School	104 Port Tobacco Road	LaPlata	20646	Archbishop Neale School	Denied
PRINCE GEORGE'S	Nonpublic	St. Pius X Regional School	14710 Annapolis Road	Bowie	20715	St. Pius X Regional School	Denied
PRINCE GEORGE'S	Nonpublic	St. Mary of Piscataway	13407 Piscataway Road	Clinton	20735	St. Mary of Piscataway	Denied
PRINCE GEORGE'S	Nonpublic	St. Ambrose School	6310 Jason Street	Cheverly	20785	Main Building	Denied
PRINCE GEORGE'S	Nonpublic	St. Jerome Academy	5207 42nd Place	Hyattsville	20781	St. Jerome Academy	Denied
PRINCE GEORGE'S	Nonpublic	St. Jerome's Child Center	5300 43rd Avenue	Hyattsville	20781	St. Jerome's Child Center	Denied
ST. MARY'S	Nonpublic	Father Andrew White S.J. School	22850 Washington Street	Leonardtown	20650	Father Andrew White S.J. School	Denied

Table 14. Waivers - Bottled Water (Type 2) - Public, Charter, and Nonpublic Schools

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	Abbottston Elementary	1300 Gorsuch Avenue	Baltimore	21218	Abbottston Elementary	Denied
BALTIMORE CITY	Public	Alexander Hamilton Elementary	800 Poplar Grove Street	Baltimore	21216	Alexander Hamilton Elementary	Denied
BALTIMORE CITY	Public	Arlington Elementary/Middle at Garrison	3910 Barrington Road	Baltimore	21217	Arlington Elementary/Middle at Garrison	Denied
BALTIMORE CITY	Public	Armistead Gardens Elementary/Middle	5001 E. Eager Street	Baltimore	21205	Armistead Gardens Elementary/Middle	Denied
BALTIMORE CITY	Public	Baltimore Collegiate School for Boys at Chinquapin	900 Winston Avenue	Baltimore	21212	Baltimore Collegiate School for Boys at Chinquapin	Denied
BALTIMORE CITY	Public	Barclay Elementary/Middle	2900 Barclay Street	Baltimore	21218	Barclay Elementary/Middle	Denied
BALTIMORE CITY	Public	Bay-Brook Elementary/Middle	4411 Sixth Street	Baltimore	21225	Bay-Brook Elementary/Middle	Denied
BALTIMORE CITY	Public	Beechfield Elementary/Middle	301 S. Beechfield Avenue	Baltimore	21229	Beechfield Elementary/Middle	Denied
BALTIMORE CITY	Public	Belmont Elementary	1406 N. Ellamont Street	Baltimore	21216	Belmont Elementary	Denied
BALTIMORE CITY	Public	Benjamin Franklin High at Masonville Cove	1201 Cambria Street	Baltimore	21225	Benjamin Franklin High at Masonville Cove	Denied
BALTIMORE CITY	Public	Booker T. Washington Middle	1301 McCulloh Street	Baltimore	21217	Booker T. Washington Middle	Denied
BALTIMORE CITY	Public	Brehms Lane Public Charter School	3536 Brehms Lane	Baltimore	21213	Brehms Lane Public Charter School	Denied
BALTIMORE CITY	Public	Callaway Elementary	3701 Fernhill Avenue	Baltimore	21215	Callaway Elementary	Denied
BALTIMORE CITY	Public	Calverton Elementary/Middle at West Balto Elementary	201 North Bend Road	Baltimore	21229	Calverton Elementary/Middle at West Balto Elementary	Denied
BALTIMORE CITY	Public	Calvin M. Rodwell Elementary	3501 Hillsdale Road	Baltimore	21207	Calvin M. Rodwell Elementary	Denied
BALTIMORE CITY	Public	Cecil Elementary	2000 Cecil Avenuenue	Baltimore	21218	Cecil Elementary	Denied
BALTIMORE CITY	Public	Charles Carroll Barrister Elementary	1307 Washington Blvd	Baltimore	21230	Charles Carroll Barrister Elementary	Denied

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	City Neighbors Hamilton at Hamilton	5609 Sefton Avenue	Baltimore	21214	City Neighbors Hamilton at Hamilton	Denied
BALTIMORE CITY	Public	City Springs Elementary/Middle	100 S. Caroline Street	Baltimore	21231	City Springs Elementary/Middle	Denied
BALTIMORE CITY	Public	Claremont School	5301 Erdman Avenue	Baltimore	21205	Claremont School	Denied
BALTIMORE CITY	Public	Collington Square Elementary/Middle	1409 N. Collington Avenue	Baltimore	21213	Collington Square Elementary/Middle	Denied
BALTIMORE CITY	Public	Commodore John Rodgers Elementary/Middle	100 N. Chester Street	Baltimore	21231	Commodore John Rodgers Elementary/Middle	Denied
BALTIMORE CITY	Public	Cross Country Elementary/Middle	6100 Cross Country Blvd	Baltimore	21215	Cross Country Elementary/Middle	Denied
BALTIMORE CITY	Public	Curtis Bay Elementary/Middle	4301 West Bay Avenue	Baltimore	21225	Curtis Bay Elementary/Middle	Denied
BALTIMORE CITY	Public	Dallas F. Nicholas Sr. Elementary	201 W. 21st Street	Baltimore	21218	Dallas F. Nicholas Sr. Elementary	Denied
BALTIMORE CITY	Public	Dickey Hill Elementary/Middle	5025 Dickey Hill Road	Baltimore	21207	Dickey Hill Elementary/Middle	Denied
BALTIMORE CITY	Public	Dr. Bernard Harris, Sr., Elementary	1400 N. Caroline Street	Baltimore	21213	Dr. Bernard Harris, Sr., Elementary	Denied
BALTIMORE CITY	Public	Dr. Martin Luther King, Jr., Elementary/Middle	3750 Greenspring Avenue	Baltimore	21211	Dr. Martin Luther King, Jr., Elementary/Middle	Denied
BALTIMORE CITY	Public	Dr. Nathan A. Pitts-Ashburton Elementary/Middle	3935 Hilton Street	Baltimore	21215	Dr. Nathan A. Pitts-Ashburton Elementary/Middle	Denied
BALTIMORE CITY	Public	Edgecombe Circle Elementary	1900 Edgewood Street	Baltimore	21215	Edgecombe Circle Elementary	Denied
BALTIMORE CITY	Public	Edgewood Elementary	1900 Edgewood Street	Baltimore	21216	Edgewood Elementary	Denied
BALTIMORE CITY	Public	Eutaw-Marshburn Elementary	1624 Eutaw Place	Baltimore	21217	Eutaw-Marshburn Elementary	Denied
BALTIMORE CITY	Public	Excel Academy at Francis M. Wood High	1001 W. Saratoga Street	Baltimore	21223	Excel Academy at Francis M. Wood High	Denied
BALTIMORE CITY	Public	Fallstaff Elementary/Middle	3801 Fallstaff Road	Baltimore	21215	Fallstaff Elementary/Middle	Denied
BALTIMORE CITY	Public	Federal Hill Preparatory Academy	1040 William Street	Baltimore	21230	Federal Hill Preparatory Academy	Denied

Appendix G: Table 14. Waivers - Bottled Water (Type 2) - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	Francis Scott Key Elementary/Middle	1425 E. Fort Avenue	Baltimore	21230	Francis Scott Key Elementary/Middle	Denied
BALTIMORE CITY	Public	Franklin Square Elementary/Middle	1400 W. Lexington Street	Baltimore	21223	Franklin Square Elementary/Middle	Denied
BALTIMORE CITY	Public	Furley Elementary at Herring Run	5001 Sinclair Lane	Baltimore	21206	Furley Elementary at Herring Run	Denied
BALTIMORE CITY	Public	Furman Templeton Preparatory Academy	1200 N. Pennsylvania Avenue	Baltimore	21217	Furman Templeton Preparatory Academy	Denied
BALTIMORE CITY	Public	Gardenville Elementary	5300 Belair Road	Baltimore	21206	Gardenville Elementary	Denied
BALTIMORE CITY	Public	Garrett Heights Elementary/Middle	2800 Ailsa Avenue	Baltimore	21214	Garrett Heights Elementary/Middle	Denied
BALTIMORE CITY	Public	George W. F. McMechen High	800 Scott Street	Baltimore	21215	George W. F. McMechen High	Denied
BALTIMORE CITY	Public	George Washington Elementary	800 Scott Street	Baltimore	21230	George Washington Elementary	Denied
BALTIMORE CITY	Public	Gilmor Elementary	1311 N. Gilmor Street	Baltimore	21217	Gilmor Elementary	Denied
BALTIMORE CITY	Public	Glenmount Elementary/Middle	6211 Walther Avenue	Baltimore	21206	Glenmount Elementary/Middle	Denied
BALTIMORE CITY	Nonpublic	God's Little Cherubs Elementary School	5300 Gwynn Oak Avenue	Baltimore	21207	God's Little Cherubs Elementary School	Under Review
BALTIMORE CITY	Public	Govans Elementary	5801 York Road	Baltimore	21212	Govans Elementary	Denied
BALTIMORE CITY	Public	Graceland Park/O'Donnell Heights Elementary/Middle	6300 O'Donnell Street	Baltimore	21224	Graceland Park/O'Donnell Heights Elementary/Middle	Denied
BALTIMORE CITY	Public	Guilford Elementary/Middle	4520 York Road	Baltimore	21212	Guilford Elementary/Middle	Denied
BALTIMORE CITY	Public	Gwynns Falls Elementary	2700 Gwynns Falls Pkwy	Baltimore	21216	Gwynns Falls Elementary	Denied
BALTIMORE CITY	Nonpublic	H.O.P.E. Academy	1808 Edison Highway	Baltimore	21213	H.O.P.E. Academy	Under Review
BALTIMORE CITY	Public	Hamilton Elementary/Middle	6101 Old Harford Road	Baltimore	21214	Hamilton Elementary/Middle	Denied
BALTIMORE CITY	Public	Hampden Elementary/Middle	3608 Chestnut Avenue	Baltimore	21211	Hampden Elementary/Middle	Denied

Appendix G: Table 14. Waivers - Bottled Water (Type 2) - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	Hampstead Hill Academy	500 S. Linwood Avenue	Baltimore	21224	Hampstead Hill Academy	Denied
BALTIMORE CITY	Public	Harford Heights Elementary	1919 N. Broadway Street	Baltimore	21213	Harford Heights Elementary	Denied
BALTIMORE CITY	Public	Harlem Park Elementary Middle	1401 W. Lafayette Avenue	Baltimore	21217	Harlem Park Elementary Middle	Denied
BALTIMORE CITY	Public	Hazelwood Elementary/Middle	4517 Hazelwood Avenue	Baltimore	21206	Hazelwood Elementary/Middle	Denied
BALTIMORE CITY	Public	Highlandtown Elementary/Middle	3223 E. Pratt Street	Baltimore	21224	Highlandtown Elementary/Middle	Denied
BALTIMORE CITY	Public	Hilton Elementary	3301 Calisle Avenue	Baltimore	21216	Hilton Elementary	Denied
BALTIMORE CITY	Public	Holabird Elementary/Middle	1500 Imla Street	Baltimore	21224	Holabird Elementary/Middle	Denied
BALTIMORE CITY	Public	James McHenry Elementary/Middle	31 S. Schroeder Street	Baltimore	21223	James McHenry Elementary/Middle	Denied
BALTIMORE CITY	Public	James Mosher Elementary	31 S. Schroeder Street	Baltimore	21216	James Mosher Elementary	Denied
BALTIMORE CITY	Public	John Ruhrah Elementary/Middle at Southeast Middle	6820 Fait Avenue	Baltimore	21224	John Ruhrah Elementary/Middle at Southeast Middle	Denied
BALTIMORE CITY	Public	Johnston Square Elementary	1101 Valley Street	Baltimore	21202	Johnston Square Elementary	Denied
BALTIMORE CITY	Public	KIPP Academy at Greenspring	4701 Greenspring Avenue	Baltimore	21209	KIPP Academy at Greenspring	Denied
BALTIMORE CITY	Public	Lakeland Elementary/Middle	2921 Stranden Road	Baltimore	21230	Lakeland Elementary/Middle	Denied
BALTIMORE CITY	Public	Lakewood Elementary	2625 Federal Street	Baltimore	21213	Lakewood Elementary	Denied
BALTIMORE CITY	Public	Liberty Elementary	3901 Maine Avenue	Baltimore	21207	Liberty Elementary	Denied
BALTIMORE CITY	Public	Lillie May Carroll Jackson School at Chinquapin	900 Woodbourne	Baltimore	21212	Lillie May Carroll Jackson School at Chinquapin	Denied
BALTIMORE CITY	Public	Lockerman Bundy Elementary	301 N. Pulaski Street	Baltimore	21223	Lockerman Bundy Elementary	Denied
BALTIMORE CITY	Public	Lois T. Murray Elementary/Middle	1600 Arlington Avenue	Baltimore	21239	Lois T. Murray Elementary/Middle	Denied

Appendix G: Table 14. Waivers - Bottled Water (Type 2) - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	Maree G. Farring Elementary/Middle	300 Pontiac Avenue	Baltimore	21225	Maree G. Farring Elementary/Middle	Denied
BALTIMORE CITY	Public	Margaret Brent Elementary/Middle	100 E. 26th Street	Baltimore	21218	Margaret Brent Elementary/Middle	Denied
BALTIMORE CITY	Public	Mary Ann Winterling Elementary at Bentalou	201 North Bend Road	Baltimore	21229	Mary Ann Winterling Elementary at Bentalou	Denied
BALTIMORE CITY	Public	Mary E. Rodman Elementary at West Balto	201 North Bend Road	Baltimore	21229	Mary E. Rodman Elementary at West Balto	Denied
BALTIMORE CITY	Public	Matthew A. Henson Elementary	1600 N. Payson Street	Baltimore	21217	Matthew A. Henson Elementary	Denied
BALTIMORE CITY	Public	Medfield Heights Elementary	4300 Buchanan Avenue	Baltimore	21211	Medfield Heights Elementary	Denied
BALTIMORE CITY	Public	Montebello Elementary/Middle	2040 E. 32nd Street	Baltimore	21218	Montebello Elementary/Middle	Denied
BALTIMORE CITY	Public	Moravia Park Elementary	6201 Frankford Avenue	Baltimore	21206	Moravia Park Elementary	Denied
BALTIMORE CITY	Public	Morrell Park Elementary/Middle	2601 Tolley Street	Baltimore	21230	Morrell Park Elementary/Middle	Denied
BALTIMORE CITY	Public	Mount Royal Elementary/Middle	121 McMechen Street	Baltimore	21217	Mount Royal Elementary/Middle	Denied
BALTIMORE CITY	Public	North Bend Elementary/Middle	181 N. Bend Road	Baltimore	21229	North Bend Elementary/Middle	Denied
BALTIMORE CITY	Public	Northwood Elementary	5201 Loch Raven Blvd	Baltimore	21239	Northwood Elementary	Denied
BALTIMORE CITY	Public	Robert W. Coleman Elementary	2400 Windsor Avenue	Baltimore	21216	Robert W. Coleman Elementary	Denied
BALTIMORE CITY	Public	Rognel Heights Elementary/Middle	4300 Sidehill Road	Baltimore	21229	Rognel Heights Elementary/Middle	Denied
BALTIMORE CITY	Public	Roland Park Elementary/Middle	5207 Roland Avenue	Baltimore	21210	Roland Park Elementary/Middle	Denied
BALTIMORE CITY	Public	Roots and Branches School at Harriet Tubman	1807 Harlem Avenue	Baltimore	21217	Roots and Branches School at Harriet Tubman	Denied
BALTIMORE CITY	Public	Rosemont Elementary/Middle	2777 Presstman Street	Baltimore	21216	Rosemont Elementary/Middle	Denied

Appendix G: Table 14. Waivers - Bottled Water (Type 2) - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	Sarah M. Roach Elementary	3434 Old Frederick Road	Baltimore	21229	Sarah M. Roach Elementary	Denied
BALTIMORE CITY	Public	Sharp-Leadenhall Elementary	150 W. West Street	Baltimore	21230	Sharp-Leadenhall Elementary	Denied
BALTIMORE CITY	Public	Sinclair Lane Elementary	3880 Sinclair Lane	Baltimore	21213	Sinclair Lane Elementary	Denied
BALTIMORE CITY	Public	Southwest Baltimore Charter at DiggsJohnson	1300 Herkimer Street	Baltimore	21223	Southwest Baltimore Charter at DiggsJohnson	Denied
BALTIMORE CITY	Public	Stadium School at Coldstream	1400 Exeter Hall Avenue	Baltimore	21218	Stadium School at Coldstream	Denied
BALTIMORE CITY	Public	Steuart Hill Academic Academy	30 S. Gilmor Street	Baltimore	21223	Steuart Hill Academic Academy	Denied
BALTIMORE CITY	Public	Tench Tilghman Elementary/Middle	600 N. Patterson Park Avenue	Baltimore	21205	Tench Tilghman Elementary/Middle	Denied
BALTIMORE CITY	Public	The Historic Samuel Coleridge-Taylor Elementary	507 W. Preston Street	Baltimore	21201	The Historic Samuel Coleridge-Taylor Elementary	Denied
BALTIMORE CITY	Public	The Mount Washington School	1801 Sulgrave Avenue	Baltimore	21209	The Mount Washington School	Denied
BALTIMORE CITY	Public	Thomas Jefferson Elementary/Middle	605 Dryden Drive	Baltimore	21229	Thomas Jefferson Elementary/Middle	Denied
BALTIMORE CITY	Public	Thomas Johnson Elementary/Middle	100 E. Heath Street	Baltimore	21230	Thomas Johnson Elementary/Middle	Denied
BALTIMORE CITY	Public	Walter P. Carter Elementary/Middle	820 E. 43rd Street	Baltimore	21212	Walter P. Carter Elementary/Middle	Denied
BALTIMORE CITY	Public	Westport Academy	2401 Nevada Street	Baltimore	21230	Westport Academy	Denied
BALTIMORE CITY	Public	William Paca Elementary	200 N. Lakewood Avenue	Baltimore	21224	William Paca Elementary	Denied
BALTIMORE CITY	Public	William Pinderhughes Elementary/Middle	1200 N. Fremont Avenue	Baltimore	21217	William Pinderhughes Elementary/Middle	Denied
BALTIMORE CITY	Public	William S. Baer School	2001 N. Warwick Avenue	Baltimore	21216	William S. Baer School	Denied
BALTIMORE CITY	Public	Windsor Hills Elementary/Middle	4001 Alto Road	Baltimore	21216	Windsor Hills Elementary/Middle	Denied
BALTIMORE CITY	Public	Wolfe Street Academy	245 S. Wolfe Street	Baltimore	21231	Wolfe Street Academy	Denied

Appendix G: Table 14. Waivers - Bottled Water (Type 2) - Public, Charter, and Nonpublic Schools - Period Ending July 1, 2018

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
BALTIMORE CITY	Public	Woodhome Elementary/Middle	7300 Moyer Avenue	Baltimore	21234	Woodhome Elementary/Middle	Denied
BALTIMORE CITY	Public	Yorkwood Elementary	5931 Yorkwood Road	Baltimore	21234	Yorkwood Elementary	Denied
BALTIMORE	Nonpublic	Cambridge School	110 Sudbrook Lane	Pikesville	21208	Cambridge School	Under Review
FREDERICK	Nonpublic	St. Thomas More Academy	103 Prospect Street	Middletown	21769	St. Thomas More Academy	Under Review
MONTGOMERY	Nonpublic	Geneva Day School	11931 Seven Locks Road	Potomac	20854	Kindergarten Learning Cottage	Under Review
WICOMICO	Public	Beaver Run Elementary School	31481 Old Ocean City Road	Salisbury	21804	Beaver Run Elementary School	Under Review

Table 15. Waivers - Lead-Free Building (Type 3) - Public, Charter, and Nonpublic Schools

COUNTY	SCHOOL TYPE	SCHOOL NAME	SCHOOL STREET ADDRESS	CITY	ZIP	BUILDING NAME/ID	WAIVER STATUS
CAROLINE	Public	Preston Elementary School	225 Main Street	Preston	21655	Preston Elementary School	Under Review/Also Submitted 12M Deferral
MONTGOMERY	Nonpublic	Spencerville Adventist Academy	2502 Spencerville Road	Spencerville	20868	Spencerville Adventist Academy	Denied/Also Submitted 12M Deferral
PRINCE GEORGE'S	Nonpublic	St. Mary of the Mills School	800 Main Street	Laurel	20707	Keesler Center	Under Review
QUEEN ANNE'S	Nonpublic	Wye River Upper School	316 S. Commerce Street	Centreville	21617	Wye River Upper School	Under Review/Also Submitted 12M Deferral
WORCESTER	Public	Pocomoke High School	1817 Old Virginia Road	Pocomoke	21851	Pocomoke High School	Under Review/Also Submitted 12M Deferral
WORCESTER	Public	Snow Hill High School	305 S. Church Street	Snow Hill	21863	Snow Hill High School	Under Review/Also Submitted 12M Deferral

APPENDIX H

References

General Assembly of Maryland, House Bill 270 (2017, May 4). Retrieved from https://mgaleg.maryland.gov/2017RS/Chapters_noln/CH_386_hb0270t.pdf

Maryland Department of the Environment, Maryland Register (2018, February 2). Retrieved from https://mde.maryland.gov/programs/Water/water_supply/Documents/Maryland_Register_COMAR_26.16.07.pdf

Maryland Department of the Environment, Testing for Lead in Drinking Water – Public and Nonpublic Schools web page (2018). Retrieved from https://mde.maryland.gov/programs/Water/water_supply/Pages/Testing-For-Lead-In-Drinking-Water-Public-and-Nonpublic-Schools.aspx

Maryland Department of the Environment, Testing for Lead in Drinking Water – Public and Nonpublic Schools, Sample Procedures for Collection of Water from Drinking Water Outlets (2018). Retrieved from https://mde.maryland.gov/programs/Water/water_supply/Documents/SLT_Sample_Collection_Instructions.pdf

United States Environmental Protection Agency, Water Infrastructure Improvement for the Nation (WIIN) Grant: Lead Testing in School and Child Care Program Drinking Water (2018). Retrieved from <https://www.epa.gov/dwcapacity/wiin-grant-lead-testing-school-and-child-care-program-drinking-water>